




# ISO-NE Daily Report

Monday March 01, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	34.85	35.34	35.34	35.34	35.34	37.13	46.90	44.76	49.21	50.23	45.94	47.81	45.08	42.83	41.03	40.70	43.71	51.65	61.16	52.75	43.95	39.03	38.71	35.34	43.09	46.16	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	33.70	34.17	34.17	34.17	34.17	35.90	45.35	43.28	47.58	48.57	44.15	46.21	43.57	41.42	39.67	39.35	41.89	48.51	58.04	50.31	42.03	37.74	37.43	34.17	41.48	44.36		
<b>New Hampshire</b>	33.37	33.83	33.83	33.83	33.83	35.54	44.90	42.86	47.11	48.09	43.71	45.76	43.14	41.01	39.28	38.96	41.47	48.00	57.45	49.79	41.60	37.36	37.06	33.83	41.07	43.92		
<b>Maine</b>	32.37	32.82	32.82	32.82	32.82	34.48	43.56	41.57	45.70	46.65	42.40	44.39	41.85	39.78	38.10	37.79	40.22	46.55	55.72	48.30	40.35	36.24	35.95	32.82	39.84	42.60		
<b>Mass Hub</b>	34.00	34.48	34.48	34.48	34.48	36.22	45.76	43.67	48.01	49.01	44.52	46.63	43.96	41.79	40.03	39.70	42.22	48.74	58.43	50.66	42.34	38.08	37.77	34.48	41.83	44.72		
<b>Cleared Load (GW)</b>	10.7	11.3	11.3	11.3	11.7	11.9	13.6	15.3	15.5	15.7	16.0	16.0	15.8	15.7	15.3	15.3	15.7	16.9	17.3	16.8	15.9	14.7	13.2	11.8				

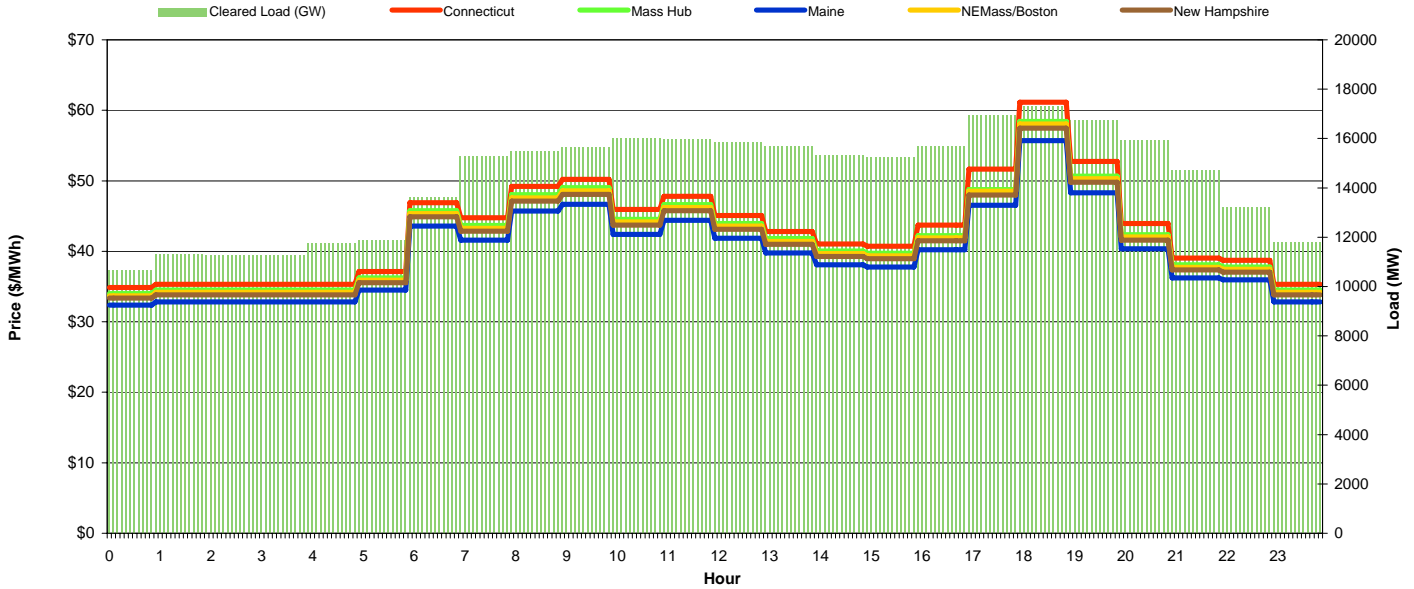

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	39.52	40.52	39.22	40.68	37.09	40.45	49.32	45.69	54.30	43.91	48.35	45.96	41.87	42.04	40.21	38.87	40.47	49.88	56.04	55.70	42.68	39.35	34.24	32.81	43.30	44.97	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	38.71	39.42	38.27	39.68	36.34	39.48	47.96	44.51	52.91	42.63	46.84	44.59	40.76	41.18	39.32	38.12	39.62	48.79	54.65	54.04	41.69	38.39	33.59	32.30	42.24	43.85		
<b>New Hampshire</b>	38.34	39.17	38.03	39.47	36.08	39.21	47.61	44.06	52.39	42.14	46.36	44.19	40.55	40.89	39.03	37.78	39.23	48.19	53.92	53.32	41.32	38.06	33.16	31.85	41.85	43.41		
<b>Maine</b>	37.70	38.34	37.23	38.61	35.50	38.00	46.98	43.46	51.63	41.44	45.58	43.60	39.98	40.19	38.29	36.92	38.35	47.30	53.02	52.23	40.62	37.28	32.61	31.46	43.18	42.66		
<b>Mass Hub</b>	38.91	39.83	38.70	40.15	36.71	39.95	48.35	44.78	53.23	42.95	47.27	44.98	41.10	41.45	39.59	38.33	39.86	49.03	54.91	54.48	41.99	38.65	33.76	32.47	42.56	44.15		
<b>DA Forecast Load (GW)</b>	11.56	11.19	11.03	11.08	11.43	12.52	14.46	15.66	16.05	16.22	16.36	16.32	16.15	16.00	15.78	15.72	16.08	17.11	17.65	17.22	16.47	15.33	13.89	12.67				
<b>Forecast Error %</b>	1.5%	9.7%	13.4%	13.1%	12.5%	9.3%	1.7%	1.3%	1.0%	1.0%	0.3%	0.0%	-0.3%	-0.4%	-0.6%	-0.9%	-1.2%	-1.2%	0.3%	0.7%	0.7%	0.5%	0.4%	1.4%				

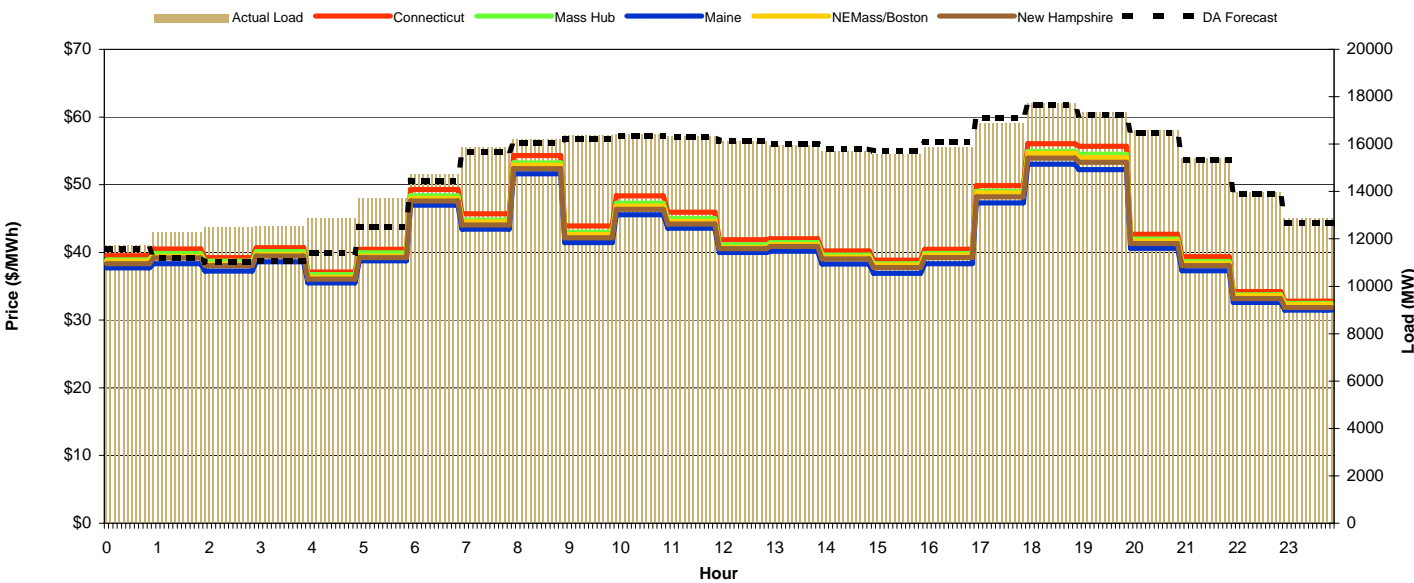




# ISO-NE Daily Report

Tuesday March 02, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	34.83	34.81	31.61	31.78	34.00	38.45	44.99	51.70	48.10	48.06	45.74	45.02	43.14	44.72	41.62	41.56	45.00	54.23	70.00	55.00	50.30	42.13	37.08	35.26	43.71	47.71	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	33.68	33.66	30.57	30.74	32.88	37.18	43.51	50.00	46.52	46.43	44.05	43.29	41.59	43.26	40.26	40.21	43.29	51.69	62.85	51.90	48.65	40.74	35.86	34.10	41.95	45.66		
<b>New Hampshire</b>	33.32	33.30	30.24	30.41	32.53	36.78	43.04	49.46	46.02	45.93	43.57	42.82	41.14	42.79	39.83	39.78	42.82	51.11	62.16	51.33	48.12	40.30	35.47	33.73	41.50	45.17		
<b>Maine</b>	32.33	32.32	29.35	29.51	31.56	35.69	41.77	48.00	42.89	42.85	42.09	41.55	39.92	38.00	34.23	33.67	41.55	49.60	60.29	49.80	46.70	39.11	34.43	32.74	39.58	42.79		
<b>Mass Hub</b>	33.98	33.96	30.84	31.01	33.17	37.51	43.90	50.44	46.93	46.83	44.41	43.64	41.94	43.64	40.62	40.56	43.64	52.04	63.42	52.33	49.08	41.10	36.18	34.40	42.32	46.05		
<b>Cleared Load (GW)</b>	11.7	11.4	12.0	11.8	11.7	12.2	14.2	14.8	15.5	15.7	15.5	15.7	15.6	15.1	14.8	14.9	15.1	16.5	16.8	16.0	15.2	14.1	13.1	12.1				

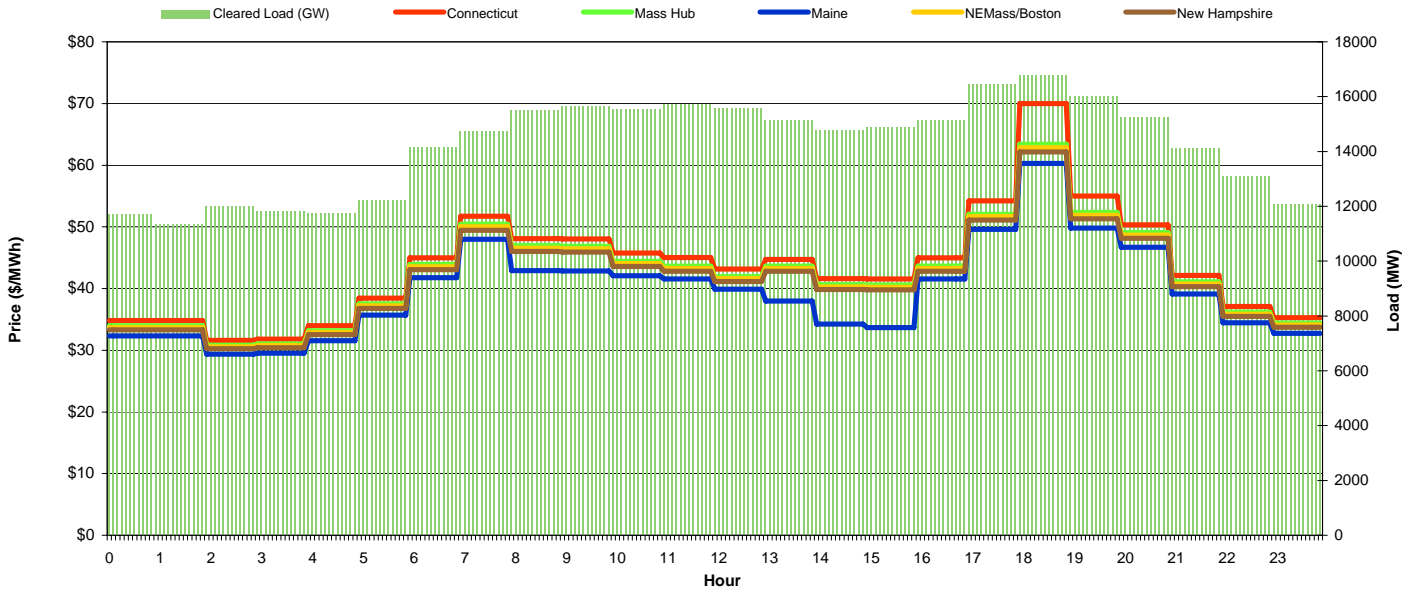

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	32.80	32.69	30.15	30.12	30.38	37.12	48.92	48.86	42.21	40.70	40.62	39.53	39.65	40.27	39.73	40.08	41.03	47.49	53.76	54.26	46.46	41.52	32.52	30.47	40.06	43.04	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	31.97	31.75	29.30	29.28	29.58	36.20	47.78	47.44	40.67	39.31	39.25	38.45	38.65	39.17	38.65	38.89	39.88	46.22	52.14	52.31	44.77	40.41	31.79	29.84	38.90	41.75		
<b>New Hampshire</b>	31.62	31.46	29.03	29.00	29.31	35.87	47.48	46.99	40.24	38.79	38.73	37.95	38.18	38.79	38.26	38.50	39.51	45.60	51.46	51.70	44.36	39.99	31.32	29.42	38.48	41.27		
<b>Maine</b>	31.14	30.89	28.48	28.38	28.72	35.80	46.55	45.96	39.05	36.55	36.87	36.58	36.68	36.65	30.41	36.61	38.38	44.20	49.87	50.15	43.00	38.82	30.46	29.04	39.23	39.39		
<b>Mass Hub</b>	32.33	32.20	29.73	29.71	29.99	36.60	48.14	47.82	41.11	39.69	39.61	38.74	38.91	39.48	38.94	39.19	40.17	46.48	52.45	52.79	45.25	40.76	32.03	30.07	39.26	42.09		
<b>DA Forecast Load (GW)</b>	11.89	11.46	11.25	11.25	11.58	12.67	14.66	15.80	16.07	16.21	16.27	16.20	16.01	15.93	15.73	15.69	16.07	17.03	17.54	17.22	16.57	15.45	14.03	12.70				
<b>Forecast Error %</b>	6.1%	9.8%	12.3%	12.0%	11.3%	3.9%	-1.6%	-1.7%	-2.2%	-3.1%	-3.8%	-4.1%	-4.1%	-4.3%	-4.1%	-4.3%	-4.5%	-3.4%	-1.2%	-1.2%	-1.4%	-1.6%	-1.2%	2.1%				

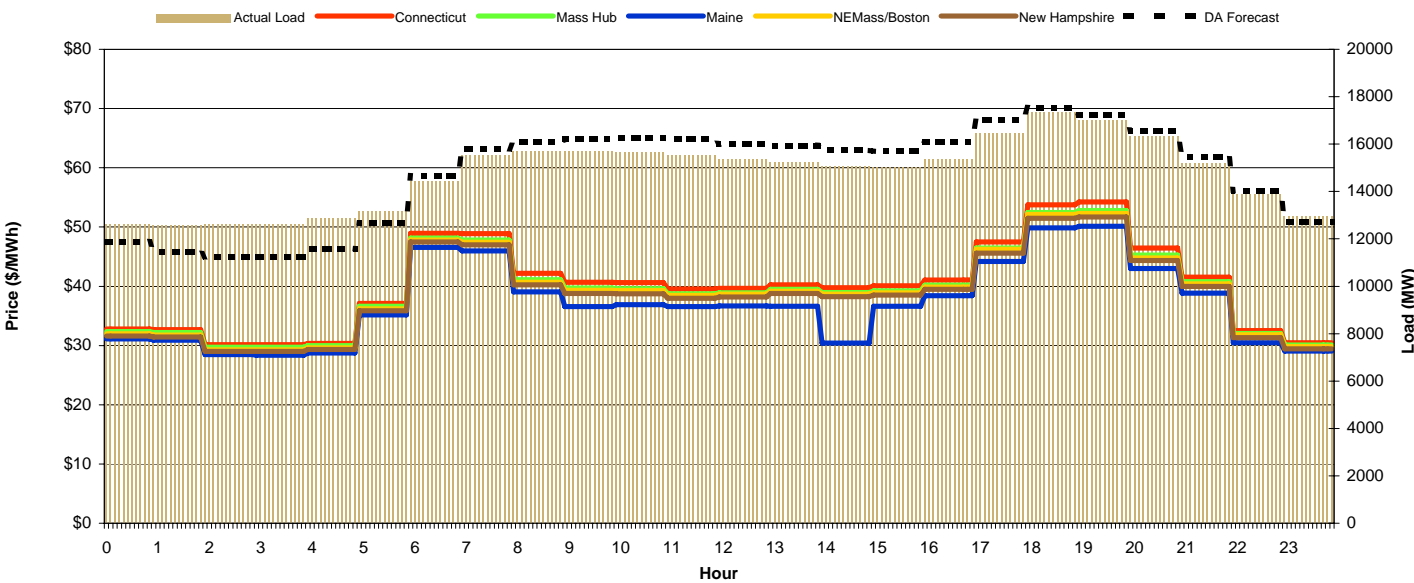




# ISO-NE Daily Report

Wednesday March 03, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	32.90	31.89	31.59	31.59	31.59	34.08	43.52	56.00	58.84	59.06	59.70	59.71	56.84	53.35	50.00	47.00	55.00	69.78	75.00	70.48	61.75	42.41	40.26	35.97	49.51	57.20	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	31.81	30.84	30.54	30.54	30.54	32.95	41.98	42.41	41.05	41.29	43.67	43.78	43.07	41.60	40.36	40.10	42.76	48.00	55.48	48.63	44.35	41.01	38.93	33.63	39.97	43.53		
<b>New Hampshire</b>	31.45	30.48	30.19	30.19	30.19	32.57	41.50	41.89	40.54	40.76	43.13	43.24	42.54	41.09	39.88	39.62	42.23	47.38	54.78	48.01	43.80	40.54	38.48	33.24	39.49	42.99		
<b>Maine</b>	30.57	29.63	29.35	29.35	29.35	31.66	40.34	40.64	39.29	39.51	41.82	41.93	41.27	39.88	38.71	38.48	40.98	45.94	53.14	46.54	42.48	39.41	37.40	32.31	38.33	41.71		
<b>Mass Hub</b>	32.10	31.12	30.82	30.82	30.82	33.25	42.36	42.82	41.46	41.65	44.08	44.20	43.49	42.00	40.75	40.47	43.12	48.39	55.93	49.05	44.78	41.38	39.28	33.94	40.34	43.93		
<b>Cleared Load (GW)</b>	11.5	11.2	11.2	11.2	11.6	11.8	14.1	15.1	15.5	15.5	15.5	15.6	15.4	15.1	14.9	14.9	15.4	16.6	16.8	16.4	15.5	14.4	12.7	11.6				

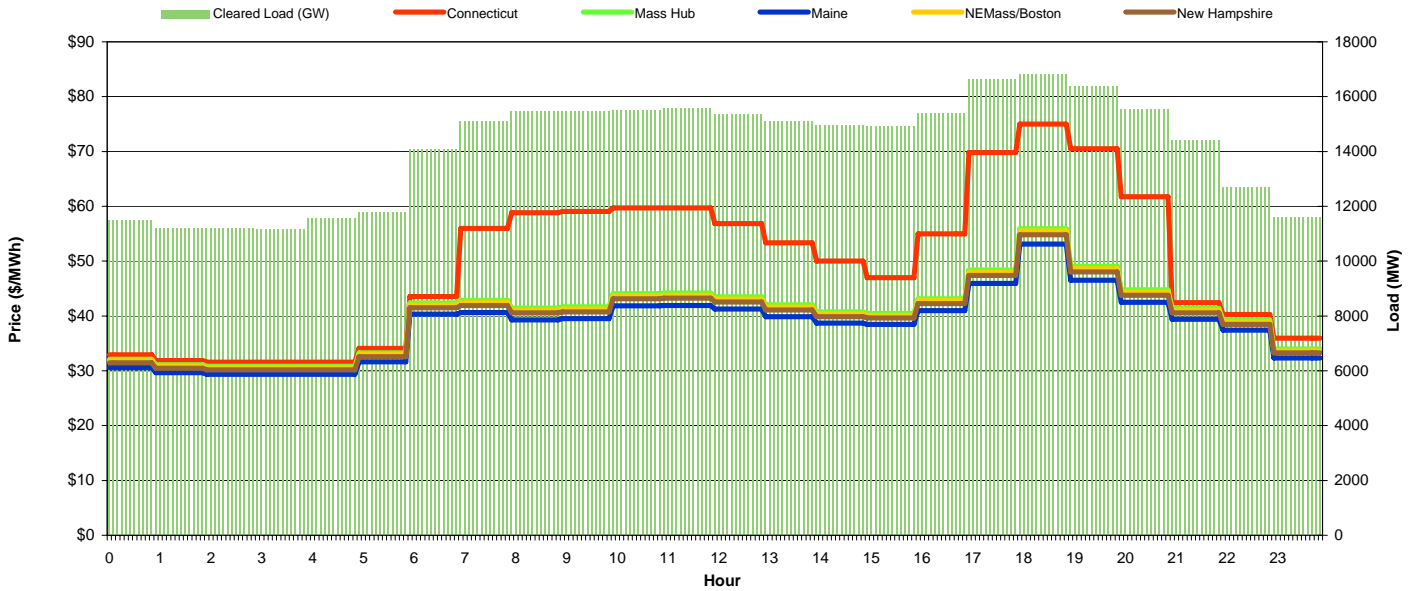

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	34.75	35.70	32.63	34.57	28.97	29.85	48.99	46.25	42.78	44.26	48.63	53.38	58.64	52.90	53.77	52.33	54.68	71.33	74.35	69.04	66.89	44.15	43.76	39.50	48.42	54.82	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	33.94	35.01	32.01	33.84	28.48	29.37	47.99	44.99	41.50	42.98	47.00	51.57	57.33	51.62	52.67	51.56	53.76	70.25	73.49	67.99	65.59	43.27	43.25	39.12	47.44	53.68		
<b>New Hampshire</b>	33.56	34.74	31.79	33.59	28.28	29.12	47.60	44.54	41.15	42.64	46.53	50.92	56.24	50.56	51.49	50.36	52.43	68.27	71.44	66.20	64.17	42.30	42.29	38.36	46.61	52.60		
<b>Maine</b>	33.21	34.31	31.40	33.12	28.02	28.00	46.84	43.25	40.03	41.36	44.78	48.83	53.83	48.07	48.83	47.85	49.87	65.40	68.33	63.62	61.39	40.47	40.68	37.50	47.46	50.41		
<b>Mass Hub</b>	34.23	35.30	32.29	34.21	28.77	29.60	48.30	45.29	41.88	43.39	47.52	52.08	57.44	51.77	52.81	51.65	53.86	70.14	73.35	67.94	65.69	43.43	43.34	39.18	47.64	53.85		
<b>DA Forecast Load (GW)</b>	11.72	11.32	11.09	11.11	11.50	12.56	14.38	15.64	15.97	16.20	16.38	16.56	16.41	16.42	16.08	15.94	16.44	17.24	17.80	17.41	16.81	15.50	14.28	12.85				
<b>Forecast Error %</b>	1.5%	3.0%	5.6%	7.8%	8.2%	2.8%	0.8%	1.4%	2.0%	1.7%	1.3%	0.2%	0.8%	0.4%	1.6%	2.5%	1.5%	2.0%	1.7%	1.7%	0.8%	1.7%	0.0%	0.3%				

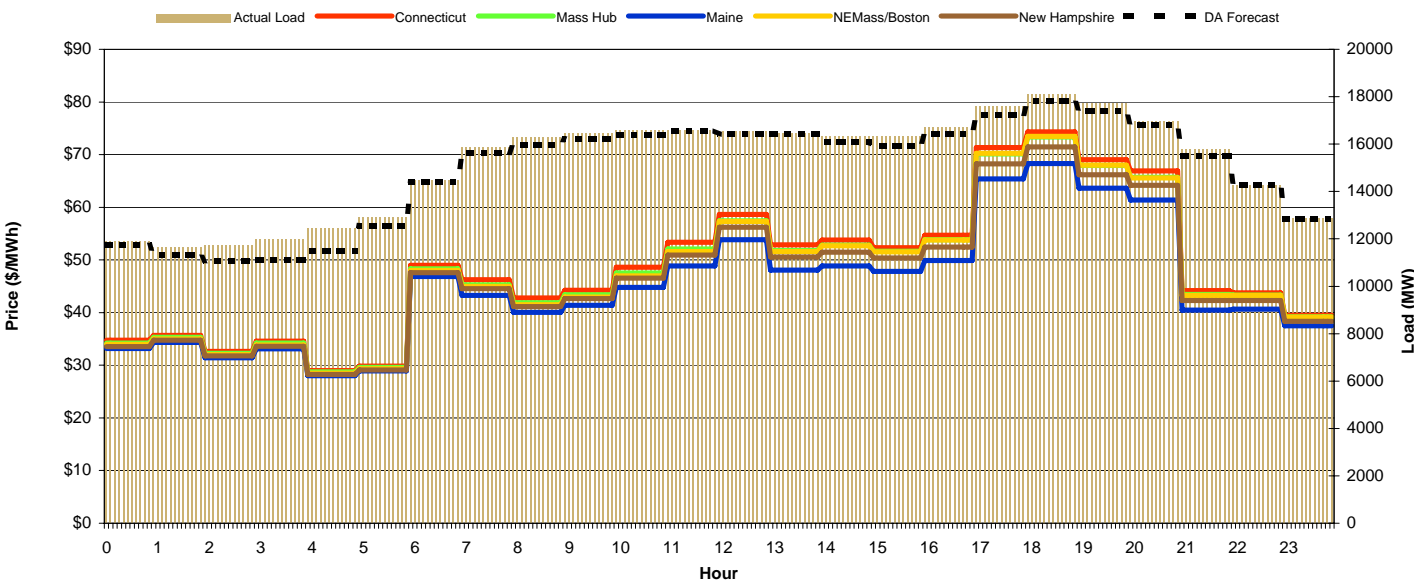




# ISO-NE Daily Report

Thursday March 04, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$		
<b>Connecticut</b>	34.96	34.70	33.44	33.44	33.00	35.54	46.25	48.21	48.58	49.00	48.94	49.29	48.47	47.24	46.00	45.81	47.87	55.46	63.59	56.14	50.32	46.93	40.76	38.08	38.08	46.81	52.16
<b>NEMass/Boston</b>	33.81	33.56	32.34	32.34	31.92	34.38	44.73	46.64	46.99	47.40	47.34	47.68	46.88	45.69	44.50	44.31	46.31	53.64	61.51	54.30	48.67	45.39	39.42	36.83	43.61	45.85	50.89
<b>New Hampshire</b>	33.40	33.15	31.95	31.95	31.53	33.96	44.19	46.07	46.42	46.82	46.76	47.10	46.31	45.14	43.96	43.77	45.74	52.99	60.76	53.64	48.08	44.84	38.95	36.39	43.08	44.98	49.90
<b>Maine</b>	32.45	32.21	31.04	31.04	30.64	33.00	42.94	44.77	45.10	45.50	45.44	45.77	45.00	43.86	42.72	42.53	44.45	51.49	59.04	52.13	46.72	43.57	37.84	35.36	41.86	45.52	47.48
<b>Mass Hub</b>	34.11	33.86	32.63	32.63	32.20	34.68	45.13	47.05	47.41	47.82	47.76	48.11	47.30	46.10	44.90	44.71	46.72	54.12	62.06	54.79	49.10	45.79	39.78	37.16	44.00	46.09	51.17
<b>Cleared Load (GW)</b>	11.3	11.0	11.1	11.0	11.3	11.6	14.0	15.1	15.1	15.1	15.2	15.0	14.9	14.9	14.7	14.7	15.0	16.2	16.7	16.1	15.2	13.8	12.7	11.7			

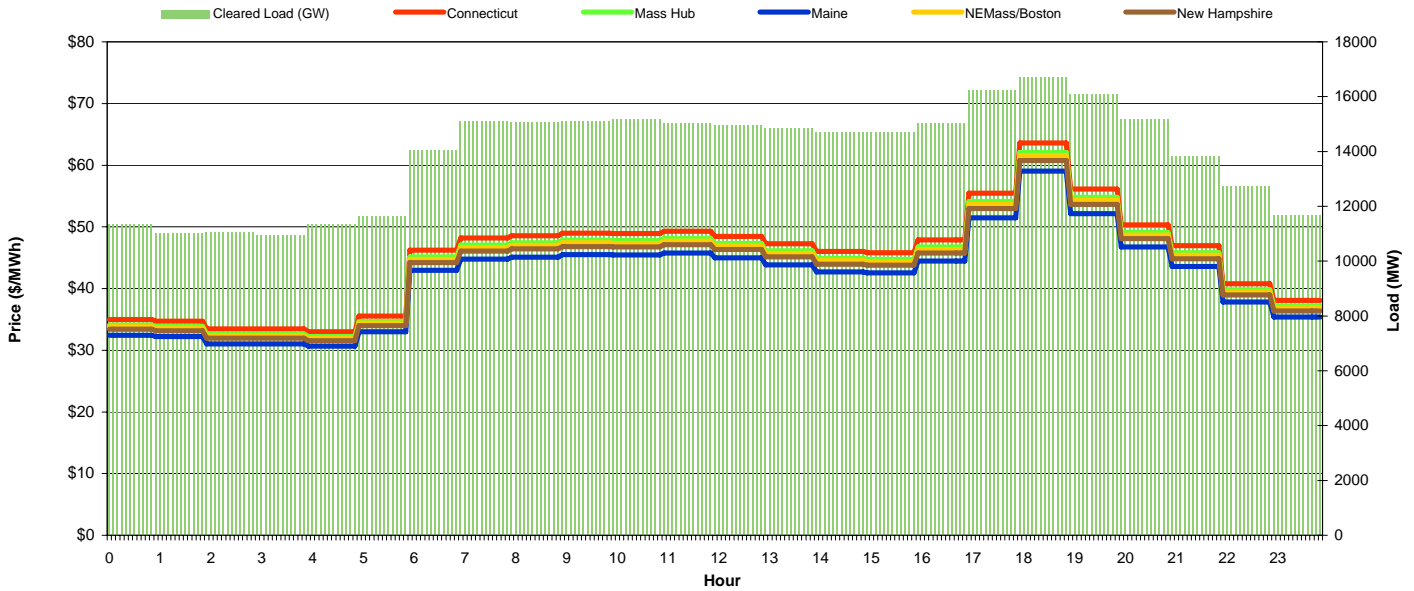

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$		
<b>Connecticut</b>	35.44	36.61	35.34	33.86	34.52	31.15	45.24	47.01	45.59	50.08	52.98	51.89	42.86	44.95	47.88	45.15	53.64	61.30	58.11	62.98	66.16	65.23	38.74	36.63	46.81	46.81	52.16
<b>NEMass/Boston</b>	35.27	36.40	34.98	33.58	34.28	30.81	44.57	45.83	44.52	48.91	51.69	50.54	41.88	43.69	46.40	44.07	52.41	59.46	56.72	61.67	64.57	63.76	38.11	36.22	45.85	45.85	50.89
<b>New Hampshire</b>	34.68	35.84	34.41	33.03	33.66	30.25	43.81	44.83	43.60	47.93	50.54	49.52	41.21	43.04	45.70	43.42	51.60	58.12	55.48	60.30	63.22	62.50	37.34	35.60	44.98	44.98	49.90
<b>Maine</b>	34.00	35.07	33.64	32.32	32.95	88.00	42.02	42.65	41.35	45.32	47.67	46.74	39.14	40.83	43.54	41.59	49.59	55.27	52.83	57.58	60.08	59.65	35.84	34.89	45.52	45.52	47.48
<b>Mass Hub</b>	35.35	36.55	35.21	33.77	34.45	30.97	44.71	46.12	44.74	49.16	51.96	50.86	42.19	44.09	46.85	44.41	52.77	59.87	56.96	61.81	64.73	64.00	38.27	36.38	46.09	46.09	51.17
<b>DA Forecast Load (GW)</b>	11.98	11.56	11.40	11.41	11.73	12.82	14.67	15.89	16.27	16.33	16.38	16.30	16.09	16.02	15.88	15.87	16.25	17.17	17.73	17.37	16.65	15.54	14.16	12.82			
<b>Forecast Error %</b>	4.1%	6.0%	8.7%	8.4%	6.7%	3.3%	0.1%	-0.4%	-0.8%	-0.6%	-0.5%	-0.2%	0.0%	-0.1%	0.0%	-0.1%	-0.3%	-0.2%	0.4%	0.7%	0.8%	0.8%	0.7%	3.7%			

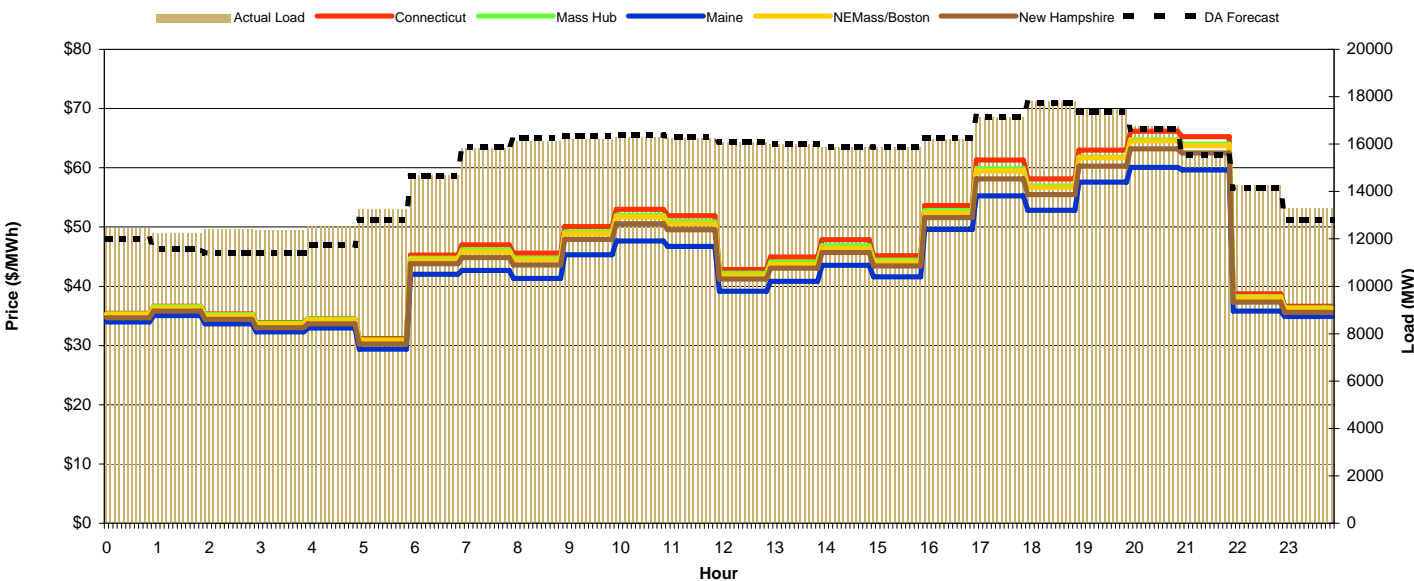




# ISO-NE Daily Report

Friday March 05, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
<b>Connecticut</b>	36.97	36.66	36.43	36.05	36.00	38.13	46.90	50.95	48.86	50.13	49.73	48.78	47.41	47.00	45.12	44.96	46.78	54.99	60.72	54.36	49.79	44.42	41.38	39.00	44.17	47.63	49.09	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	35.83	35.52	35.30	34.94	34.89	36.96	45.45	49.38	47.16	48.46	48.00	47.03	45.95	45.55	43.73	43.58	45.34	53.29	58.81	52.67	48.00	43.05	40.10	37.80	44.03	47.51			
<b>New Hampshire</b>	35.35	35.05	34.83	34.47	34.42	36.46	44.84	48.72	46.52	47.81	47.35	46.39	45.53	45.15	43.44	42.99	44.73	52.58	58.02	51.96	47.35	42.47	39.56	37.29	43.47	46.91			
<b>Maine</b>	34.29	34.00	33.78	33.44	33.39	35.37	43.49	47.26	45.12	46.37	45.93	45.00	43.97	43.59	41.84	41.70	43.38	51.00	56.28	50.40	45.93	41.19	38.37	36.17	42.14	45.46			
<b>Mass Hub</b>	36.12	35.82	35.59	35.23	35.18	37.27	45.84	49.80	47.54	48.86	48.38	47.40	46.34	45.94	44.10	43.95	45.72	53.75	59.31	53.11	48.38	43.41	40.44	38.12	44.40	47.90			
<b>Cleared Load (GW)</b>	11.5	11.5	11.4	11.4	11.4	11.9	14.1	14.7	15.3	15.0	15.1	14.9	14.8	14.7	14.5	14.5	14.7	15.5	15.9	15.5	14.8	14.0	12.7	11.8					

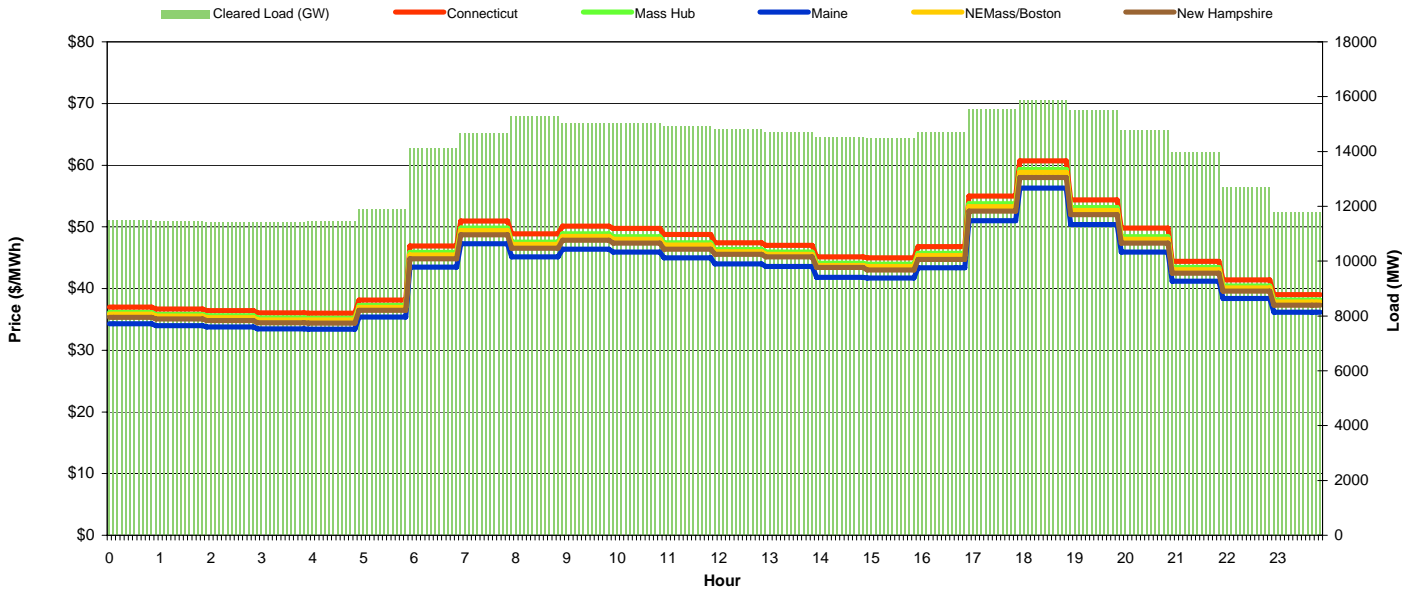

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
<b>Connecticut</b>	44.03	36.37	35.93	36.90	35.79	35.28	48.39	54.75	50.80	60.50	70.15	57.37	54.85	54.26	42.04	42.20	42.27	47.94	62.09	47.08	48.03	46.12	45.83	44.17	47.63	51.64	<b>All</b>	<b>On Pk</b>	
<b>NEMass/Boston</b>	43.60	36.04	35.60	36.50	35.47	35.07	47.63	53.81	50.02	59.36	68.71	56.20	53.62	53.09	41.19	41.33	41.40	46.82	60.68	46.00	46.84	44.97	45.17	43.62	46.78	50.58			
<b>New Hampshire</b>	43.15	35.67	35.27	36.20	35.09	34.65	47.08	53.12	49.39	58.65	67.91	55.51	53.01	52.47	40.71	40.78	40.84	45.99	59.58	45.18	46.17	44.43	44.53	43.01	46.18	49.89			
<b>Maine</b>	42.22	34.84	34.41	35.35	34.18	88.00	44.85	50.65	47.18	55.65	64.49	52.24	49.76	49.21	38.58	38.84	39.01	43.81	56.65	42.93	43.60	42.40	42.75	41.51	46.38	47.36			
<b>Mass Hub</b>	43.87	36.23	35.81	36.76	35.68	35.16	47.80	53.97	50.14	59.59	68.99	56.48	53.92	53.42	41.41	41.54	41.58	47.04	60.87	46.20	47.12	45.24	45.32	43.84	47.00	50.80			
<b>DA Forecast Load (GW)</b>	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
<b>Forecast Error %</b>	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!		

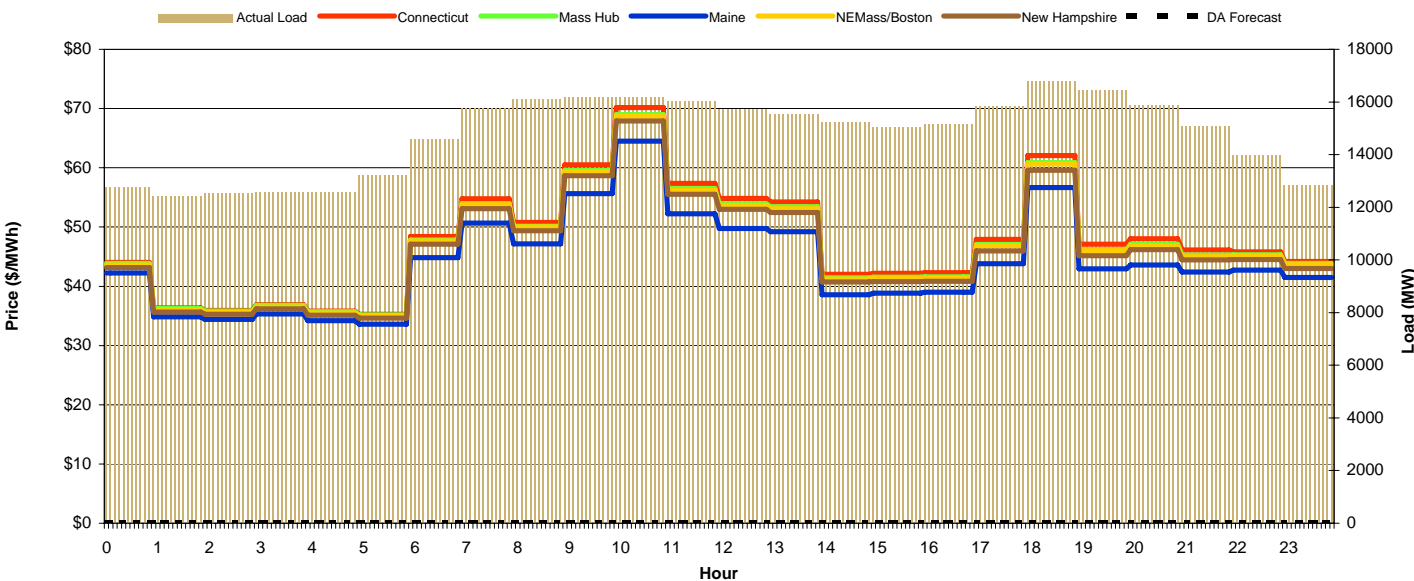




# ISO-NE Daily Report

Saturday March 06, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	38.10	37.04	34.76	35.00	36.08	38.15	41.42	41.42	44.06	49.87	48.88	43.74	40.58	38.43	36.04	35.18	37.61	43.68	57.38	50.99	44.95	40.13	37.84	35.76	41.13	43.17	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	37.00	35.93	33.71	33.94	35.00	37.05	40.22	40.22	42.79	48.43	47.47	42.48	39.41	37.32	35.00	34.16	36.52	42.42	55.05	49.49	43.43	38.97	36.74	34.72	39.89	41.87		
<b>New Hampshire</b>	36.48	35.40	33.20	33.44	34.49	36.53	39.65	39.65	42.18	47.74	46.80	41.88	38.85	36.79	34.51	33.68	36.00	41.82	54.26	48.79	42.82	38.42	36.22	34.23	39.33	41.28		
<b>Maine</b>	35.35	34.32	32.19	32.41	33.43	35.40	38.43	38.43	40.88	46.27	45.35	40.59	37.65	35.66	33.44	32.64	34.89	40.53	52.58	47.29	41.49	37.23	35.11	33.18	38.11	40.00		
<b>Mass Hub</b>	37.29	36.42	34.22	34.44	35.44	37.34	40.53	40.53	43.12	48.80	47.84	42.81	39.71	37.61	35.27	34.43	36.80	42.75	55.40	49.88	43.75	39.27	37.03	34.99	40.24	42.19		
<b>Cleared Load (GW)</b>	11.5	11.7	11.5	11.4	11.5	11.8	12.1	12.9	13.7	14.0	14.0	13.9	13.6	13.3	13.0	12.9	13.3	14.6	14.9	14.6	14.2	13.2	12.4	11.8				

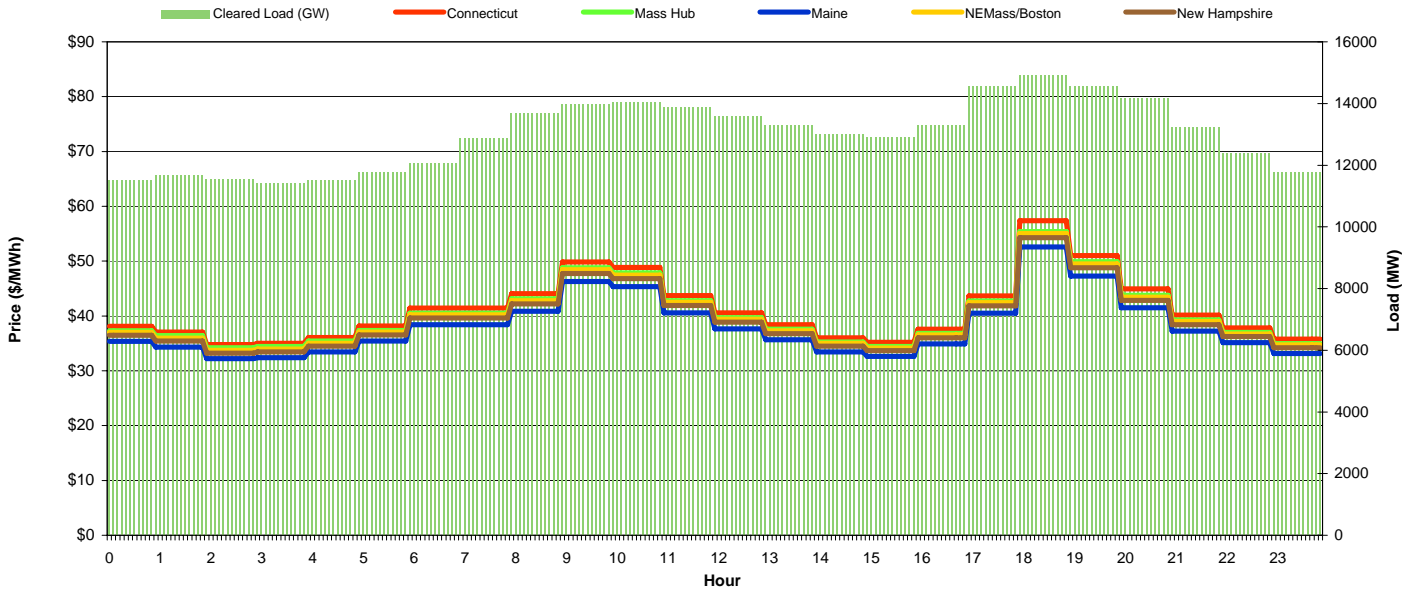

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
<b>Connecticut</b>	41.15	38.24	45.87	39.25	39.56	83.93	46.36	44.36	46.19	57.45	54.33	46.07	38.37	35.01	31.52	30.14	31.75	37.28	47.46	39.85	39.81	40.72	32.17	32.64	42.48	40.78	<b>All</b>	<b>On Pk</b>	
<b>NEMass/Boston</b>	40.42	37.35	44.47	37.98	38.33	81.52	44.99	43.06	44.54	54.94	51.78	44.14	36.84	33.78	30.38	29.14	30.71	35.89	45.04	38.12	37.97	38.93	31.20	31.79	40.97	39.15			
<b>New Hampshire</b>	39.99	36.95	44.10	37.64	38.02	80.90	44.51	42.48	44.07	54.21	50.96	43.51	36.30	33.26	29.90	28.65	30.26	35.42	44.52	37.66	37.59	38.70	30.83	31.46	40.50	38.65			
<b>Maine</b>	39.23	36.02	42.91	36.69	37.06	88.00	42.86	40.48	42.02	50.95	47.82	41.15	34.38	31.36	28.15	27.02	28.68	33.79	42.06	35.69	35.45	36.96	29.46	30.63	39.12	36.59			
<b>Mass Hub</b>	40.65	37.69	45.01	38.45	38.79	82.39	45.45	43.38	44.92	55.53	52.37	44.61	37.20	34.08	30.69	29.41	31.01	36.27	45.63	38.56	38.45	39.43	31.49	32.06	41.40	39.56			
<b>DA Forecast Load (GW)</b>	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
<b>Forecast Error %</b>	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!		

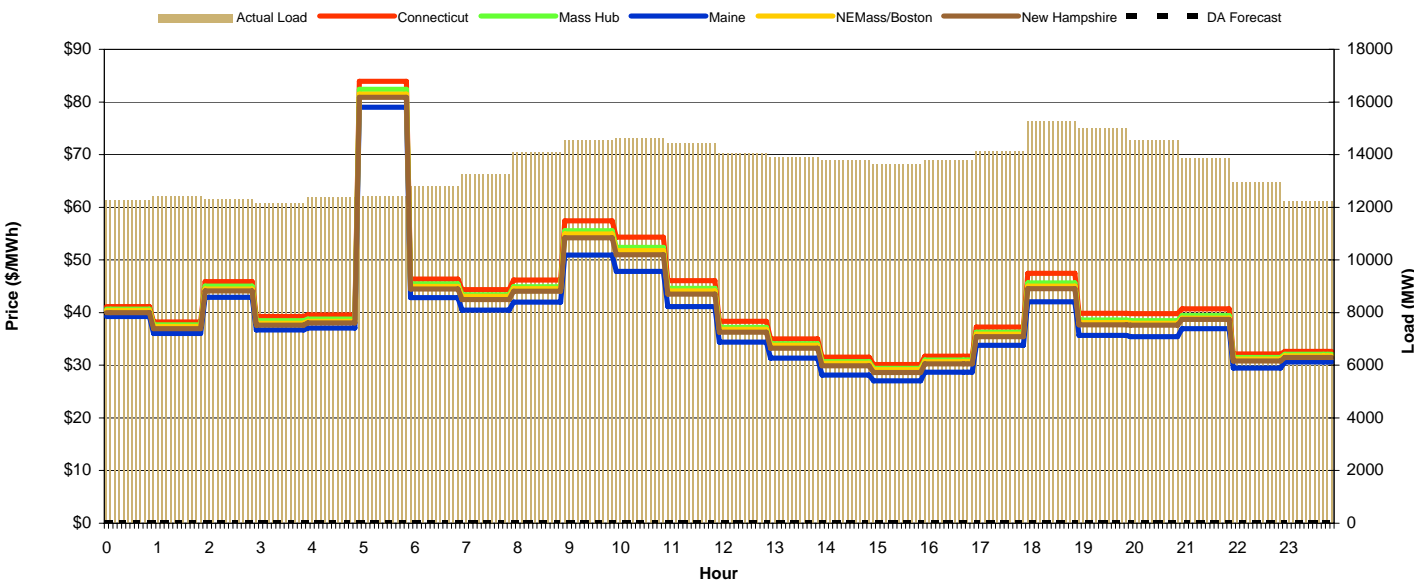




# ISO-NE Daily Report

Sunday March 07, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	37.79	34.68	34.48	33.72	33.72	35.51	35.26	35.92	37.68	39.95	40.19	41.32	39.95	37.25	35.93	37.68	41.59	53.31	61.29	57.94	50.76	42.35	36.59	34.92	40.41	43.11	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	36.71	33.77	33.57	32.83	32.83	34.58	34.34	34.98	36.69	38.90	39.13	40.23	38.90	36.27	34.99	36.69	40.50	51.78	59.19	55.26	49.42	41.23	35.63	34.00	39.27	41.86		
<b>New Hampshire</b>	36.18	33.30	33.11	32.38	32.38	34.10	33.86	34.49	36.18	38.37	38.59	39.67	38.37	35.77	34.50	36.18	39.94	51.06	58.36	54.49	48.74	40.66	35.13	33.53	38.72	41.28		
<b>Maine</b>	35.02	32.23	32.04	31.33	31.33	33.00	32.77	33.38	35.01	37.13	37.34	38.39	37.13	34.62	33.39	35.01	38.65	49.41	56.48	52.72	47.16	39.35	34.00	32.45	37.47	39.95		
<b>Mass Hub</b>	37.15	34.00	33.81	33.06	33.06	34.82	34.57	35.22	36.94	39.17	39.40	40.51	39.17	36.52	35.23	36.94	40.78	52.12	59.52	55.58	49.75	41.51	35.86	34.22	39.54	42.14		
<b>Cleared Load (GW)</b>	11.3	11.4	11.3	11.3	11.3	11.6	11.8	12.6	13.2	13.7	13.8	13.7	13.5	13.2	13.0	13.1	13.8	14.8	15.6	15.1	14.4	13.4	12.2	11.6				

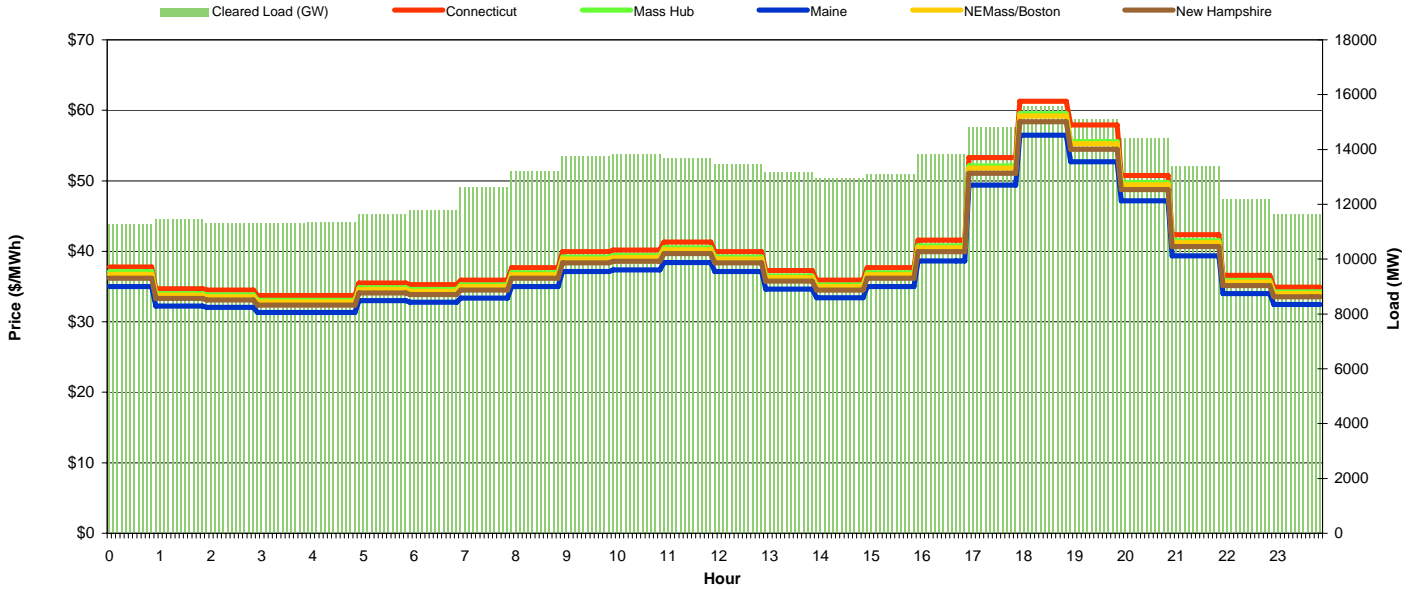

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
<b>Connecticut</b>	36.60	34.31	30.78	29.21	33.35	30.17	24.78	34.13	36.37	37.42	37.35	36.32	34.44	34.07	34.03	31.07	26.11	38.51	46.22	44.09	44.24	40.27	27.30	28.89	34.58	36.37	<b>All</b>	<b>On Pk</b>	
<b>NEMass/Boston</b>	35.27	33.11	29.77	28.36	32.47	29.33	24.05	32.66	34.79	35.74	35.64	34.82	33.16	32.89	32.84	30.03	25.39	36.97	44.16	42.35	42.26	38.58	26.34	28.08	33.29	34.91			
<b>New Hampshire</b>	35.01	32.86	29.54	28.13	32.23	29.08	23.85	32.43	34.66	35.69	35.45	34.60	32.92	32.61	32.53	29.72	25.10	36.64	43.82	41.97	41.87	38.24	26.01	27.76	33.03	34.64			
<b>Maine</b>	34.21	32.09	28.87	27.56	31.73	28.00	23.18	31.22	33.58	34.49	34.08	33.14	31.52	31.33	31.18	28.48	24.00	35.12	41.90	40.08	39.53	36.35	24.77	26.96	34.31	33.17			
<b>Mass Hub</b>	35.76	33.63	30.24	28.77	32.93	29.75	24.40	33.29	35.42	36.37	36.26	35.37	33.63	33.32	33.26	30.39	25.67	37.52	44.75	42.88	42.92	39.18	26.68	28.40	33.78	35.43			
<b>DA Forecast Load (GW)</b>	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
<b>Forecast Error %</b>	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!		

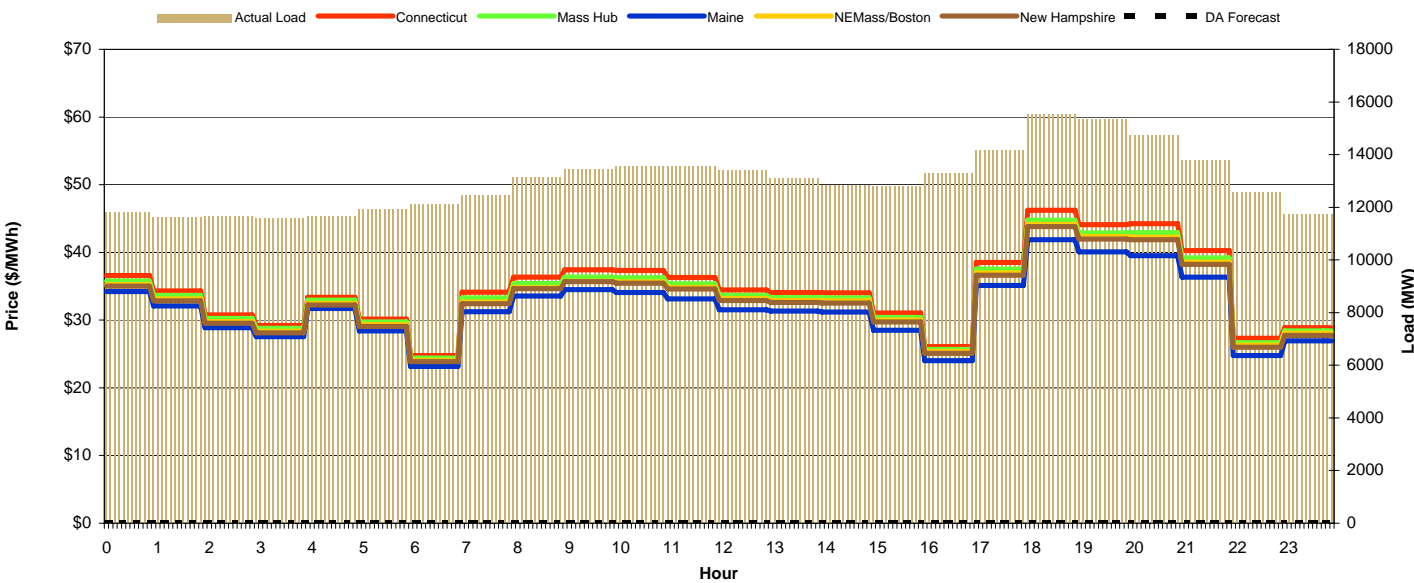




# ISO-NE Daily Report

Monday March 08, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
<b>Connecticut</b>	30.57	26.06	24.04	23.26	26.42	34.53	43.90	43.56	44.64	44.79	44.69	44.64	43.50	41.33	39.99	40.09	42.60	49.98	54.97	52.22	45.68	41.42	38.74	34.89	34.89	39.85	44.55	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	29.79	25.40	23.43	22.67	25.75	33.65	42.78	42.45	43.51	43.65	43.51	43.51	42.40	40.28	38.97	39.07	41.46	48.26	53.20	50.72	43.35	40.28	37.76	34.00	38.74	43.27	43.27		
<b>New Hampshire</b>	29.40	25.06	23.12	22.37	25.40	33.20	42.21	41.88	42.93	43.07	42.93	42.93	41.83	39.74	38.46	38.55	40.91	47.61	52.49	50.04	42.75	39.74	37.26	33.55	38.23	42.70	42.70		
<b>Maine</b>	28.41	24.22	22.34	21.62	24.55	32.08	40.79	40.47	41.48	41.62	41.48	41.48	40.42	38.40	37.16	37.25	39.53	46.00	50.71	48.35	41.29	38.40	36.00	32.41	36.94	41.25	41.25		
<b>Mass Hub</b>	29.99	25.57	23.59	22.82	25.92	33.88	43.06	42.73	43.80	43.94	43.79	43.80	42.68	40.54	39.23	39.33	41.73	48.53	53.51	51.03	43.50	40.53	38.01	34.22	38.99	43.54	43.54		
<b>Cleared Load (GW)</b>	10.4	10.5	10.5	10.5	10.7	11.4	13.6	15.0	15.1	15.0	14.9	14.9	14.8	14.5	14.2	14.1	14.5	15.8	16.4	15.7	15.0	13.7	12.1	11.1					

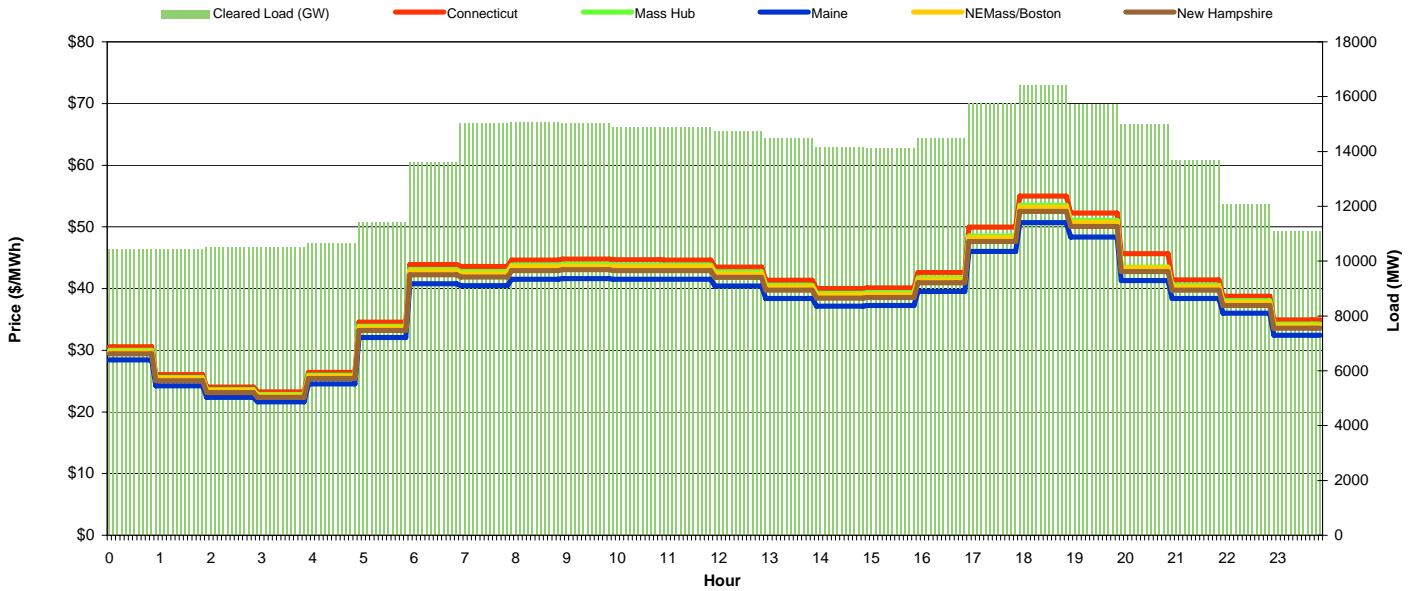

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
<b>Connecticut</b>	21.49	21.82	35.26	31.85	19.57	33.90	41.79	45.01	42.01	41.47	65.50	67.50	66.27	64.34	38.11	37.45	50.05	61.32	64.66	46.94	40.86	35.67	27.63	14.81	42.30	49.67	<b>All</b>	<b>On Pk</b>	
<b>NEMass/Boston</b>	20.89	21.20	34.03	30.69	18.91	32.72	40.09	42.93	40.01	39.49	38.62	37.16	35.40	34.52	30.80	32.05	34.73	36.33	39.89	41.56	38.91	34.11	26.91	14.56	33.19	36.46			
<b>New Hampshire</b>	20.67	20.99	33.81	30.48	18.74	32.46	39.86	42.58	39.77	39.19	38.22	36.84	35.00	34.10	30.35	31.56	34.24	35.77	39.43	41.09	38.60	33.72	26.49	14.39	32.85	36.06			
<b>Maine</b>	20.15	20.50	33.05	29.90	18.41	32.00	38.85	41.15	38.56	37.83	36.43	35.08	33.30	32.67	29.26	30.50	32.79	34.40	38.07	39.54	36.90	32.16	25.33	14.05	34.04	34.62			
<b>Mass Hub</b>	21.14	21.48	34.58	31.17	19.19	33.17	40.67	43.57	40.64	40.09	39.59	38.07	36.24	35.28	31.09	32.30	35.23	37.02	40.54	42.12	39.48	34.56	27.15	14.68	33.71	37.06			
<b>DA Forecast Load (GW)</b>	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
<b>Forecast Error %</b>	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!		

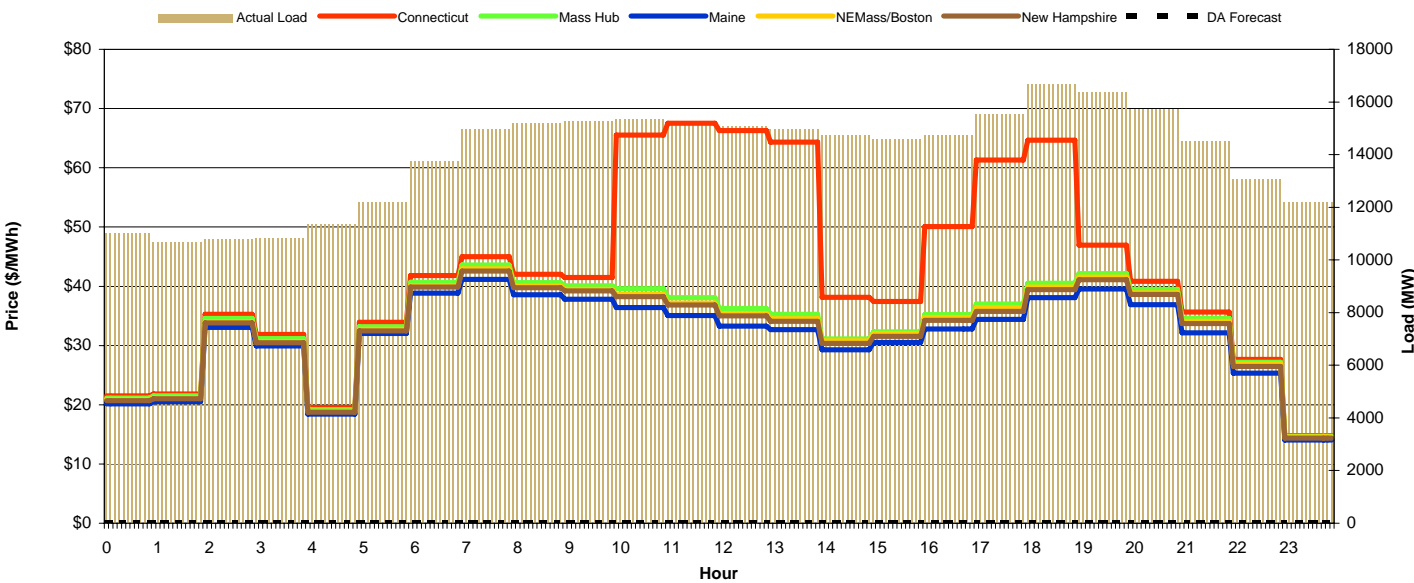






# ISO-NE Daily Report

Tuesday March 09, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
<b>Connecticut</b>	31.42	30.43	30.43	30.43	30.39	36.45	41.38	46.75	43.17	43.90	44.17	43.27	41.26	39.61	38.07	38.84	40.07	47.43	55.96	51.94	46.46	42.58	37.51	34.57	34.57	40.27	43.81	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	30.61	29.64	29.64	29.64	29.60	35.51	40.31	45.54	41.54	42.31	42.59	41.72	39.63	38.47	37.08	37.73	38.48	45.48	54.00	50.23	44.56	41.00	36.54	33.68	33.68	38.98	42.31		
<b>New Hampshire</b>	30.22	29.26	29.26	29.26	29.22	35.06	39.80	44.96	40.99	41.76	42.04	41.18	39.11	37.97	36.61	37.25	37.97	44.88	53.30	49.58	43.98	40.47	36.07	33.25	33.25	38.48	41.76		
<b>Maine</b>	29.19	28.27	28.27	28.27	28.23	33.87	38.45	43.43	39.60	40.34	40.61	39.78	37.78	36.69	35.37	35.99	36.68	43.36	51.49	47.89	42.49	39.09	34.85	32.12	32.12	37.17	40.34		
<b>Mass Hub</b>	30.85	29.87	29.87	29.87	29.83	35.79	40.63	45.89	41.80	42.59	42.87	42.00	39.87	38.75	37.37	38.02	38.71	45.75	54.36	50.57	44.82	41.26	36.82	33.94	33.94	39.25	42.59		
<b>Cleared Load (GW)</b>	10.5	10.3	10.3	10.2	10.5	11.5	13.8	14.8	14.8	14.7	14.7	14.7	14.5	14.3	14.2	13.9	14.3	15.5	16.0	15.6	15.1	13.8	12.5	11.3					

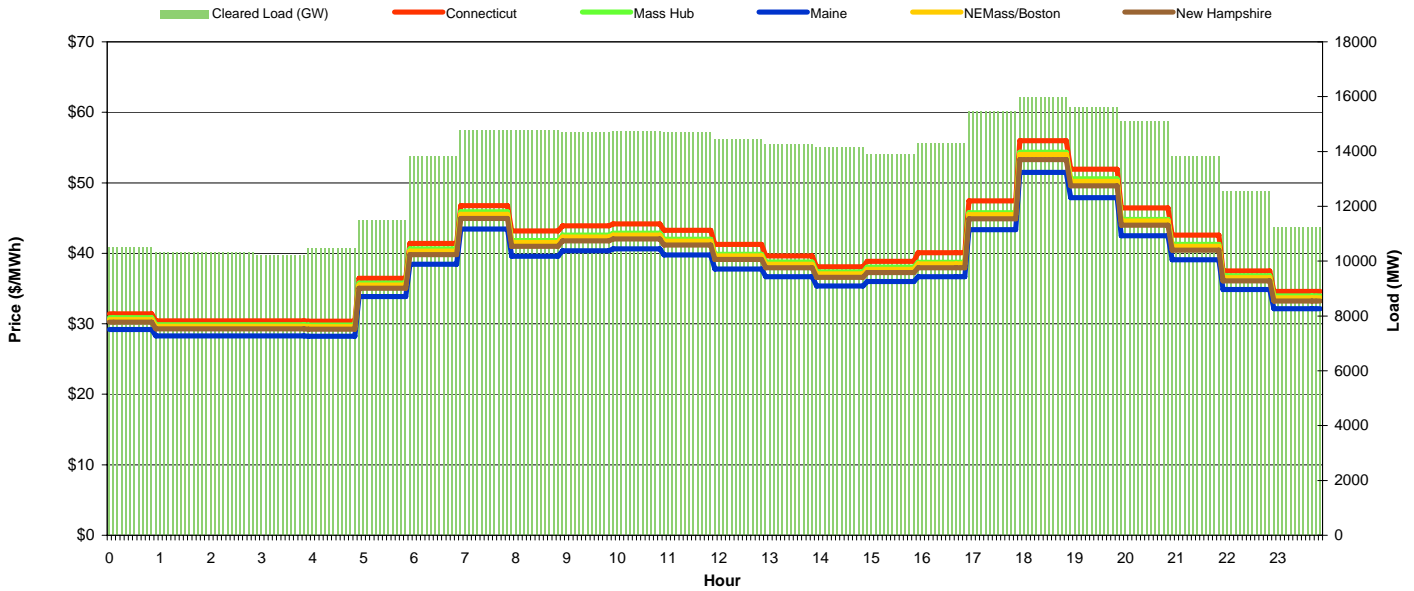

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
<b>Connecticut</b>	16.42	22.68	21.06	24.43	20.74	16.01	42.71	42.32	37.78	38.61	42.21	42.39	39.64	39.47	37.76	37.79	36.84	43.75	52.69	48.53	43.39	42.59	28.55	27.32	35.24	40.89	<b>All</b>	<b>On Pk</b>	
<b>NEMass/Boston</b>	16.06	22.06	20.45	23.64	20.11	15.55	41.61	40.87	36.45	37.32	40.81	40.77	38.12	37.96	36.36	36.37	35.61	42.02	50.43	46.31	41.66	40.99	27.85	26.84	34.01	39.37			
<b>New Hampshire</b>	15.89	21.86	20.26	23.42	19.89	15.35	41.08	40.26	35.92	36.76	40.25	40.22	37.55	37.35	35.67	35.72	34.91	41.23	49.43	45.38	41.05	40.44	27.47	26.54	33.50	38.73			
<b>Maine</b>	15.56	21.36	19.79	22.89	19.51	88.00	39.93	38.56	34.27	35.15	38.50	38.16	35.41	35.27	33.70	33.88	33.11	39.29	46.93	43.00	39.07	38.45	26.21	25.98	35.08	36.81			
<b>Mass Hub</b>	16.24	22.34	20.71	23.97	20.38	15.71	41.91	41.24	36.78	37.64	41.21	41.25	38.55	38.38	36.72	36.75	35.92	42.50	50.99	46.89	42.16	41.47	28.06	26.98	34.36	39.78			
<b>DA Forecast Load (GW)</b>	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
<b>Forecast Error %</b>	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!		

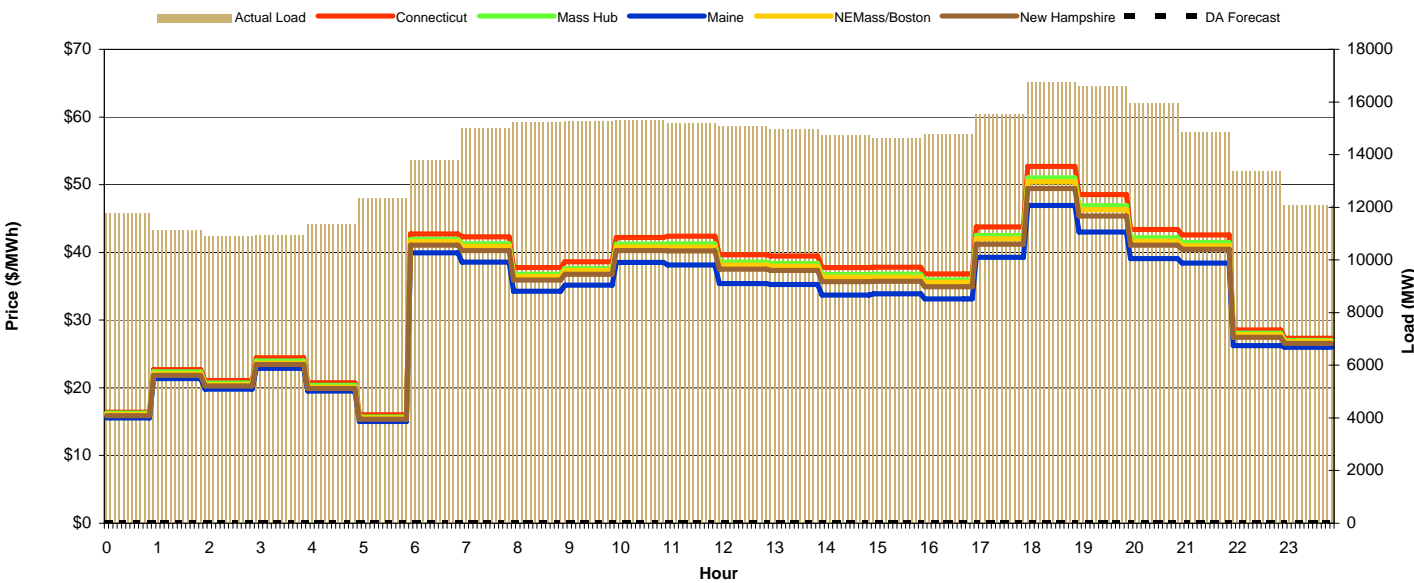




# ISO-NE Daily Report

Wednesday March 10, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	28.69	24.57	22.11	23.51	25.48	30.52	42.03	44.23	45.01	45.08	45.78	43.42	42.50	41.38	39.34	39.27	41.26	49.78	54.39	49.85	44.99	41.05	35.67	33.87	38.91	43.94	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	27.90	23.90	21.51	22.87	24.79	29.69	40.89	42.91	43.08	43.16	42.58	41.81	40.89	40.00	38.27	38.11	39.85	47.23	51.20	46.85	42.58	39.84	34.70	32.95	37.40	42.07		
<b>New Hampshire</b>	27.56	23.60	21.24	22.59	24.48	29.32	40.39	42.38	42.40	42.46	41.21	41.28	40.38	39.50	37.80	37.64	39.35	46.61	50.50	46.21	42.03	39.35	34.27	32.54	36.88	41.46		
<b>Maine</b>	26.61	22.79	20.51	21.81	23.64	28.31	39.00	40.92	40.96	41.02	39.91	39.86	38.99	38.14	36.50	36.34	38.00	45.00	48.76	44.61	40.58	38.00	33.10	31.43	35.62	40.04		
<b>Mass Hub</b>	28.14	24.10	21.69	23.07	25.00	29.94	41.24	43.27	43.49	43.57	43.51	42.11	41.19	40.31	38.60	38.42	40.16	47.49	51.50	47.07	42.80	40.18	35.00	33.23	37.71	42.42		
<b>Cleared Load (GW)</b>	10.4	10.7	10.9	10.9	10.8	11.1	13.5	14.7	14.6	14.6	14.5	14.6	14.4	14.0	13.8	13.7	13.9	15.3	16.0	15.6	14.8	13.5	12.3	11.0				

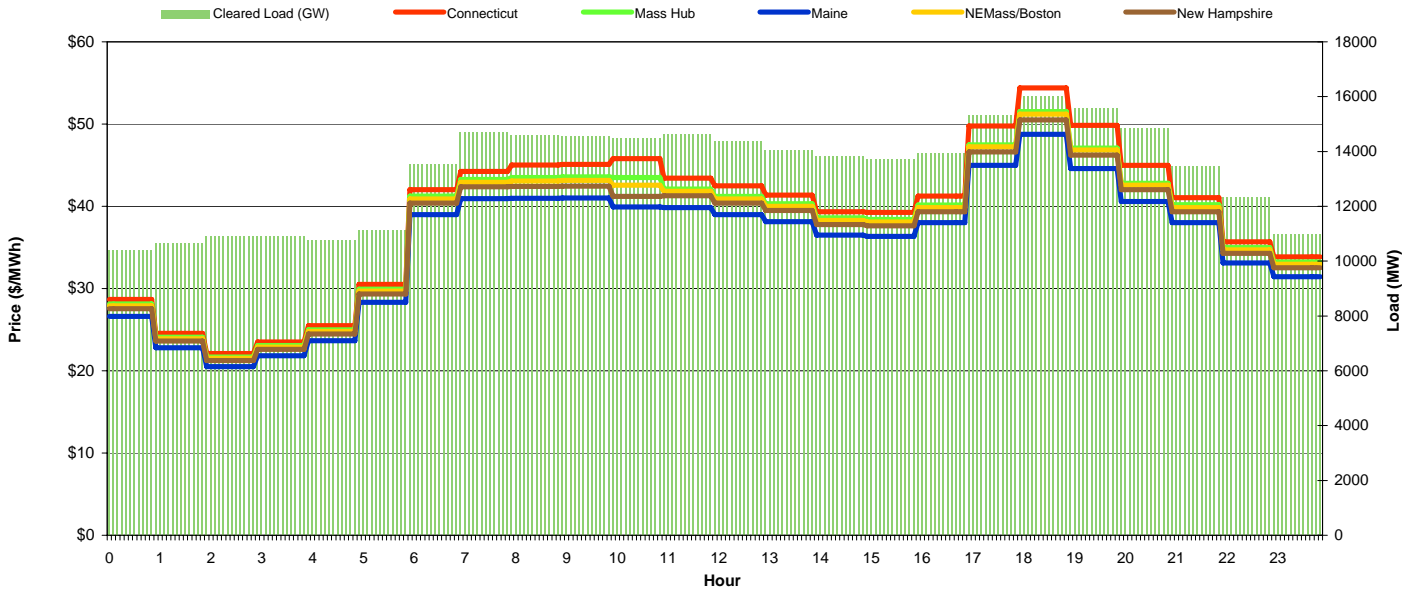

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	31.46	31.49	25.77	26.79	31.13	24.71	40.24	39.52	42.70	41.37	40.20	42.29	41.75	41.57	39.63	36.47	37.49	40.57	48.28	46.09	42.82	40.90	33.62	15.26	36.76	40.95	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	30.64	30.65	25.21	26.21	30.48	24.30	39.34	38.15	40.96	39.76	38.72	40.60	40.07	39.81	37.89	35.01	35.98	38.77	45.95	43.73	40.64	39.03	32.63	15.00	35.40	39.23		
<b>New Hampshire</b>	30.36	30.42	25.05	26.03	30.24	24.07	38.87	37.66	40.43	39.20	38.15	40.08	39.61	39.31	37.36	34.46	35.44	38.13	45.20	43.02	40.05	38.62	32.21	14.83	34.95	38.68		
<b>Maine</b>	29.72	29.76	24.53	25.54	29.75	24.50	37.72	36.14	38.86	37.55	36.48	38.28	37.71	37.44	35.42	32.81	33.79	36.48	42.95	40.93	37.82	36.62	30.67	14.43	36.23	36.87		
<b>Mass Hub</b>	30.87	30.94	25.45	26.47	30.77	24.50	39.62	38.52	41.43	40.20	39.13	41.08	40.55	40.31	38.39	35.38	36.35	39.19	46.47	44.31	41.26	39.61	32.93	15.09	35.78	39.69		
<b>DA Forecast Load (GW)</b>	11.19	10.83	10.65	10.72	11.12	12.25	14.20	15.16	15.46	15.45	15.33	15.25	15.13	15.07	14.68	14.61	14.91	15.81	16.79	16.57	15.94	14.70	13.50	12.10				
<b>Forecast Error %</b>	1.5%	5.8%	9.0%	8.7%	6.0%	5.3%	0.4%	1.3%	0.2%	0.0%	0.5%	0.4%	-0.3%	-0.7%	0.4%	0.0%	-1.0%	-2.2%	-0.6%	-0.4%	-0.2%	0.5%	-1.5%	1.6%				

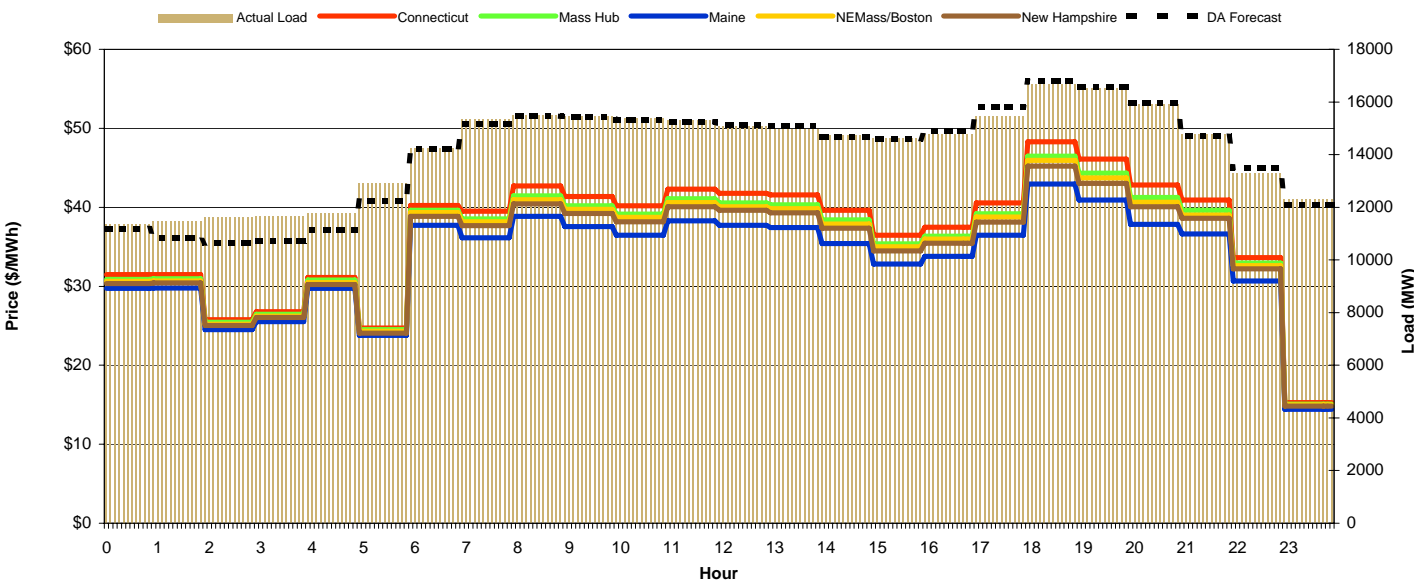




# ISO-NE Daily Report

Thursday March 11, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	31.42	31.31	29.13	28.49	28.74	30.50	40.53	42.03	40.96	41.05	40.86	41.07	40.80	38.80	38.25	38.75	40.00	45.24	53.19	49.01	41.48	37.88	35.18	33.29	38.25	41.53	All	On Pk
<b>NEMass/Boston</b>	30.53	30.43	28.31	27.68	27.93	29.64	39.38	40.55	39.81	39.89	39.70	39.91	39.65	37.71	37.17	37.66	38.87	43.15	50.66	47.23	39.92	36.81	34.19	32.35	37.05	40.18		
<b>New Hampshire</b>	30.14	30.04	27.95	27.33	27.57	29.26	38.88	40.02	39.30	39.38	39.19	39.40	39.14	37.22	36.69	37.18	38.37	42.57	49.99	46.62	39.40	36.34	33.75	31.93	36.57	39.66		
<b>Maine</b>	29.03	28.93	26.92	26.32	26.55	28.19	37.45	38.55	37.85	37.93	37.75	37.95	37.70	35.85	35.34	35.81	36.96	41.00	48.14	44.90	37.95	35.00	32.51	30.76	35.22	38.20		
<b>Mass Hub</b>	30.80	30.69	28.56	27.93	28.17	29.90	39.73	40.87	40.16	40.24	40.05	40.26	40.00	38.04	37.49	37.99	39.21	43.42	51.02	47.59	40.22	37.13	34.49	32.63	37.36	40.51		
<b>Cleared Load (GW)</b>	10.5	10.3	10.3	10.4	10.6	10.9	13.4	14.7	14.9	14.9	15.0	14.9	14.6	14.5	14.1	14.0	14.3	15.5	15.7	15.4	15.0	13.8	12.0	10.6				

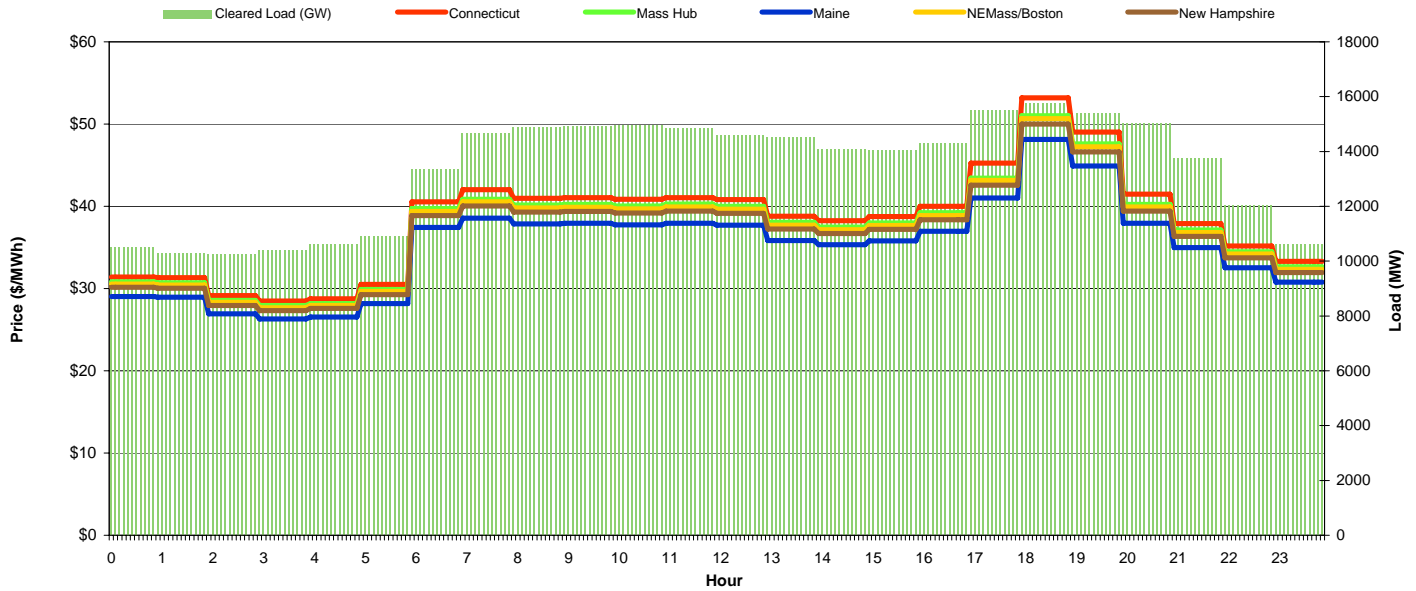

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	29.72	32.40	23.95	23.10	39.03	37.16	45.40	44.39	43.52	45.35	45.32	44.13	44.37	41.97	39.61	38.56	43.35	47.21	50.68	52.85	43.78	37.61	35.93	34.04	40.14	43.66	All	On Pk
<b>NEMass/Boston</b>	29.24	31.89	23.54	22.73	38.44	36.56	44.45	42.76	41.82	43.63	43.43	42.40	42.56	40.50	38.48	37.44	41.99	45.59	48.78	50.66	41.91	36.22	34.95	33.50	38.89	42.07		
<b>New Hampshire</b>	28.94	31.59	23.33	22.57	38.22	36.31	44.00	42.32	41.29	42.99	42.70	41.82	41.97	39.94	38.01	36.88	41.30	44.68	47.81	49.68	41.15	35.65	34.32	33.02	38.35	41.41		
<b>Maine</b>	28.30	30.83	22.73	22.12	37.77	88.00	43.22	41.29	40.06	41.21	40.68	39.77	39.81	38.00	36.18	34.90	39.05	42.44	45.55	47.22	39.00	33.73	32.37	31.94	39.01	39.45		
<b>Mass Hub</b>	29.47	32.21	23.79	22.98	38.85	36.85	44.77	43.24	42.34	44.14	44.03	42.94	43.14	41.01	38.91	37.83	42.46	46.07	49.29	51.29	42.52	36.69	35.34	33.78	39.33	42.58		
<b>DA Forecast Load (GW)</b>	11.16	10.77	10.57	10.59	10.95	12.07	14.04	15.16	15.38	15.38	15.28	15.21	14.98	14.88	14.65	14.53	14.86	15.78	16.79	16.45	15.80	14.67	13.34	12.01				
<b>Forecast Error %</b>	1.8%	4.6%	6.1%	6.7%	3.6%	-1.1%	-2.1%	-1.3%	-0.4%	0.3%	2.0%	2.1%	2.9%	3.4%	4.2%	5.1%	5.1%	3.8%	1.3%	1.3%	1.0%	1.1%	0.2%	0.1%				

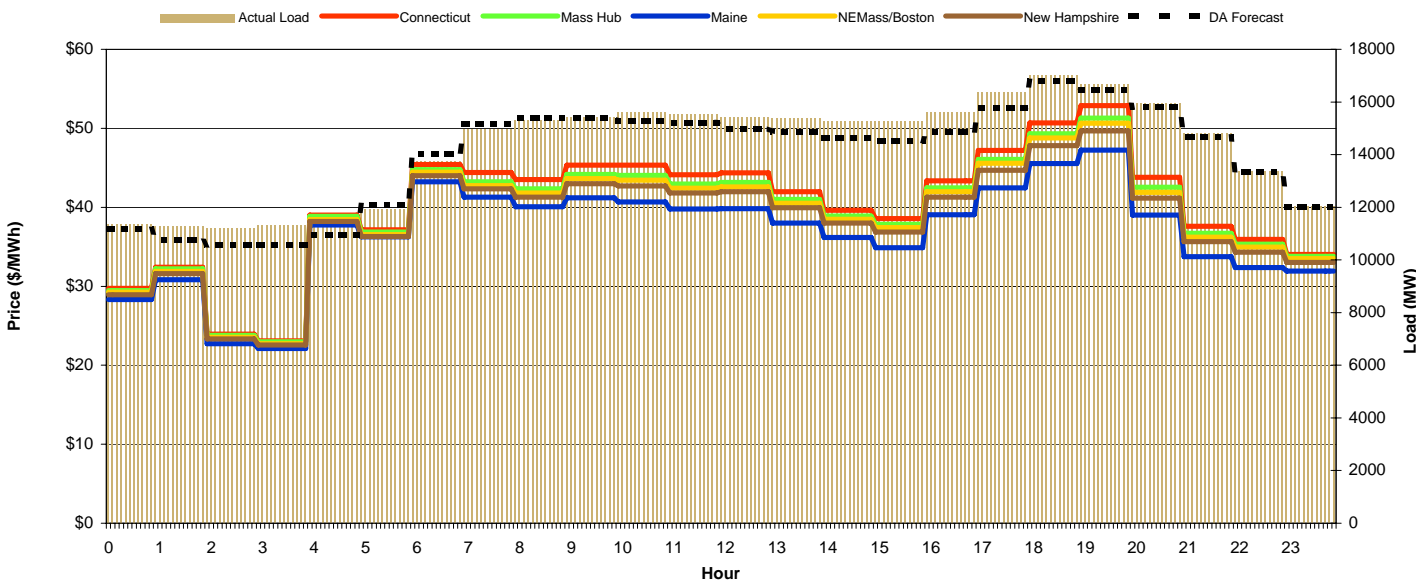




# ISO-NE Daily Report

Friday March 12, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
<b>Connecticut</b>	30.77	30.77	27.56	27.56	29.26	34.63	42.43	43.25	45.63	47.20	47.31	46.61	46.83	44.18	42.98	41.82	42.58	47.20	56.45	50.36	42.85	40.52	38.40	37.28	41.02	45.26
<b>NEMass/Boston</b>	29.88	29.88	26.75	26.75	28.41	33.63	41.19	41.99	44.30	45.83	45.93	45.25	45.46	42.89	41.73	40.60	41.34	45.83	54.80	48.90	41.61	39.34	37.29	36.19	39.82	43.94
<b>New Hampshire</b>	29.48	29.48	26.40	26.40	28.04	33.19	40.65	41.44	43.72	45.23	45.33	44.66	44.87	42.33	41.18	40.07	40.80	45.23	54.09	48.26	41.06	38.83	36.80	35.72	39.30	43.37
<b>Maine</b>	28.36	28.36	25.40	25.40	26.97	31.92	39.11	39.87	42.06	43.51	43.61	42.96	43.16	40.72	39.61	38.54	39.25	43.51	52.03	46.42	39.50	37.35	35.40	34.36	37.81	41.72
<b>Mass Hub</b>	30.15	30.15	27.00	27.00	28.67	33.94	41.57	42.38	44.71	46.25	46.36	45.67	45.88	43.29	42.11	40.97	41.73	46.25	55.31	49.35	41.99	39.70	37.63	36.53	40.19	44.35
<b>Cleared Load (GW)</b>	10.5	10.6	10.6	10.7	10.8	11.0	13.2	14.5	14.4	14.4	14.3	14.5	14.2	14.2	14.0	13.8	14.0	14.8	15.0	14.8	14.5	13.4	12.1	10.7		

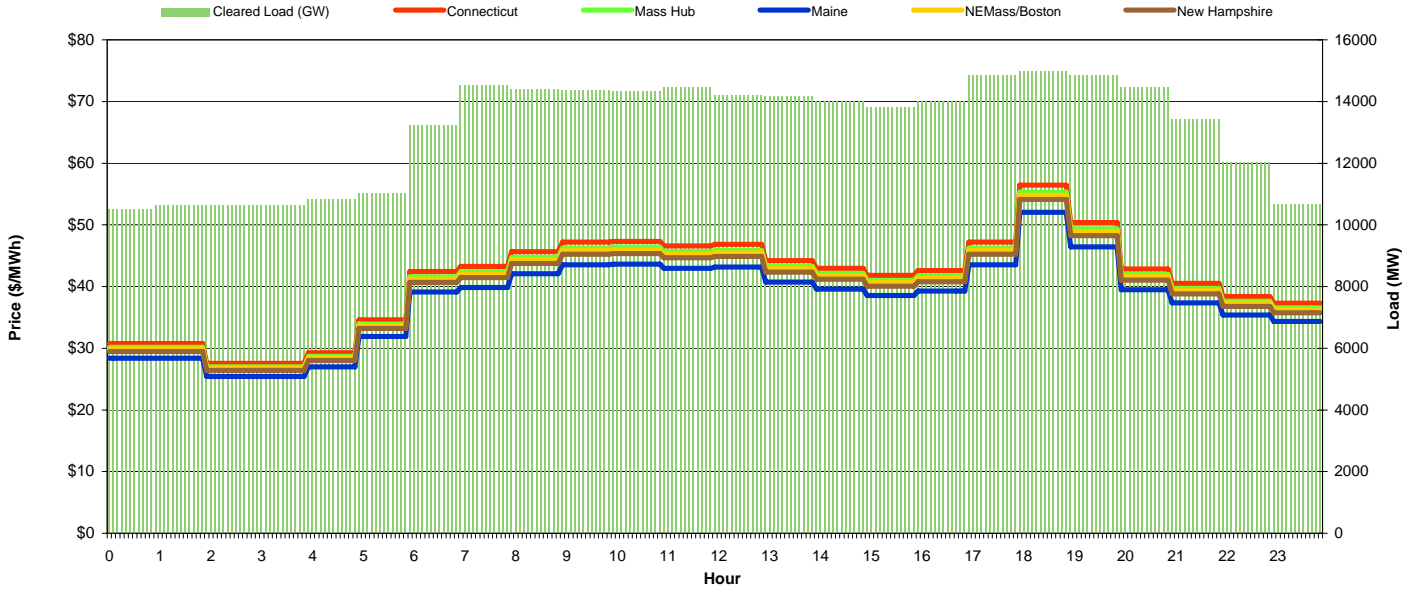

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
<b>Connecticut</b>	30.67	32.02	32.94	32.79	31.99	34.64	42.98	43.98	46.88	55.84	60.39	69.28	71.68	51.99	49.75	49.06	46.84	58.86	60.09	55.15	48.82	44.52	36.92	41.65	47.07	53.13
<b>NEMass/Boston</b>	30.34	31.67	32.55	32.41	31.73	34.14	41.98	42.66	45.41	54.14	58.42	67.34	69.69	50.35	48.06	47.19	45.20	56.71	58.28	53.27	46.96	43.16	35.97	41.04	45.78	51.43
<b>New Hampshire</b>	30.04	31.37	32.26	32.16	31.51	33.91	41.78	42.45	45.19	53.78	57.98	66.98	69.44	50.04	47.73	46.77	44.70	55.87	57.43	52.44	46.30	42.62	35.36	40.30	45.35	50.94
<b>Maine</b>	29.60	30.88	31.73	31.70	31.15	33.80	40.77	41.13	43.64	51.77	55.41	63.72	66.44	47.61	45.26	44.11	42.23	53.10	54.91	49.83	43.77	40.35	33.39	38.82	45.81	48.54
<b>Mass Hub</b>	30.57	31.95	32.91	32.77	32.03	34.38	42.23	42.99	45.80	54.56	58.96	67.84	70.20	50.77	48.55	47.69	45.61	57.20	58.62	53.68	47.43	43.54	36.23	41.21	46.16	51.85
<b>DA Forecast Load (GW)</b>	11.27	10.85	10.60	10.62	10.93	11.99	13.79	15.00	15.40	15.56	15.59	15.58	15.35	15.26	15.00	14.89	15.11	15.88	16.51	16.07	15.45	14.55	13.49	12.31		
<b>Forecast Error %</b>	0.2%	3.7%	6.8%	6.3%	5.8%	-1.0%	-1.1%	-0.4%	-0.1%	0.1%	1.1%	0.4%	0.3%	0.1%	0.4%	0.5%	0.1%	-1.2%	-0.9%	-0.5%	-0.3%	0.0%	-0.8%	-0.5%		

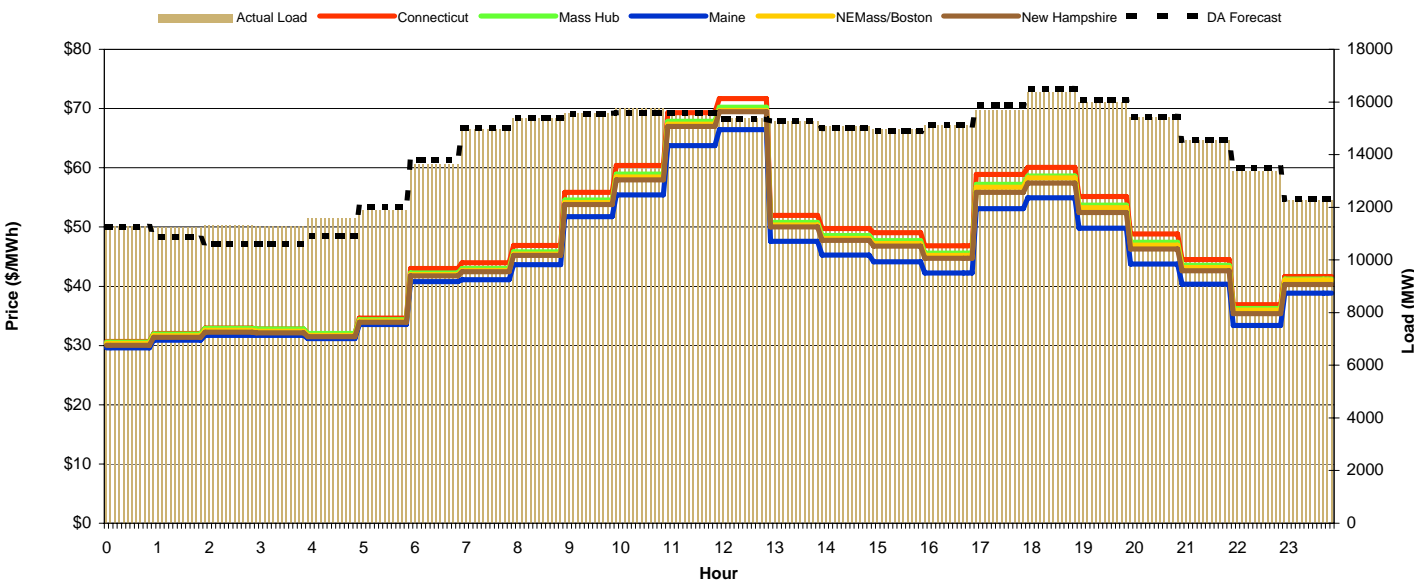




# ISO-NE Daily Report

Saturday March 13, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
<b>Connecticut</b>	41.07	35.55	37.53	35.75	37.44	38.45	41.84	43.58	46.50	48.87	50.14	53.00	52.14	46.68	45.65	45.01	45.32	53.00	62.42	55.31	45.38	45.80	43.28	39.48	39.48	45.38	48.88	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	39.82	34.47	36.39	34.67	36.31	37.28	40.57	42.25	45.09	47.39	48.62	51.39	49.98	45.02	44.26	43.64	43.80	51.39	60.53	53.63	44.01	44.17	41.97	38.29	38.29	43.96	47.32		
<b>New Hampshire</b>	39.32	34.04	35.93	34.23	35.85	36.82	40.07	41.73	44.53	46.80	48.02	50.75	50.75	45.02	43.71	43.10	43.60	50.75	59.78	52.97	43.46	44.19	41.44	37.81	37.81	43.53	46.91		
<b>Maine</b>	37.81	32.73	34.55	32.92	34.48	35.40	38.53	40.12	42.81	45.00	46.17	48.80	47.58	42.80	42.03	41.44	41.63	48.80	57.48	50.93	41.79	42.00	39.85	36.36	36.36	41.75	44.95		
<b>Mass Hub</b>	40.22	34.82	36.75	35.02	36.67	37.65	40.98	42.68	45.54	47.86	49.11	51.90	50.87	45.63	44.70	44.08	44.34	51.91	61.14	54.17	44.45	44.78	42.39	38.67	38.67	44.43	47.85		
<b>Cleared Load (GW)</b>	10.4	10.3	10.4	10.4	10.6	10.8	11.2	12.3	13.4	13.9	14.0	13.9	13.6	13.2	12.9	13.0	13.5	14.2	14.4	14.0	13.9	13.0	11.8	10.7					

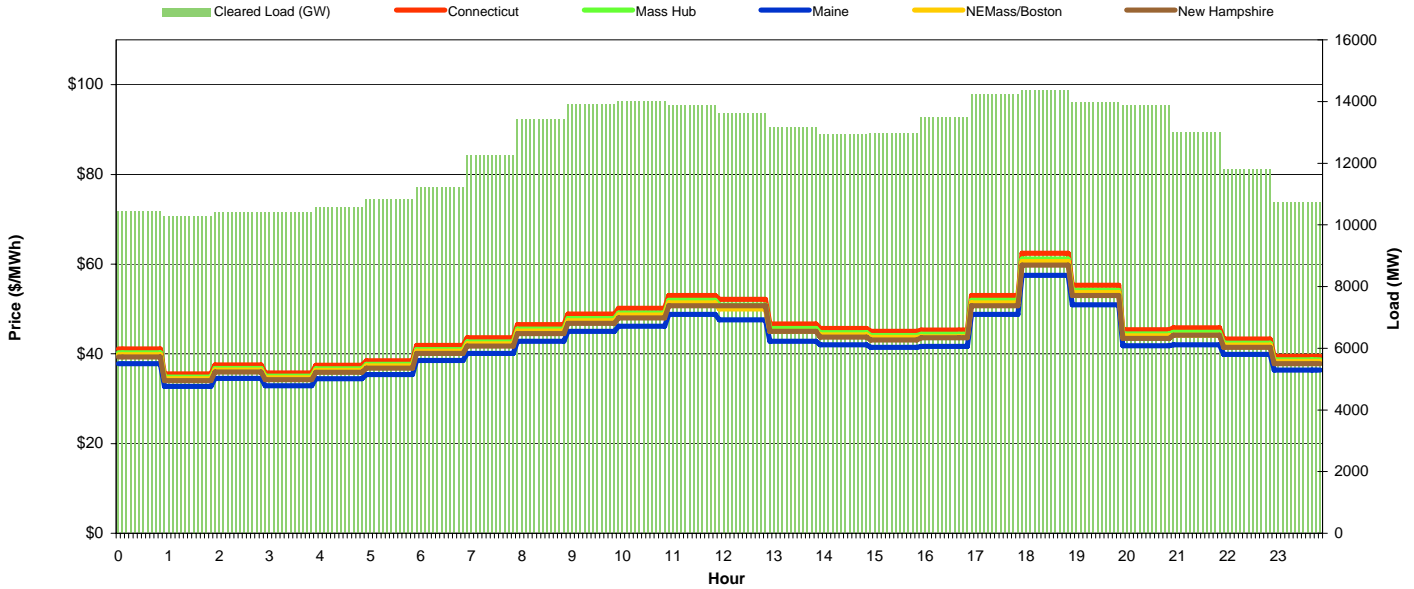

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
<b>Connecticut</b>	37.08	36.72	35.72	34.98	35.89	46.06	36.59	35.64	47.86	58.31	65.65	74.82	101.31	94.73	98.83	62.33	63.29	64.37	53.79	55.56	46.13	40.21	39.32	52.81	54.92	62.63	<b>All</b>	<b>On Pk</b>	
<b>NEMass/Boston</b>	36.50	35.92	35.03	34.33	35.27	45.42	36.10	34.64	46.15	55.95	63.02	72.17	97.81	91.12	94.83	59.73	60.79	62.08	51.64	53.37	44.40	38.80	38.16	51.64	53.12	60.29			
<b>New Hampshire</b>	35.97	35.38	34.55	33.88	34.87	44.91	35.67	34.36	46.15	55.79	62.66	71.53	96.90	90.35	93.90	59.08	60.09	61.24	50.96	52.71	43.98	38.62	37.78	51.01	52.60	59.76			
<b>Maine</b>	35.14	34.48	33.68	33.09	34.12	88.00	34.89	33.36	44.91	54.11	60.66	69.21	93.47	87.41	90.47	56.29	57.18	58.56	48.63	50.34	42.09	37.19	36.34	49.49	52.63	57.51			
<b>Mass Hub</b>	36.72	36.24	35.38	34.68	35.63	45.76	36.25	34.88	46.54	56.46	63.53	72.62	98.40	91.88	95.80	60.35	61.39	62.66	52.12	53.90	44.85	39.19	38.56	52.07	53.58	60.82			
<b>DA Forecast Load (GW)</b>	11.49	11.01	10.73	10.66	10.75	11.11	11.72	12.57	13.74	14.47	14.75	14.83	14.72	14.61	14.52	14.55	14.84	15.48	15.92	15.51	14.91	14.10	13.21	12.22					
<b>Forecast Error %</b>	2.7%	7.0%	11.3%	11.8%	13.2%	8.9%	2.6%	2.0%	1.3%	2.2%	2.7%	2.9%	2.9%	2.0%	1.4%	1.3%	1.4%	1.1%	0.3%	-0.1%	-0.3%	-0.2%	-0.8%	-0.4%					

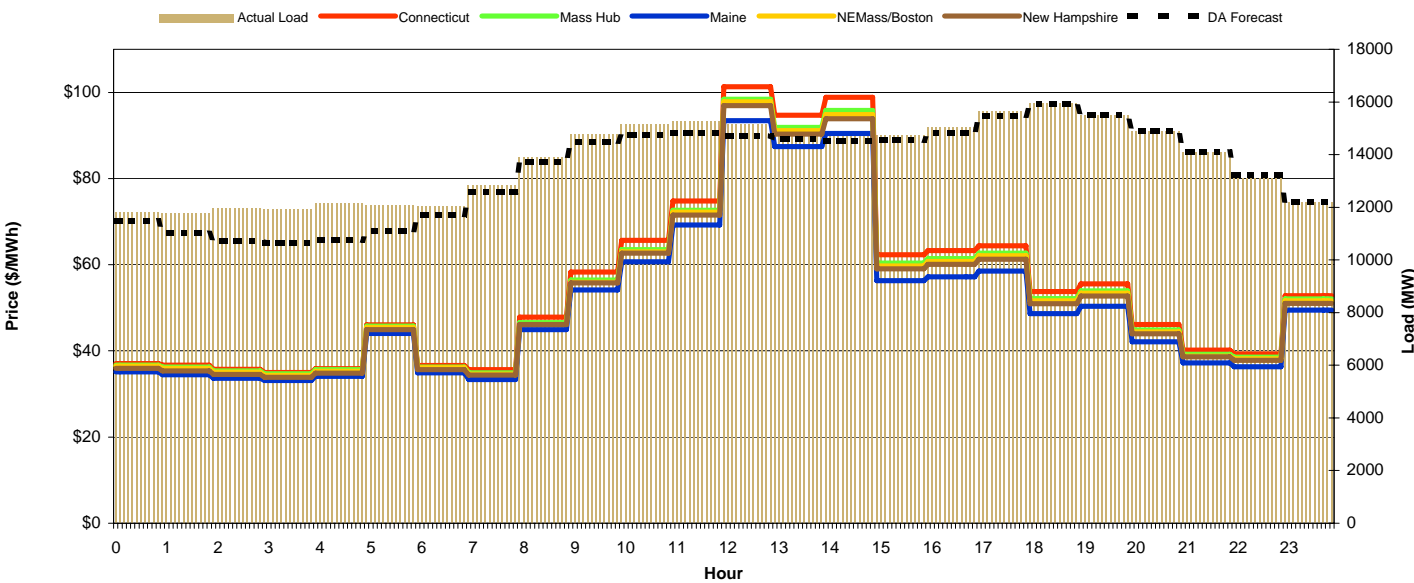



# ISO-NE Daily Report


Sunday March 14, 2010

Note: Data affected by daylight savings.

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
<b>Connecticut</b>	34.61	#N/A	34.86	32.57	31.84	33.71	34.86	34.93	36.18	38.48	43.00	42.84	43.23	39.68	38.48	39.00	40.29	44.66	57.97	63.42	52.12	42.24	36.18	34.61	34.61	40.42	43.29	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	33.53	#N/A	33.77	31.55	30.85	32.66	33.77	33.83	35.05	37.28	41.65	41.50	41.88	38.44	37.28	37.78	39.03	43.26	55.73	59.13	50.48	40.92	35.05	33.53	39.04	41.77			
<b>New Hampshire</b>	33.14	#N/A	33.37	31.18	30.49	32.28	33.37	33.44	34.64	36.84	41.17	41.01	41.39	37.99	36.84	37.34	38.58	42.76	55.12	58.65	49.89	40.44	34.64	33.14	38.60	41.30			
<b>Maine</b>	31.88	#N/A	32.11	30.00	29.33	31.05	32.11	32.17	33.33	35.44	39.61	39.45	39.82	36.55	35.44	35.92	37.11	41.13	53.00	56.27	48.00	38.90	33.33	31.88	37.12	39.72			
<b>Mass Hub</b>	33.88	#N/A	34.12	31.88	31.17	33.00	34.12	34.19	35.42	37.67	42.09	41.93	42.32	38.84	37.67	38.18	39.44	43.72	56.38	60.11	51.01	41.35	35.42	33.88	39.47	42.23			
<b>Cleared Load (GW)</b>	10.8	10.8	10.7	10.8	11.1	11.4	11.4	11.8	12.8	13.1	13.2	13.1	12.8	12.6	12.6	12.9	13.6	14.2	14.2	14.1	13.1	11.6	10.5	0.0					

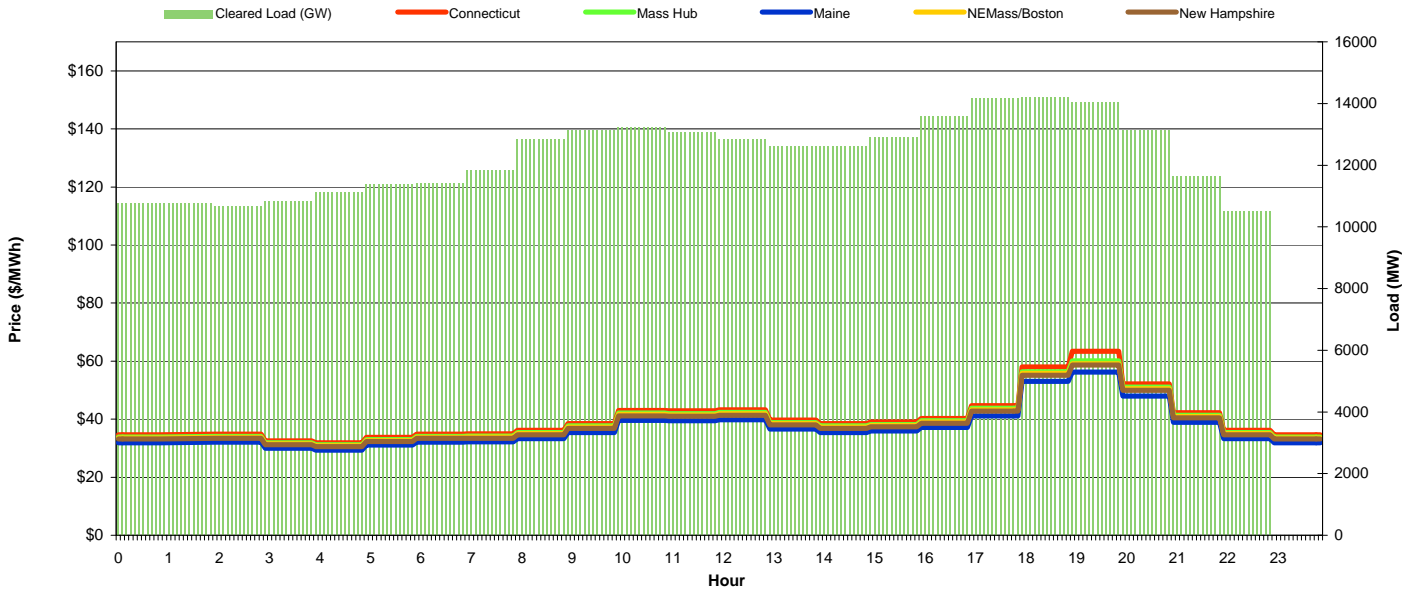

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	54.26	#N/A	36.41	35.15	33.64	31.58	32.40	29.54	33.84	38.86	54.49	62.14	62.96	63.76	66.52	63.61	66.22	58.17	58.07	155.59	57.50	38.38	34.38	37.76	52.40	59.00	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	53.41	#N/A	35.78	34.49	33.02	31.06	32.03	29.20	33.44	37.89	53.00	60.68	61.72	62.58	65.20	62.17	64.56	56.82	56.93	152.96	56.48	37.72	33.72	37.28	51.40	57.82		
<b>New Hampshire</b>	52.82	#N/A	35.49	34.20	32.76	30.75	31.73	28.91	33.18	37.71	52.77	60.32	61.39	62.26	64.92	61.93	64.32	56.40	56.51	151.20	56.25	37.63	33.60	37.01	51.05	57.46		
<b>Maine</b>	51.40	#N/A	34.44	33.11	31.74	88.00	31.05	28.23	32.54	36.72	51.18	58.52	59.49	60.25	63.15	60.26	62.16	54.76	54.93	145.76	53.76	36.05	32.17	35.86	51.98	55.62		
<b>Mass Hub</b>	53.91	#N/A	36.20	34.93	33.42	31.40	32.28	29.39	33.57	38.17	53.41	60.95	61.88	62.80	65.48	62.48	64.93	57.08	57.07	152.98	56.65	37.87	33.85	37.43	51.66	58.04		
<b>DA Forecast Load (GW)</b>	11.44	10.65	10.65	10.60	10.80	11.20	11.87	12.93	13.77	14.22	14.46	14.54	14.40	14.20	14.14	14.42	14.99	15.68	15.98	15.36	14.39	13.16	12.00	0.00				
<b>Forecast Error %</b>	7.6%	14.1%	13.5%	13.0%	11.7%	7.5%	2.0%	-5.2%	-4.5%	-2.2%	-0.1%	0.9%	1.4%	1.6%	1.5%	0.9%	-0.2%	-1.3%	-0.4%	0.9%	1.3%	1.6%	4.1%	#DIV/0!				

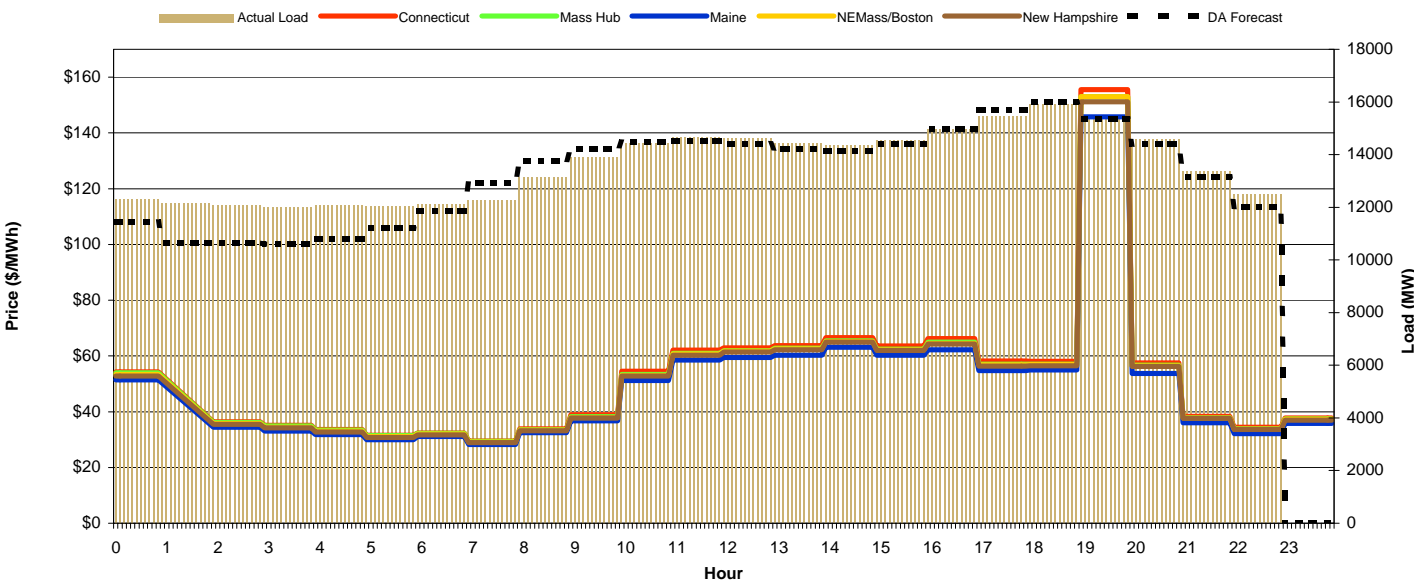




# ISO-NE Daily Report

Monday March 15, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
<b>Connecticut</b>	32.81	32.85	31.42	31.42	32.11	36.63	49.07	48.79	50.65	50.99	54.53	50.20	49.89	47.15	44.37	41.81	42.29	49.62	59.67	61.43	52.79	41.60	38.20	38.48	38.48	44.53	49.00	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	31.74	31.78	30.40	30.40	31.06	35.44	47.47	47.20	48.34	49.33	50.95	48.57	48.27	45.61	42.92	40.44	40.91	48.00	57.73	59.43	48.41	40.24	36.95	37.23	42.87	47.08			
<b>New Hampshire</b>	31.39	31.43	30.06	30.06	30.72	35.04	46.95	46.68	47.56	48.78	49.70	48.03	47.73	45.11	42.45	40.00	40.46	47.47	57.09	58.77	46.89	39.80	36.55	36.81	42.31	46.44			
<b>Maine</b>	30.24	30.28	28.96	28.96	29.59	33.76	45.23	44.97	45.87	47.00	48.00	46.28	45.99	43.46	40.90	38.53	38.98	45.73	55.00	56.63	45.35	38.34	35.21	35.47	40.78	44.77			
<b>Mass Hub</b>	32.08	32.13	30.72	30.72	31.40	35.82	47.86	47.59	48.96	49.73	51.98	48.97	48.66	45.99	43.27	40.77	41.24	48.39	58.20	59.92	49.73	40.57	37.26	37.53	43.31	47.58			
<b>Cleared Load (GW)</b>	10.8	10.8	10.5	10.4	11.0	11.3	12.9	14.5	14.5	14.8	14.8	14.9	14.7	14.8	14.6	14.5	14.8	15.1	15.3	15.3	14.8	13.7	12.2	10.7					

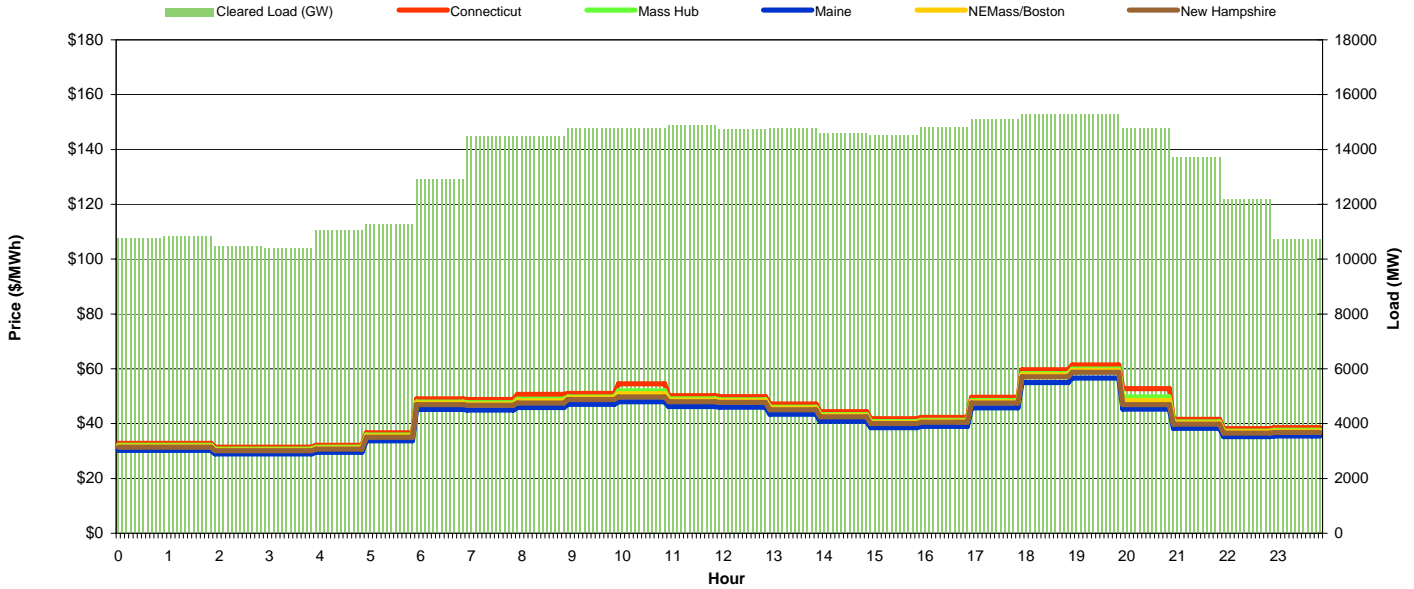

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	37.53	35.23	35.87	31.93	32.82	31.49	45.29	51.93	59.36	60.78	59.20	58.84	61.85	66.62	79.86	87.26	88.74	97.04	154.99	169.85	118.56	51.70	42.06	39.94	66.61	81.79	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	36.93	34.59	35.35	31.39	32.27	30.92	44.23	50.05	56.94	58.23	56.47	56.46	59.41	64.25	77.29	84.57	85.78	93.38	149.01	163.37	114.06	49.82	40.92	39.13	64.37	78.75		
<b>New Hampshire</b>	36.57	34.24	35.01	31.06	31.90	30.56	43.72	50.25	57.59	58.90	56.59	56.85	59.84	63.85	78.63	84.07	83.63	90.86	144.90	158.59	110.89	48.66	39.98	38.29	63.56	77.76		
<b>Maine</b>	35.41	33.10	33.92	30.03	30.94	88.00	42.34	47.22	53.62	54.34	52.47	52.28	54.66	58.82	71.00	78.28	79.39	85.97	137.20	148.52	104.04	45.91	38.18	37.40	62.21	72.62		
<b>Mass Hub</b>	37.22	34.99	35.75	31.75	32.63	31.23	44.53	50.56	57.54	58.86	57.14	57.01	59.95	64.69	77.86	85.22	86.48	94.25	150.29	164.74	115.18	50.42	41.33	39.46	64.96	79.47		
<b>DA Forecast Load (GW)</b>	11.11	10.64	10.52	10.46	10.79	11.84	13.86	15.25	15.69	15.98	16.23	16.30	16.15	16.11	15.82	15.70	15.93	16.48	16.66	17.00	16.47	15.24	13.79	12.43				
<b>Forecast Error %</b>	8.3%	13.8%	15.5%	16.0%	15.1%	9.4%	0.9%	0.9%	1.2%	1.3%	1.6%	2.0%	2.7%	2.8%	3.4%	3.4%	2.8%	1.4%	2.7%	2.9%	3.0%	3.8%	3.4%	3.1%				

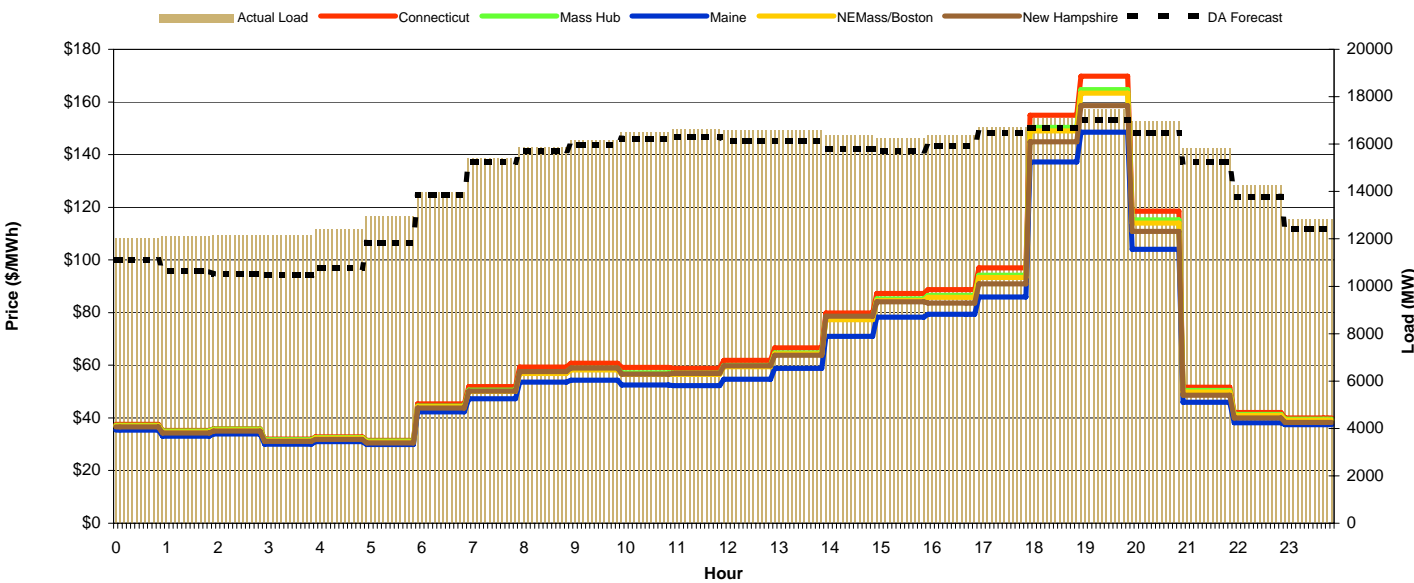




# ISO-NE Daily Report

Tuesday March 16, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
<b>Connecticut</b>	33.16	33.34	32.51	33.81	33.18	34.44	40.95	49.02	44.77	46.17	46.66	44.57	42.56	38.35	37.09	36.67	37.31	38.71	49.15	55.00	41.60	36.33	32.03	31.35	31.35	39.53	42.25	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	31.86	32.09	31.34	32.81	32.20	33.42	38.37	46.35	42.13	43.50	44.14	42.31	40.25	36.48	35.27	34.86	35.27	35.52	45.29	51.58	39.52	35.23	31.06	30.40	37.55	39.92			
<b>New Hampshire</b>	32.07	32.64	31.85	32.71	32.10	33.28	40.10	47.91	44.01	45.25	46.20	43.90	41.46	37.81	36.36	35.62	35.85	37.22	47.23	54.77	40.66	34.86	30.74	30.08	38.53	41.24			
<b>Maine</b>	30.82	30.96	30.17	31.29	30.71	31.88	38.48	45.88	41.98	43.28	43.52	41.36	39.53	35.81	34.63	34.24	34.60	35.82	45.12	51.02	37.72	33.63	29.66	29.02	36.71	39.24			
<b>Mass Hub</b>	32.38	32.62	31.84	33.16	32.54	33.77	39.58	47.55	43.34	44.72	45.19	43.15	41.12	37.28	36.06	35.64	36.01	36.65	46.45	52.82	39.84	35.59	31.38	30.71	38.31	40.80			
<b>Cleared Load (GW)</b>	10.9	10.8	11.0	11.2	11.6	11.6	14.1	14.4	14.8	14.8	15.0	14.9	14.8	14.7	14.2	14.1	14.2	15.1	15.8	15.7	15.7	14.1	12.7	11.3					

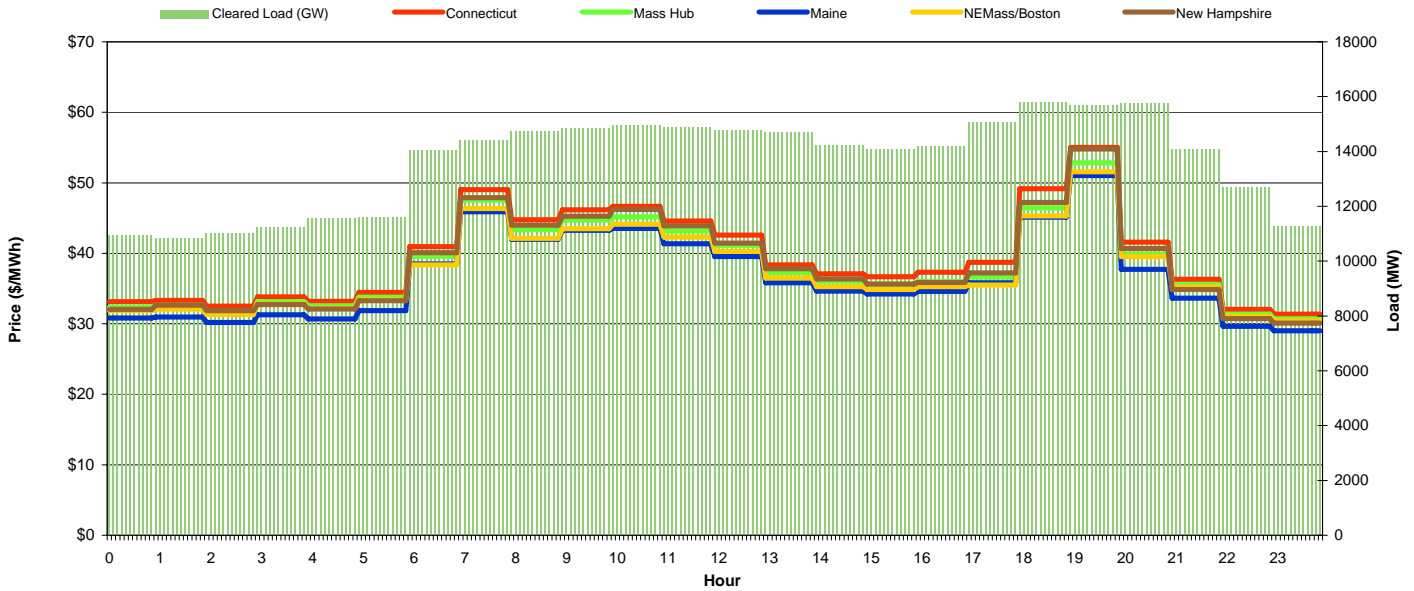

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	37.45	36.61	34.74	43.75	47.86	34.82	54.50	47.03	45.64	41.16	46.41	39.37	37.38	36.56	37.25	37.71	35.90	31.79	35.58	45.55	37.36	36.56	30.77	32.17	39.33	38.88	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	36.71	35.90	34.15	43.01	47.12	34.23	53.20	45.43	43.85	39.23	44.14	37.61	35.96	35.24	35.99	36.28	34.50	30.72	34.25	43.43	35.89	35.27	29.94	31.59	38.07	37.36		
<b>New Hampshire</b>	36.14	35.47	33.75	42.45	46.45	33.75	52.39	44.74	43.28	38.83	43.75	37.35	35.69	34.91	35.56	35.86	34.09	30.16	33.76	42.97	35.56	34.85	29.35	31.03	37.59	36.92		
<b>Maine</b>	35.57	34.91	33.30	41.95	45.93	88.00	50.70	43.13	41.82	37.48	42.26	35.91	34.38	33.74	34.33	34.51	32.89	29.03	32.70	41.39	34.18	33.48	28.21	30.51	38.76	35.59		
<b>Mass Hub</b>	37.05	36.33	34.54	43.54	47.65	34.54	53.53	45.81	44.33	39.78	44.78	38.08	36.33	35.57	36.29	36.65	34.83	30.92	34.55	43.93	36.23	35.61	30.20	31.79	38.45	37.74		
<b>DA Forecast Load (GW)</b>	11.66	11.23	11.02	10.98	11.28	12.39	14.42	15.59	15.72	15.85	15.79	15.68	15.44	15.26	15.00	14.86	14.89	15.17	15.49	16.20	16.01	14.91	13.50	12.13				
<b>Forecast Error %</b>	5.9%	10.0%	12.0%	13.6%	11.6%	5.1%	1.4%	-0.8%	-0.5%	-1.5%	-1.0%	-1.0%	-1.0%	-0.8%	-1.0%	-1.7%	-2.4%	-3.3%	-2.9%	-0.3%	-0.3%	0.5%	0.8%	1.9%				

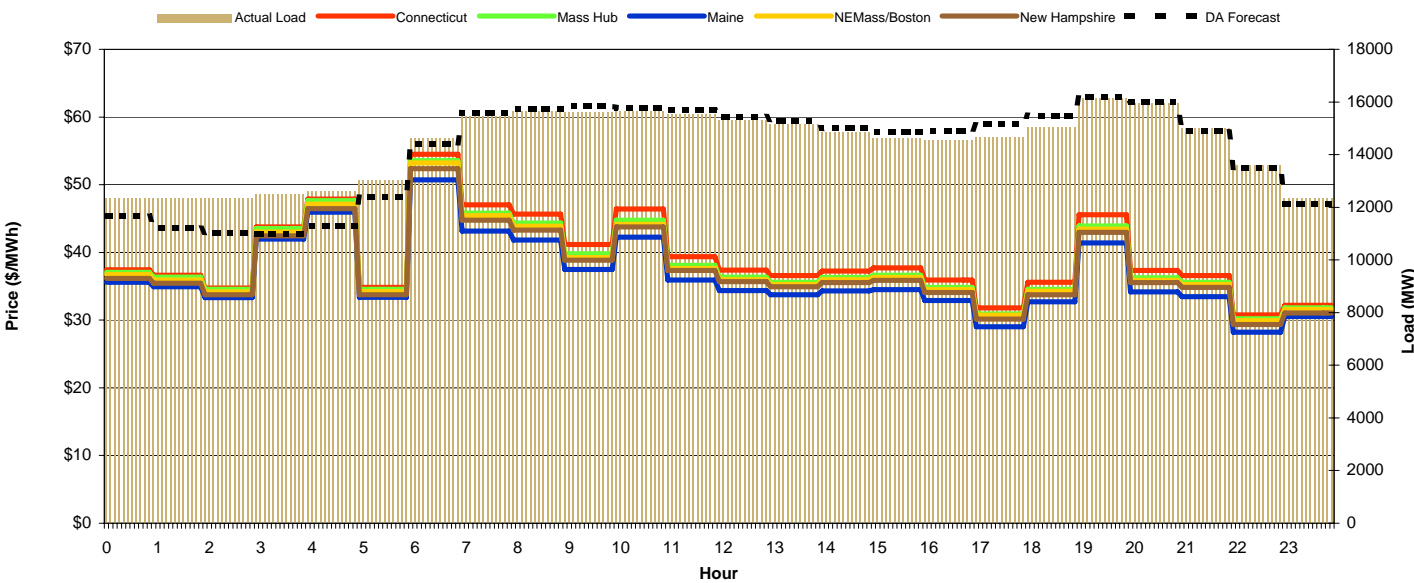






# ISO-NE Daily Report

Wednesday March 17, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	33.04	32.00	31.24	31.24	31.24	32.19	43.07	43.45	42.61	42.15	41.84	40.08	40.06	38.43	37.89	36.56	37.73	39.13	50.59	52.83	45.48	38.02	34.45	31.24	38.61	41.33	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	32.05	31.05	30.32	30.32	30.32	31.23	41.80	42.16	41.35	40.90	40.60	38.88	38.87	37.30	36.77	35.47	36.61	37.20	48.06	50.61	43.10	36.89	33.43	30.32	37.32	39.89		
<b>New Hampshire</b>	31.68	30.69	29.96	29.96	29.96	30.86	41.30	41.67	40.86	40.42	40.13	38.43	38.42	36.86	36.34	35.06	36.18	36.75	47.47	50.00	42.47	36.45	33.04	29.96	36.87	39.41		
<b>Maine</b>	30.53	29.57	28.87	28.87	28.87	29.74	39.80	40.15	39.38	38.95	38.67	37.03	37.02	35.52	35.02	33.78	34.87	35.41	45.73	48.18	40.94	35.13	31.84	28.87	35.53	37.98		
<b>Mass Hub</b>	32.36	31.35	30.61	30.61	30.61	31.53	42.10	42.47	41.65	41.20	40.90	39.17	39.16	37.57	37.04	35.73	36.88	37.35	48.24	50.87	43.39	37.16	33.67	30.54	37.59	40.15		
<b>Cleared Load (GW)</b>	10.9	10.7	10.5	10.5	10.9	11.3	13.5	14.5	14.6	14.7	14.7	14.7	14.5	14.3	13.9	13.7	13.8	14.5	15.2	16.0	14.5	13.4	11.7	10.6				

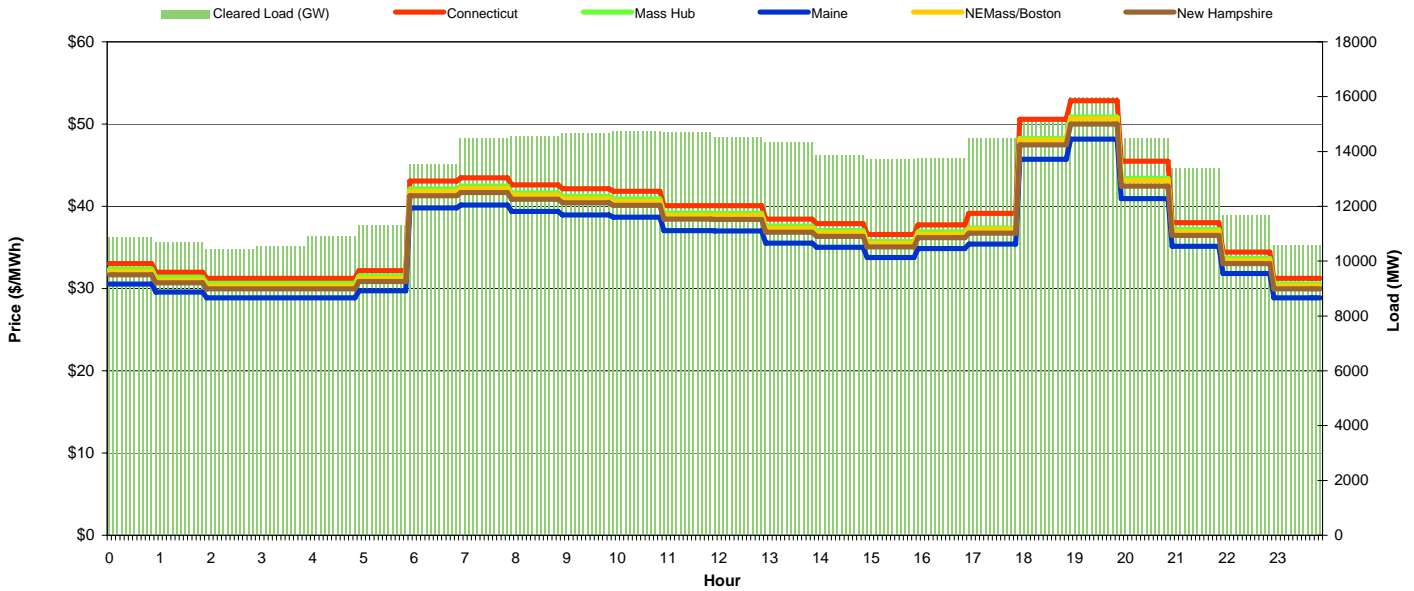

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	30.29	30.46	30.20	29.88	27.67	30.65	48.49	46.00	44.82	38.11	40.60	41.31	39.07	39.10	38.61	37.61	36.35	33.86	33.38	37.80	44.75	36.61	33.92	22.15	36.32	38.87	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	29.89	30.02	29.77	29.46	27.34	30.23	47.49	45.03	43.46	37.17	39.33	39.95	37.69	37.75	37.25	36.29	35.06	32.83	32.47	36.54	42.80	35.21	32.96	21.71	35.32	37.61		
<b>New Hampshire</b>	29.38	29.53	29.33	29.03	26.89	29.73	46.70	44.24	42.82	36.67	38.85	39.46	37.24	37.35	36.80	35.82	34.56	32.29	31.85	35.89	42.05	34.59	32.30	21.33	34.78	37.05		
<b>Maine</b>	28.78	28.91	28.81	28.60	26.56	28.00	45.66	43.35	41.60	35.49	37.51	38.07	35.86	35.83	35.12	34.21	33.02	30.88	30.51	34.28	39.93	32.97	30.65	20.78	36.06	35.58		
<b>Mass Hub</b>	30.08	30.27	30.04	29.72	27.58	30.44	47.77	45.22	43.76	37.38	39.60	40.24	38.02	38.10	37.62	36.64	35.35	33.02	32.58	36.71	43.21	35.55	33.16	21.78	35.58	37.89		
<b>DA Forecast Load (GW)</b>	11.34	10.91	10.67	10.66	10.98	12.04	14.10	15.24	15.49	15.50	15.44	15.33	15.10	15.04	14.79	14.61	14.72	14.97	15.27	15.90	15.58	14.54	13.20	11.74				
<b>Forecast Error %</b>	4.2%	4.9%	7.4%	7.6%	9.1%	2.3%	-0.1%	0.3%	-0.1%	-0.6%	-0.3%	-0.3%	-0.2%	-0.5%	-0.2%	-0.2%	-1.7%	-3.1%	-3.8%	-1.6%	-0.6%	-0.1%	-0.6%	1.4%				

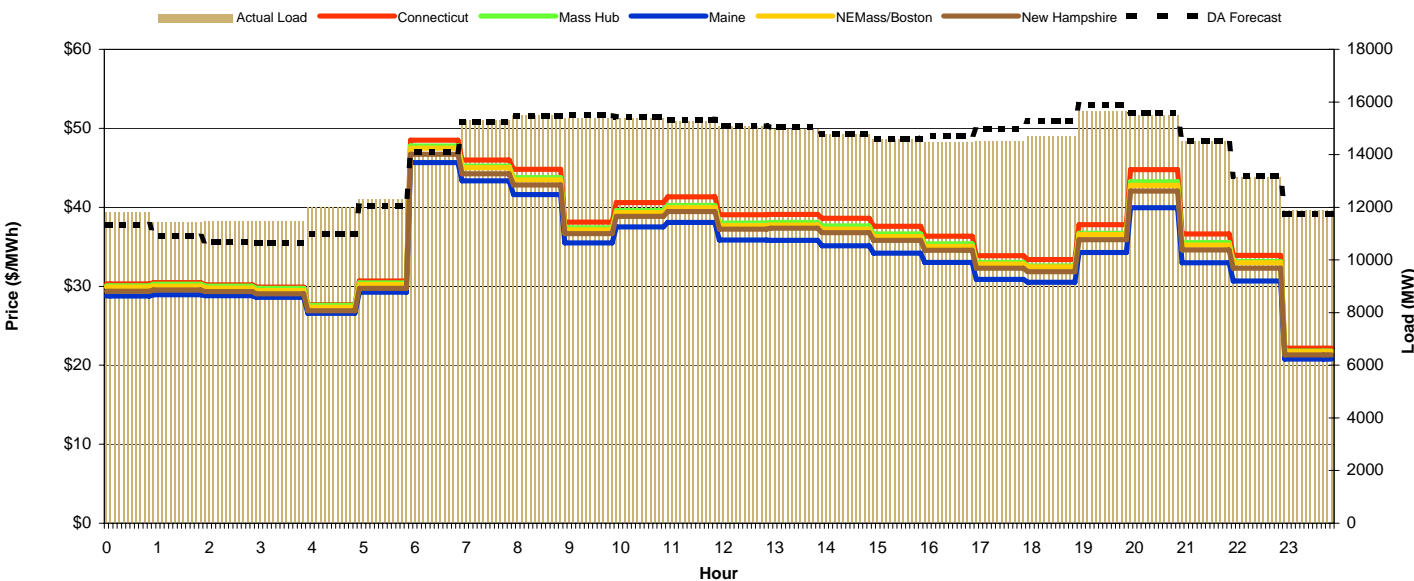




# ISO-NE Daily Report

Thursday March 18, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	25.57	26.65	24.60	24.60	24.60	31.18	41.31	43.43	42.64	40.82	40.47	40.60	40.00	39.00	37.11	36.99	36.99	36.99	44.71	49.57	44.31	38.38	34.46	30.21	36.47	40.40	All	On Pk
<b>NEMass/Boston</b>	24.83	25.88	23.89	23.89	23.89	30.27	40.11	42.17	41.40	39.63	39.29	39.42	38.83	37.86	36.03	35.91	35.91	35.91	43.40	47.59	43.02	37.26	33.45	29.33	35.38	39.19	30.21	36.47
<b>New Hampshire</b>	24.52	25.56	23.60	23.60	23.60	29.90	39.62	41.65	40.90	39.15	38.81	38.94	38.36	37.40	35.59	35.47	35.47	35.47	42.88	47.00	42.50	36.81	33.05	28.98	34.95	38.72	30.21	36.47
<b>Maine</b>	23.65	24.65	22.75	22.75	22.75	28.83	38.20	40.16	39.43	37.74	37.42	37.54	36.99	36.06	34.32	34.20	34.20	34.20	41.34	45.32	40.97	35.49	31.86	27.94	33.70	37.33	30.21	36.47
<b>Mass Hub</b>	25.00	26.06	24.05	24.05	24.05	30.48	40.39	42.46	41.69	39.91	39.56	39.69	39.11	38.13	36.28	36.16	36.16	36.16	43.71	47.84	43.32	37.52	33.69	29.54	35.63	39.46	30.21	36.47
<b>Cleared Load (GW)</b>	10.8	10.6	10.9	10.9	11.0	10.8	13.4	14.0	14.3	14.3	14.2	14.2	14.2	14.0	13.7	13.6	13.7	14.0	14.7	15.2	14.2	13.3	11.6	10.4				

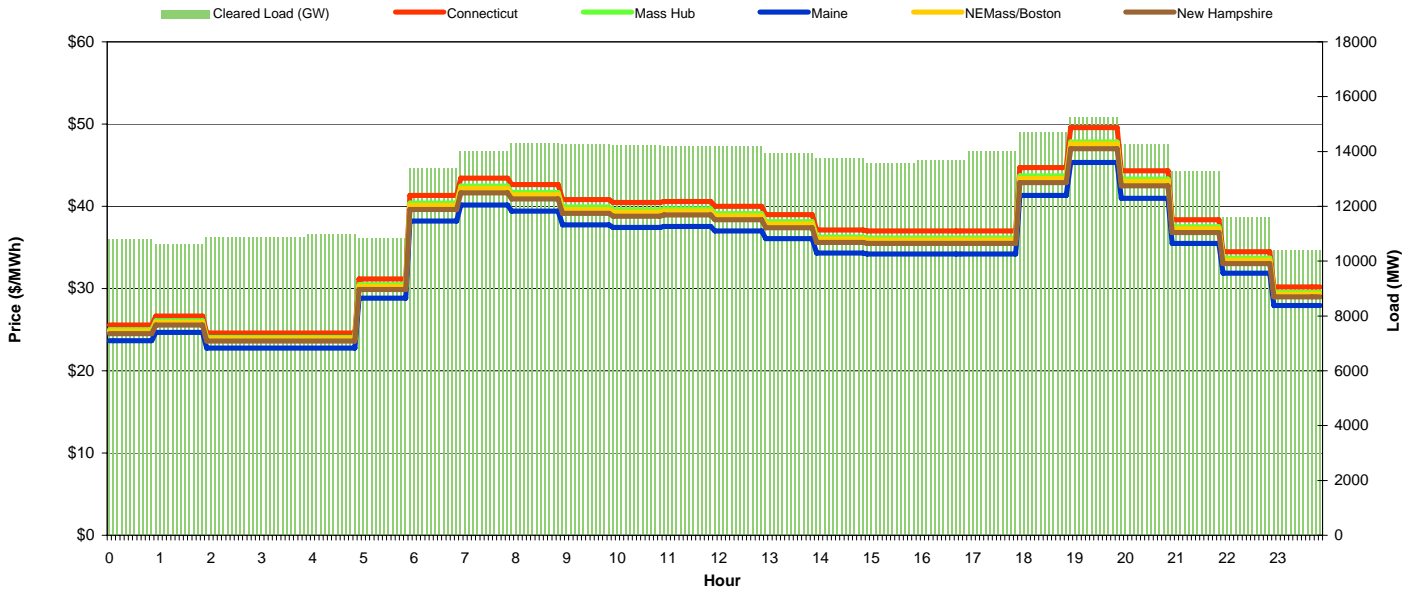

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	22.21	25.23	21.05	26.15	25.00	10.04	38.27	41.27	39.46	40.72	38.91	38.58	36.39	37.06	35.81	34.81	34.85	34.95	34.33	42.18	41.67	37.42	34.06	34.84	33.55	37.65	All	On Pk
<b>NEMass/Boston</b>	21.74	24.56	20.48	25.44	24.33	9.81	37.29	39.93	38.16	39.32	37.54	37.30	35.26	35.90	34.61	33.70	33.85	33.96	33.53	41.03	40.32	36.10	32.96	34.02	32.55	36.47	30.21	36.47
<b>New Hampshire</b>	21.45	24.26	20.24	25.18	24.06	9.71	36.90	39.43	37.74	38.93	37.13	36.91	34.86	35.54	34.19	33.25	33.36	33.42	33.01	40.50	39.84	35.66	32.37	33.51	32.14	36.01	30.21	36.47
<b>Maine</b>	20.91	23.50	19.62	24.45	23.32	88.00	35.52	37.78	36.29	37.45	35.60	35.37	33.40	34.07	32.63	31.77	31.93	32.03	31.78	39.15	38.24	34.29	31.16	33.07	34.22	34.56	30.21	36.47
<b>Mass Hub</b>	21.86	24.80	20.71	25.74	24.59	9.89	37.49	40.12	38.37	39.60	37.81	37.55	35.48	36.13	34.85	33.91	34.01	34.12	33.60	41.13	40.55	36.41	33.21	34.18	32.75	36.68	30.21	36.47
<b>DA Forecast Load (GW)</b>	10.76	10.32	10.12	10.10	10.39	11.42	13.49	14.75	15.01	15.10	15.07	14.94	14.71	14.61	14.38	14.23	14.33	14.56	14.73	15.44	15.13	14.09	12.85	11.43				
<b>Forecast Error %</b>	8.3%	11.1%	14.3%	14.4%	12.9%	9.0%	0.9%	0.1%	0.1%	-0.1%	0.8%	1.4%	2.0%	1.8%	2.3%	1.9%	0.8%	-0.3%	-0.1%	1.3%	2.2%	2.5%	1.3%	2.7%				

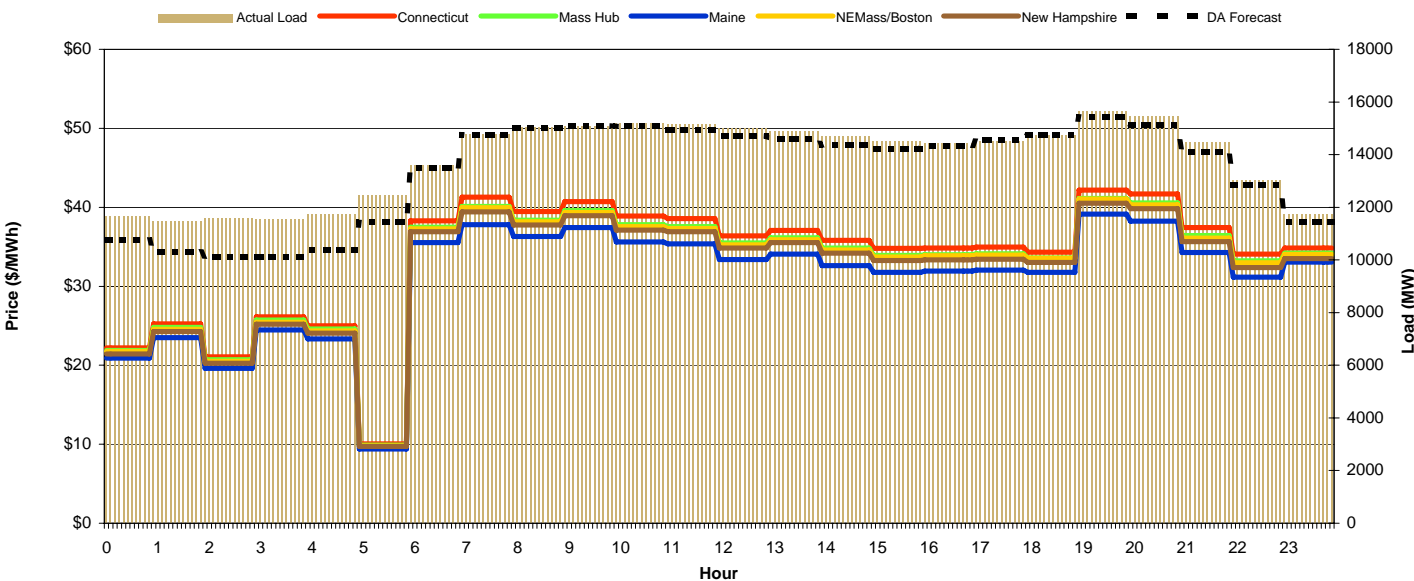




# ISO-NE Daily Report

Friday March 19, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	23.52	22.52	20.30	20.30	20.59	25.95	38.46	41.36	41.31	41.31	41.31	40.00	39.74	39.00	38.72	36.34	36.21	36.48	40.14	44.37	41.00	35.88	34.32	28.26	34.47	39.22	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	22.85	21.88	19.72	19.72	20.00	25.21	37.24	39.72	39.76	39.70	39.76	38.41	38.24	37.59	37.43	35.30	35.11	34.80	38.46	42.77	39.57	34.86	33.34	27.46	33.29	37.80		
<b>New Hampshire</b>	22.57	21.61	19.48	19.48	19.76	24.90	36.78	39.22	39.27	39.21	39.26	37.93	37.77	37.13	36.97	34.87	34.68	34.36	37.98	42.23	39.08	34.43	32.93	27.12	32.88	37.33		
<b>Maine</b>	21.77	20.85	18.79	18.79	19.06	24.02	35.48	37.83	37.88	37.82	37.87	36.59	36.44	35.82	35.66	33.64	33.46	33.14	36.64	40.74	37.71	33.22	31.78	26.17	31.72	36.02		
<b>Mass Hub</b>	23.00	22.03	19.85	19.85	20.14	25.38	37.47	39.91	39.97	39.90	39.96	38.60	38.45	37.80	37.65	35.54	35.34	34.93	38.63	43.00	39.80	35.10	33.57	27.64	33.48	38.01		
<b>Cleared Load (GW)</b>	10.5	10.4	10.5	10.5	10.6	10.5	13.0	14.0	14.2	14.2	14.2	14.1	14.1	13.7	13.5	13.3	13.3	13.5	14.2	14.4	14.0	12.9	11.5	10.5				

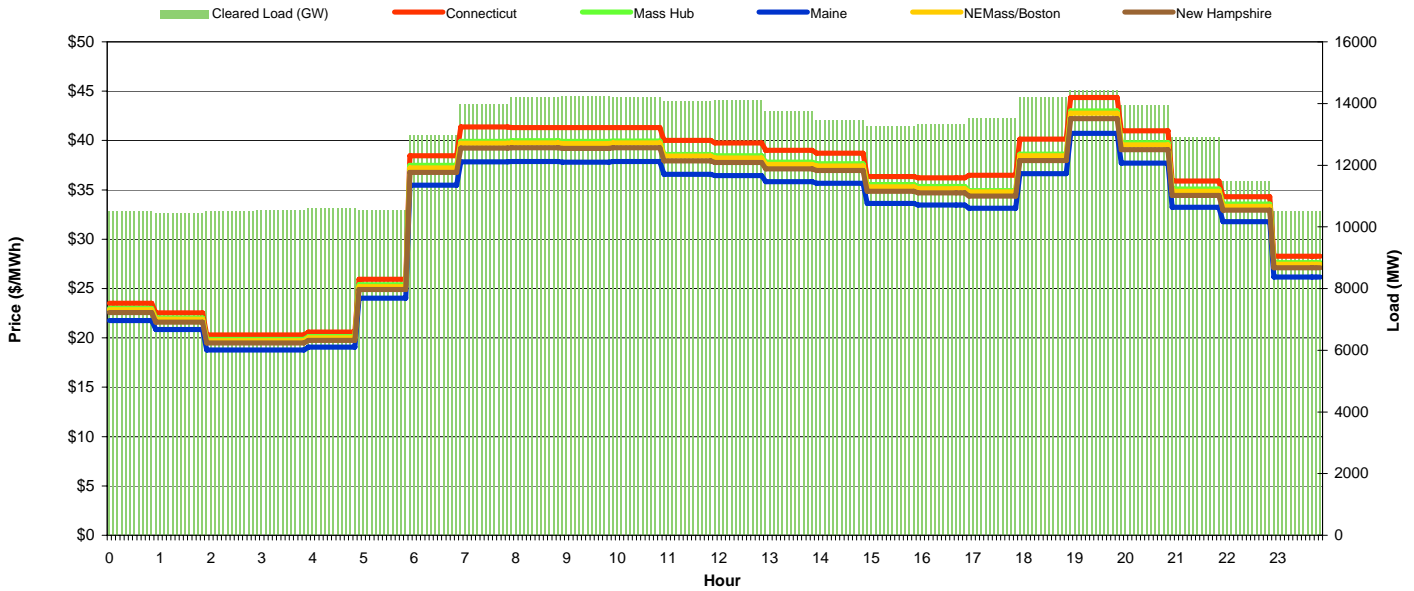

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	32.97	28.96	32.26	27.51	32.67	19.68	36.23	37.49	37.77	37.67	39.37	39.04	37.78	37.52	37.22	36.02	33.78	34.65	34.64	39.79	36.70	35.58	32.20	22.59	34.17	36.70	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	32.09	28.19	31.33	26.81	31.84	19.17	35.36	36.21	36.36	36.40	37.94	37.55	36.38	36.19	35.87	34.76	32.72	33.65	33.69	38.63	35.38	34.40	31.51	22.33	33.12	35.48		
<b>New Hampshire</b>	31.77	27.95	31.11	26.61	31.63	18.98	34.91	35.87	35.99	36.06	37.59	37.09	35.98	35.83	35.49	34.35	32.19	33.03	33.05	37.99	34.77	33.95	30.85	21.85	32.70	35.01		
<b>Maine</b>	31.40	27.58	30.65	26.25	31.29	88.00	33.97	34.71	34.72	34.65	35.84	35.50	34.69	34.58	34.14	32.97	30.80	31.63	31.68	36.47	33.28	32.65	29.54	21.34	34.51	33.62		
<b>Mass Hub</b>	32.33	28.42	31.69	27.13	32.20	19.35	35.52	36.45	36.67	36.66	38.22	37.85	36.66	36.45	36.14	35.01	32.92	33.84	33.86	38.83	35.63	34.67	31.64	22.36	33.35	35.72		
<b>DA Forecast Load (GW)</b>	10.67	10.16	9.98	9.89	10.19	11.14	13.05	14.32	14.66	14.89	14.92	14.86	14.60	14.52	14.26	14.19	14.09	14.16	14.28	14.75	14.51	13.68	12.79	11.44				
<b>Forecast Error %</b>	7.3%	10.4%	12.0%	15.9%	13.1%	7.4%	1.4%	0.9%	0.9%	0.0%	0.6%	0.6%	1.3%	1.3%	1.5%	0.5%	0.0%	-1.2%	-1.7%	0.3%	0.6%	1.1%	-0.7%	2.2%				

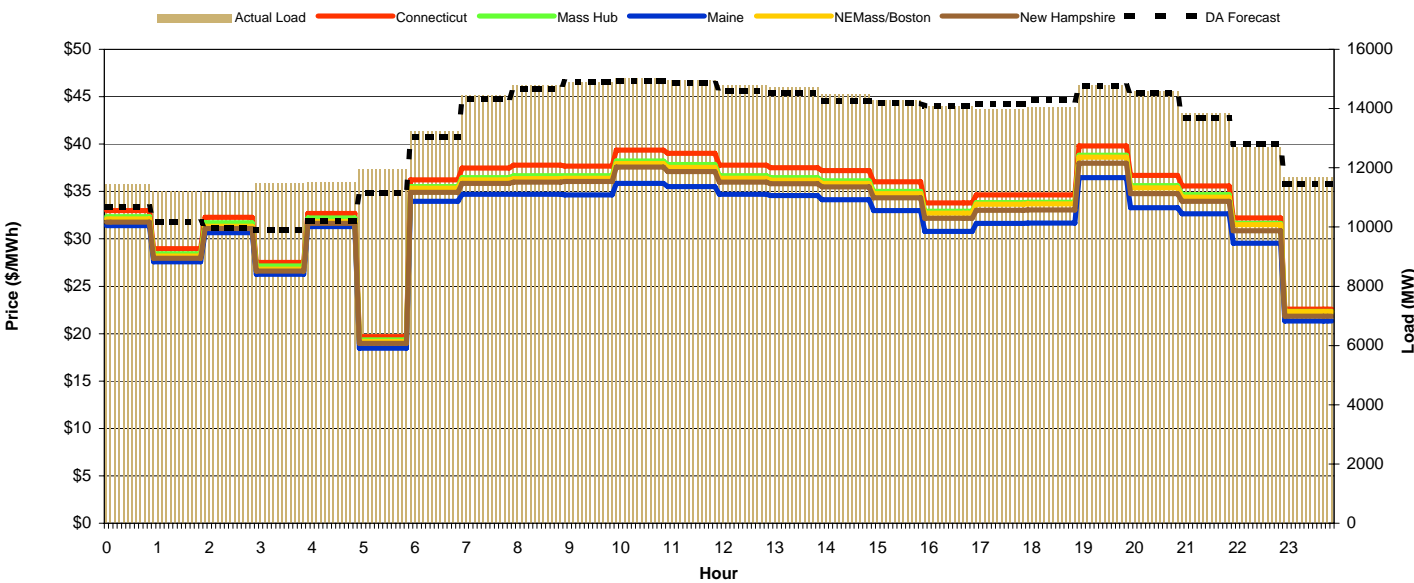




# ISO-NE Daily Report

Saturday March 20, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	27.26	26.88	26.75	23.68	21.50	23.55	25.32	29.16	34.40	36.88	38.00	37.99	34.61	34.01	32.11	31.34	31.71	34.36	38.68	43.04	38.69	34.48	34.47	31.34	32.09	35.25	All	On Pk
NEMass/Boston	26.50	26.13	26.00	23.02	20.90	22.89	24.61	28.34	33.43	35.85	36.94	36.92	33.64	33.05	31.21	30.47	30.82	33.40	37.60	41.84	37.60	33.51	33.50	30.47	31.19	34.26		
New Hampshire	26.18	25.81	25.68	22.74	20.64	22.61	24.31	28.00	33.03	35.41	36.49	36.47	33.23	32.65	30.82	30.09	30.45	32.99	37.14	41.32	37.14	33.10	33.09	30.09	30.81	33.84		
Maine	25.26	24.91	24.79	21.95	19.92	21.82	23.46	27.02	31.87	34.18	35.22	35.20	32.07	31.51	29.75	29.04	29.38	31.84	35.84	39.88	35.85	31.95	31.94	29.04	29.74	32.66		
Mass Hub	26.67	26.30	26.17	23.17	21.04	23.04	24.77	28.53	33.65	36.09	37.18	37.17	33.86	33.27	31.41	30.67	31.03	33.62	37.84	42.11	37.85	33.74	33.72	30.67	31.40	34.48		
Cleared Load (GW)	9.9	9.8	9.8	9.7	9.8	9.9	10.4	11.5	12.4	13.3	13.5	13.3	13.0	12.7	12.5	12.4	12.6	12.8	13.3	13.8	13.3	12.4	11.1	10.1				

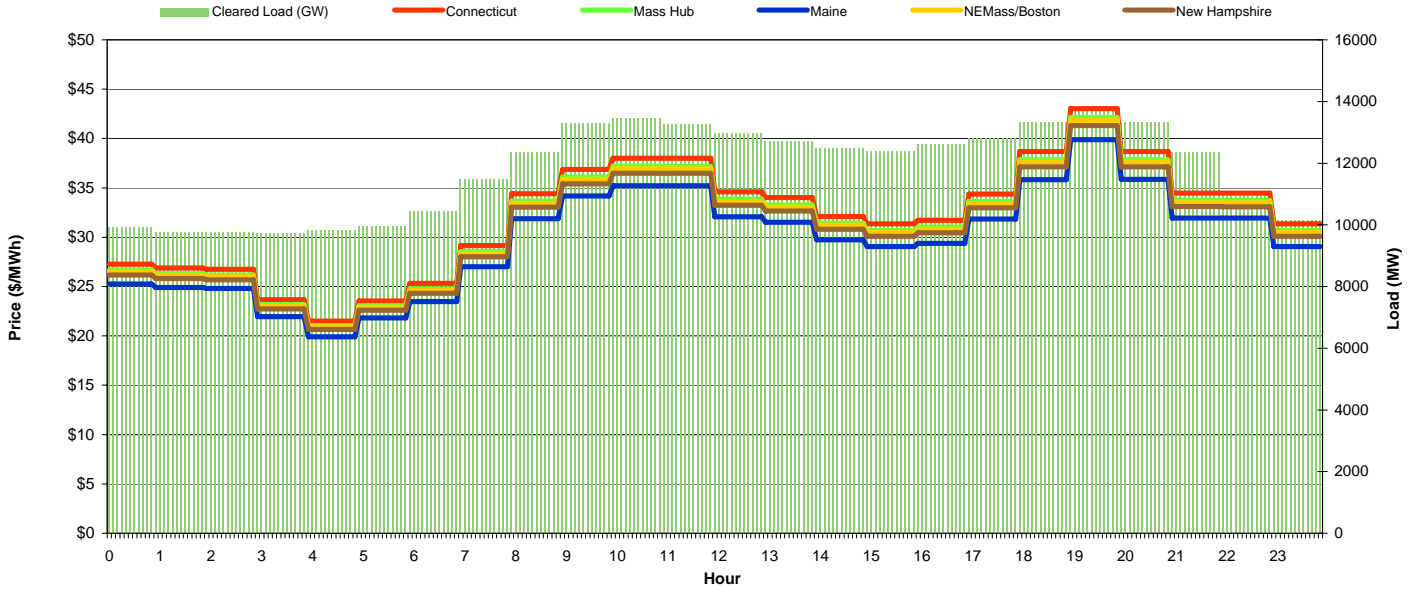

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	24.87	30.61	22.08	22.04	30.14	22.17	34.65	34.25	33.38	38.74	36.15	34.74	33.89	32.42	30.78	30.83	33.33	31.42	30.97	35.44	0.00	0.00	39.62	27.93	28.77	29.75	All	On Pk
NEMass/Boston	24.53	30.34	21.87	21.80	29.83	22.04	34.42	33.92	32.76	37.85	35.30	33.90	32.98	31.55	29.96	30.05	32.59	30.82	30.44	34.80	0.00	0.00	38.88	27.35	28.25	29.11		
New Hampshire	24.13	29.88	21.55	21.49	29.41	21.71	33.79	33.37	32.34	37.53	34.96	33.52	32.62	31.07	29.40	29.45	31.93	30.10	29.71	34.01	0.00	0.00	37.93	26.77	27.78	28.62		
Maine	23.65	29.37	21.20	21.12	28.88	22.10	33.21	32.74	31.88	37.09	34.46	32.93	31.91	30.02	28.19	28.21	30.61	28.92	28.55	32.69	0.00	0.00	36.90	26.19	28.86	27.82		
Mass Hub	24.60	30.41	21.94	21.89	29.98	22.10	34.43	33.95	32.83	37.97	35.37	33.96	33.08	31.66	30.08	30.16	32.65	30.84	30.44	34.71	0.00	0.00	38.87	27.38	28.30	29.16		
DA Forecast Load (GW)	10.62	10.02	9.77	9.65	9.72	10.01	10.70	11.59	12.54	13.23	13.51	13.50	13.36	13.16	12.98	12.82	12.92	13.20	13.38	13.88	13.74	13.00	12.23	11.06				
Forecast Error %	2.4%	5.0%	6.4%	7.1%	7.5%	7.7%	1.2%	0.1%	1.0%	0.8%	1.0%	0.6%	-0.3%	-1.0%	-1.7%	-1.2%	-1.7%	-2.5%	-2.2%	0.3%	-12.5%	-13.7%	#####	#####				

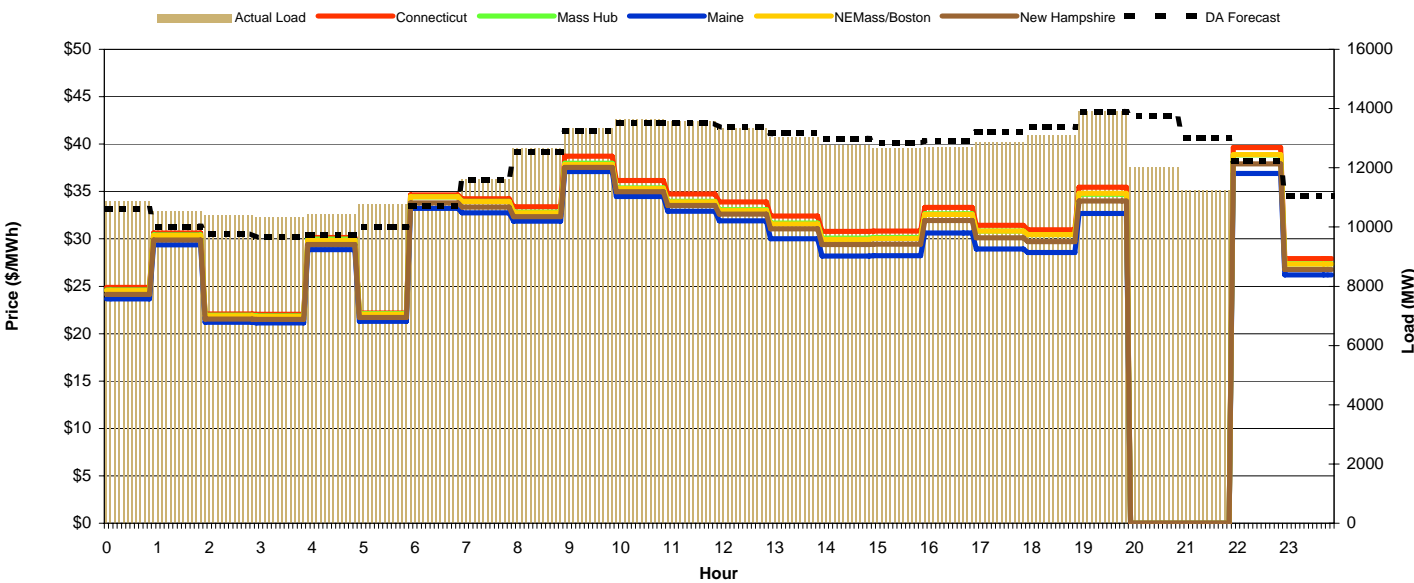




# ISO-NE Daily Report

Sunday March 21, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
<b>Connecticut</b>	26.67	25.79	22.52	22.52	24.47	24.54	27.28	29.12	33.02	34.64	37.00	38.80	36.19	35.00	34.44	34.44	34.76	38.14	43.68	49.93	42.17	38.45	34.72	31.37	31.37	33.32	37.16	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	25.93	25.07	21.89	21.89	23.78	23.86	26.52	28.31	32.10	33.68	35.97	37.73	35.19	34.03	33.48	33.48	33.79	37.08	42.46	47.76	41.00	37.38	33.75	30.49	32.36	36.07			
<b>New Hampshire</b>	25.61	24.76	21.62	21.62	23.49	23.56	26.19	27.96	31.70	33.26	35.53	37.26	34.75	33.60	33.07	33.07	33.37	36.62	41.93	47.15	40.49	36.92	33.34	30.11	31.96	35.63			
<b>Maine</b>	24.73	23.91	20.88	20.88	22.68	22.75	25.29	27.00	30.62	32.12	34.31	35.98	33.56	32.45	31.93	31.93	32.22	35.36	40.49	45.53	39.10	35.65	32.19	29.08	30.86	34.40			
<b>Mass Hub</b>	26.09	25.22	22.03	22.03	23.93	24.01	26.68	28.49	32.30	33.89	36.20	37.96	35.41	34.24	33.69	33.69	34.00	37.31	42.73	47.94	41.26	37.62	33.97	30.68	32.56	36.29			
<b>Cleared Load (GW)</b>	9.5	9.7	9.9	9.7	9.6	9.6	9.9	10.6	11.4	12.6	12.9	12.7	12.7	12.5	12.2	12.2	12.5	13.1	14.0	14.2	13.6	12.3	10.9	9.8					

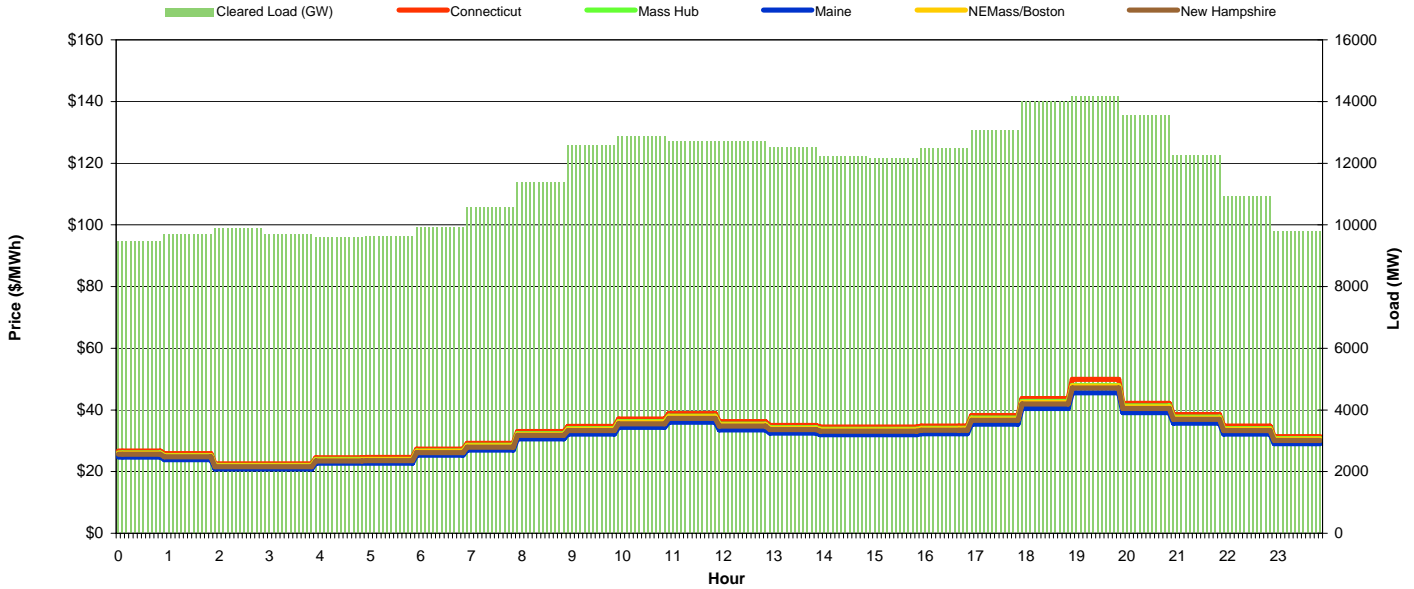

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	24.81	19.85	18.24	20.91	17.07	1.40	0.00	0.00	27.82	31.71	33.77	35.00	34.83	34.92	33.57	32.15	32.62	34.41	33.46	151.89	35.41	38.14	33.91	31.30	31.55	38.98	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	24.41	19.49	17.94	20.53	16.75	1.37	0.00	0.00	27.09	30.74	32.72	33.70	33.46	33.56	32.36	31.16	31.63	33.12	32.50	146.74	34.29	36.66	32.79	30.44	30.56	37.66		
<b>New Hampshire</b>	23.93	19.14	17.63	20.21	16.50	1.35	0.00	0.00	26.88	30.50	32.47	33.52	33.28	33.45	32.24	30.99	31.47	32.93	32.27	146.04	34.06	36.40	32.29	29.94	30.31	37.42		
<b>Maine</b>	23.57	18.72	17.23	19.80	16.19	88.00	0.00	0.00	26.47	30.14	32.13	33.10	32.83	33.02	31.75	30.57	31.05	32.53	32.19	145.04	33.57	35.96	31.53	29.34	33.53	36.99		
<b>Mass Hub</b>	24.49	19.61	18.06	20.68	16.89	1.39	0.00	0.00	27.28	30.95	32.94	33.99	33.77	33.86	32.61	31.35	31.82	33.35	32.53	146.96	34.36	36.85	32.97	30.61	30.72	37.85		
<b>DA Forecast Load (GW)</b>	10.22	9.72	9.43	9.33	9.35	9.55	9.93	10.62	11.58	12.36	12.87	12.91	12.91	12.78	12.53	12.49	12.75	13.40	13.89	14.50	14.18	13.24	12.29	11.04				
<b>Forecast Error %</b>	3.7%	7.6%	9.4%	9.1%	9.8%	7.1%	5.1%	2.9%	1.3%	0.2%	-0.5%	0.9%	1.1%	0.9%	1.3%	0.7%	-0.3%	-2.2%	-1.9%	0.8%	1.7%	1.9%	-0.5%	0.5%				

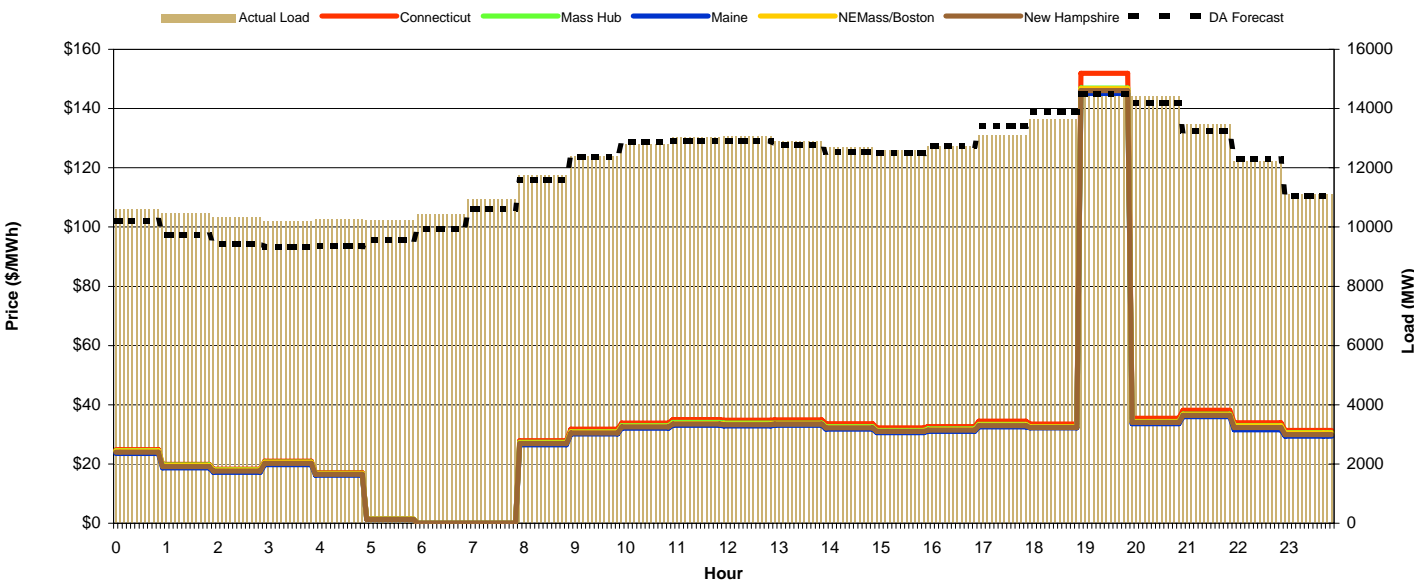




# ISO-NE Daily Report

Monday March 22, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	25.41	20.44	19.50	20.08	25.72	26.99	31.80	36.49	37.86	36.89	39.13	39.06	37.76	36.68	34.86	35.19	35.96	39.24	43.04	46.34	41.39	34.96	32.14	25.70	33.44	37.94	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	24.73	19.89	18.98	19.54	25.03	26.26	30.95	35.51	36.84	35.89	37.86	37.86	36.74	35.62	33.64	34.05	34.74	37.51	39.75	44.50	38.21	33.50	31.28	25.01	32.25	36.47		
<b>New Hampshire</b>	24.40	19.62	18.73	19.28	24.70	25.91	30.54	35.04	36.35	35.42	37.36	37.35	36.25	35.15	33.19	33.59	34.27	36.99	39.18	43.90	37.65	33.05	30.86	24.68	31.81	35.98		
<b>Maine</b>	23.60	18.98	18.11	18.65	23.88	25.06	29.53	33.88	35.15	34.25	36.12	36.12	35.06	33.99	32.09	32.48	33.14	35.77	37.87	42.45	36.40	31.95	29.84	23.86	30.76	34.79		
<b>Mass Hub</b>	24.87	20.00	19.09	19.66	25.17	26.41	31.13	35.72	37.05	36.10	38.05	38.06	36.95	35.82	33.79	34.21	34.90	37.62	39.65	44.70	38.12	33.62	31.46	25.15	32.39	36.61		
<b>Cleared Load (GW)</b>	10.0	9.9	10.0	10.0	9.9	10.1	13.2	14.2	14.5	14.7	14.9	14.9	15.0	15.0	14.6	14.5	14.6	15.2	15.6	16.0	15.0	13.7	12.1	10.8				

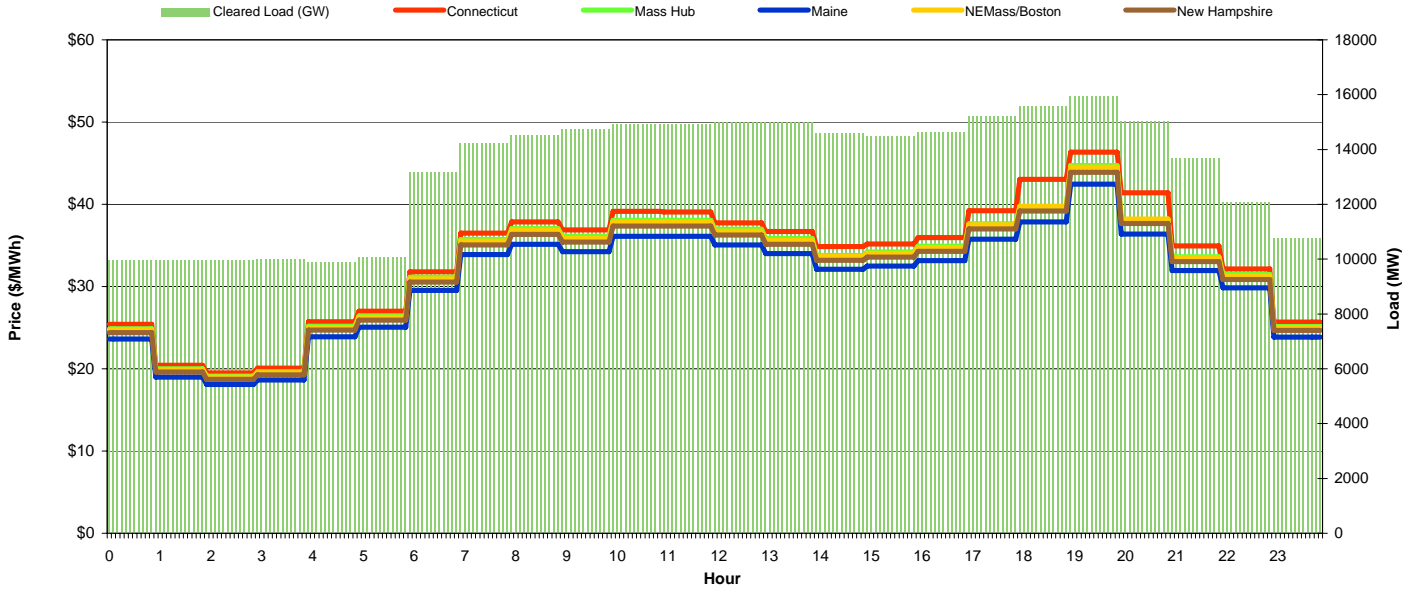

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	25.07	19.85	21.37	22.59	35.56	16.18	33.57	40.14	39.61	38.88	38.10	36.45	37.30	36.44	36.47	38.48	39.13	39.58	38.72	44.79	43.39	36.53	32.20	27.64	34.09	38.51	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	24.64	19.50	20.97	22.18	34.69	15.88	32.57	38.58	37.72	37.03	36.27	34.68	35.41	34.56	34.60	36.50	37.00	37.72	37.25	43.01	41.43	34.70	31.04	27.19	32.71	36.72		
<b>New Hampshire</b>	24.18	19.16	20.62	21.82	34.21	15.66	32.26	38.19	37.47	36.83	36.06	34.51	35.25	34.45	34.53	36.47	36.96	37.59	37.03	42.66	40.98	34.26	30.50	26.69	32.43	36.48		
<b>Maine</b>	23.82	18.86	20.32	21.49	33.75	15.80	31.89	37.49	36.84	36.03	35.10	33.44	34.22	33.38	33.50	35.52	36.17	36.77	36.35	41.80	39.88	33.16	29.31	26.15	34.72	35.56		
<b>Mass Hub</b>	24.78	19.65	21.15	22.36	35.05	15.98	32.84	38.94	38.17	37.59	36.84	35.24	36.01	35.17	35.23	37.19	37.70	38.31	37.65	43.44	41.98	35.27	31.37	27.32	33.13	37.26		
<b>DA Forecast Load (GW)</b>	10.23	9.78	9.55	9.54	9.87	11.00	12.97	14.30	14.91	15.20	15.36	15.41	15.26	15.17	14.99	14.88	14.92	15.16	15.33	16.20	15.65	14.44	13.10	11.63				
<b>Forecast Error %</b>	4.5%	8.4%	9.4%	9.2%	6.8%	3.5%	0.7%	1.2%	0.5%	-0.1%	0.2%	0.1%	0.9%	1.3%	1.6%	2.1%	3.1%	4.1%	4.9%	1.4%	1.3%	1.8%	0.8%	1.8%				

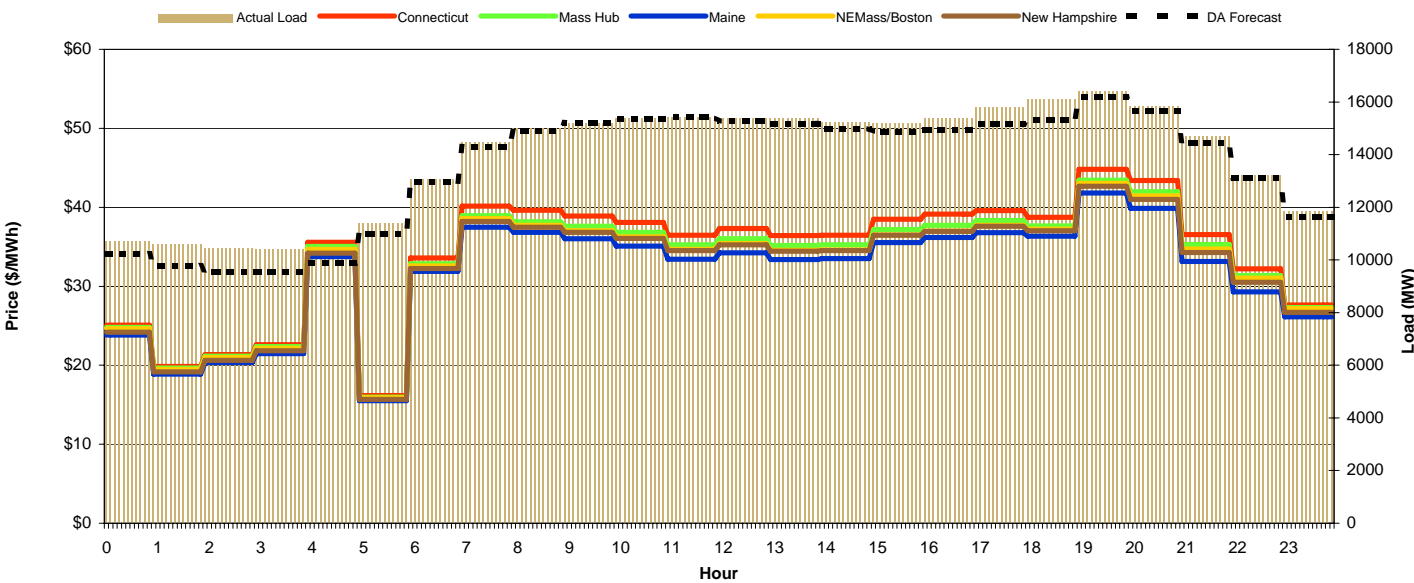




# ISO-NE Daily Report

Tuesday March 23, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	22.51	25.62	27.27	22.54	26.13	27.94	35.07	43.00	44.00	43.66	44.11	44.95	45.54	45.13	43.29	40.87	43.66	44.95	46.07	53.00	45.84	39.09	37.63	34.48	38.60	44.05	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	21.90	24.93	26.54	21.94	25.43	27.19	34.13	41.85	42.82	42.49	42.92	43.74	44.32	43.92	42.13	39.77	42.49	43.74	43.98	51.18	42.93	38.05	36.62	33.55	37.44	42.68		
<b>New Hampshire</b>	21.61	24.59	26.18	21.64	25.09	26.82	33.67	41.28	42.24	41.92	42.35	43.16	43.73	43.33	41.56	39.24	41.92	43.16	43.37	50.48	42.40	37.53	36.13	33.10	36.94	42.11		
<b>Maine</b>	20.94	23.84	25.38	20.98	24.32	26.00	32.63	40.02	40.95	40.63	41.05	41.83	42.38	42.00	40.28	38.03	40.63	41.83	42.03	48.93	41.06	36.38	35.02	32.08	35.80	40.82		
<b>Mass Hub</b>	22.03	25.07	26.70	22.06	25.58	27.35	34.33	42.09	43.07	42.74	43.18	44.00	44.58	44.18	42.37	40.00	42.74	44.00	44.11	51.42	42.96	38.27	36.84	33.75	37.64	42.91		
<b>Cleared Load (GW)</b>	10.7	10.4	10.1	10.5	10.7	10.9	12.9	14.0	14.2	14.4	14.5	14.4	14.4	14.3	14.0	13.9	14.1	14.6	15.4	15.8	14.8	13.4	11.9	10.8				

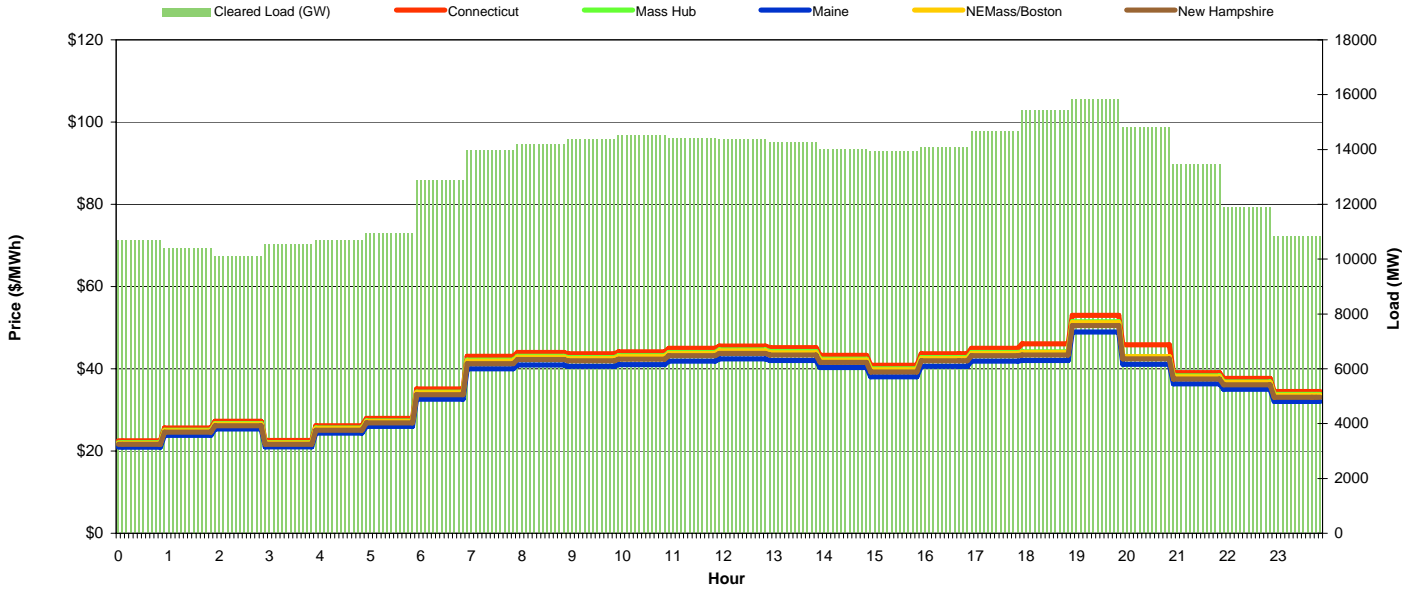

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	25.45	27.31	34.02	21.50	27.80	32.14	40.31	45.45	44.01	49.41	51.08	48.72	58.85	45.93	51.88	49.16	51.80	50.63	72.55	108.06	42.43	35.61	67.09	35.34	46.52	54.54	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	24.99	26.77	33.23	21.02	27.33	31.44	39.59	44.10	42.37	47.55	49.28	47.03	56.83	44.36	49.73	47.25	49.65	48.84	70.35	104.80	41.13	34.22	65.09	34.61	45.07	52.66		
<b>New Hampshire</b>	24.63	26.43	32.89	20.75	27.00	31.12	39.10	43.64	42.10	47.24	48.93	46.80	56.61	44.16	49.43	46.88	49.30	48.48	69.86	103.91	40.71	33.85	63.88	33.92	44.65	52.24		
<b>Maine</b>	24.15	25.84	32.09	20.28	26.42	30.28	37.82	41.98	40.72	45.72	47.01	44.83	54.28	42.21	47.23	44.77	47.13	46.79	67.49	100.15	38.94	32.40	60.71	32.43	42.99	50.15		
<b>Mass Hub</b>	25.18	27.07	33.67	21.30	27.65	31.81	39.88	44.49	42.36	47.00	48.55	46.43	55.51	43.95	49.02	46.66	48.99	48.12	69.39	104.94	40.90	34.55	65.78	34.85	44.92	52.29		
<b>DA Forecast Load (GW)</b>	10.83	10.35	10.13	10.08	10.37	11.41	13.54	14.84	15.25	15.47	15.59	15.60	15.43	15.44	15.20	15.13	15.16	15.40	15.61	16.31	15.92	14.77	13.31	11.90				
<b>Forecast Error %</b>	4.6%	9.2%	10.8%	12.7%	11.5%	6.7%	1.9%	1.3%	1.8%	2.1%	2.7%	2.7%	3.2%	2.3%	2.9%	2.9%	4.1%	5.0%	5.3%	2.3%	1.4%	1.6%	1.9%	2.5%				

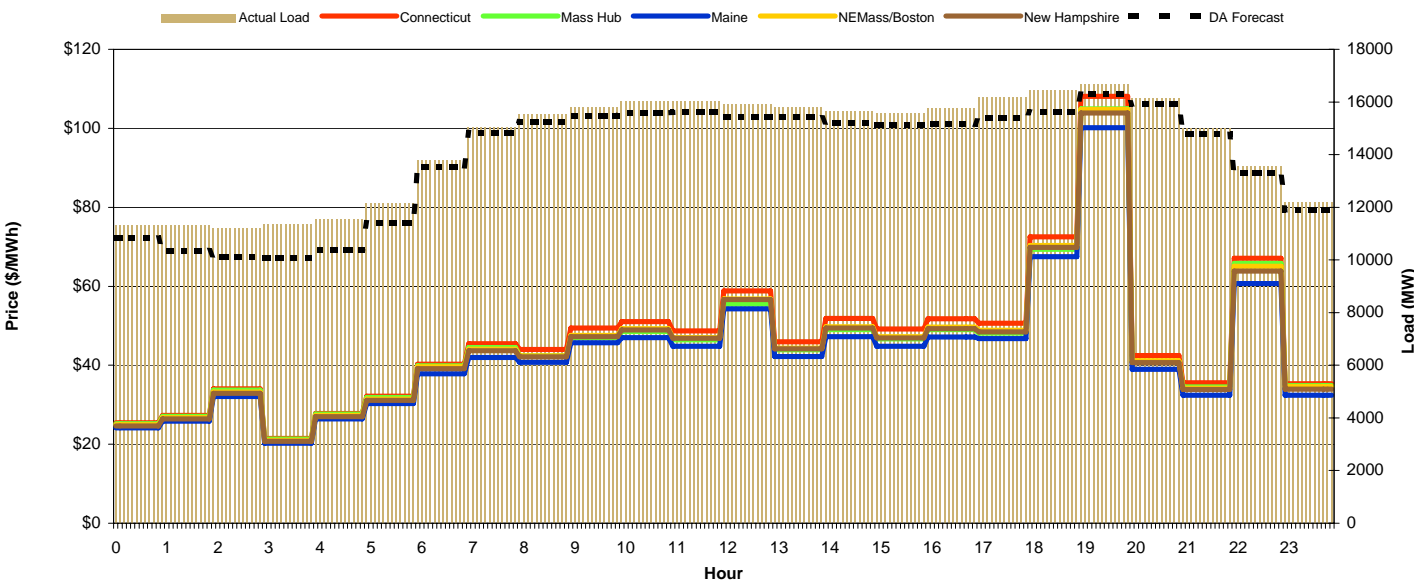




# ISO-NE Daily Report

Wednesday March 24, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	32.96	33.00	32.00	32.97	32.64	35.97	40.85	48.70	43.69	42.60	45.11	43.28	40.71	38.98	36.85	36.56	37.04	40.29	41.69	49.53	45.68	36.99	36.30	34.53	39.12	41.50	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	32.00	32.04	31.07	32.01	31.69	34.93	39.66	47.28	42.46	41.44	43.87	42.16	39.66	38.04	35.94	35.63	36.08	39.20	40.52	48.18	44.35	35.91	35.24	33.52	38.04	40.37		
<b>New Hampshire</b>	31.57	31.61	30.66	31.58	31.27	34.46	39.13	46.65	41.84	40.85	43.25	41.53	39.06	37.44	35.38	35.09	35.54	38.59	39.89	47.49	43.76	35.43	34.77	33.07	37.50	39.79		
<b>Maine</b>	30.66	30.70	29.77	30.67	30.37	33.46	38.00	45.30	40.63	39.67	42.00	40.33	37.94	36.36	34.36	34.07	34.51	37.47	38.74	46.12	42.49	34.41	33.77	32.12	36.41	38.64		
<b>Mass Hub</b>	32.21	32.25	31.28	32.22	31.91	35.16	39.93	47.60	42.58	41.60	44.06	42.24	39.72	38.01	35.94	35.67	36.14	39.19	40.50	48.36	44.64	36.15	35.48	33.75	38.19	40.49		
<b>Cleared Load (GW)</b>	10.1	10.3	10.4	10.2	10.7	11.5	13.3	13.7	14.7	15.0	14.9	14.7	14.8	14.5	14.1	13.9	14.1	14.5	15.1	15.7	14.6	13.6	11.8	10.9				

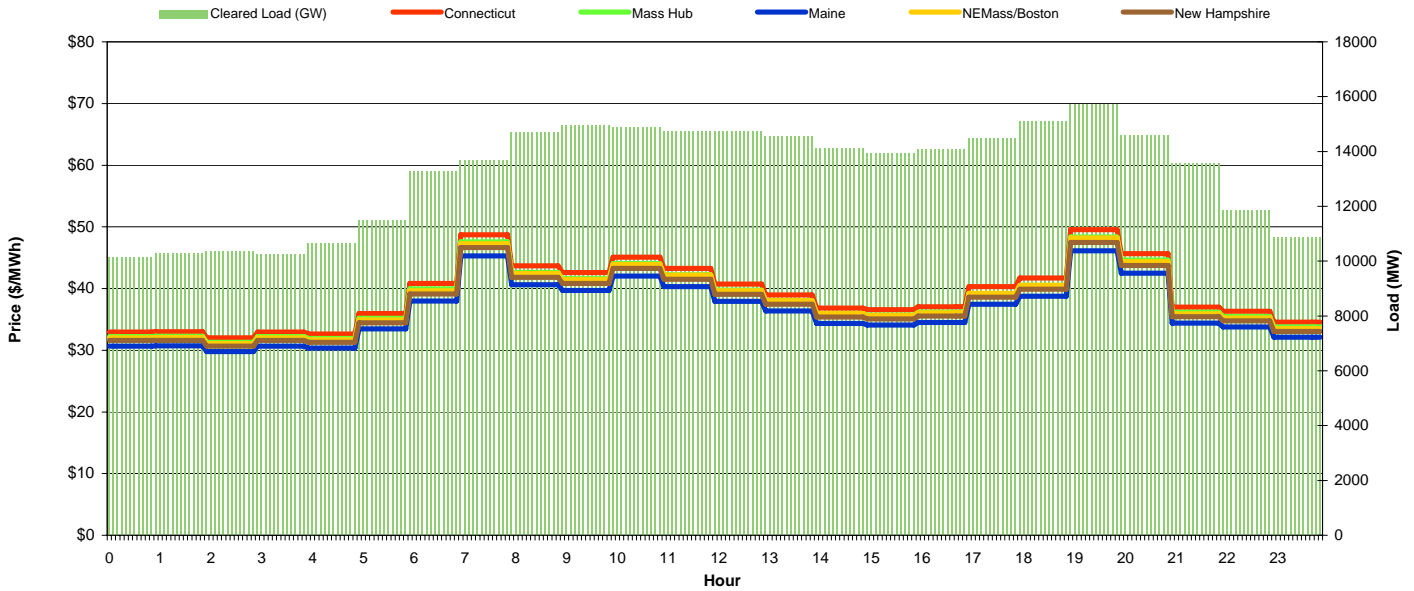

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	33.46	57.85	45.06	31.35	41.55	40.60	69.36	63.46	43.70	46.27	50.15	56.61	39.09	34.72	33.70	34.19	34.03	34.14	34.44	39.07	46.98	39.45	34.16	22.87	41.93	41.51	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	33.10	57.18	44.39	30.97	41.22	40.27	68.52	62.04	42.67	45.30	48.89	55.05	38.01	33.99	33.09	33.44	33.30	33.38	33.71	38.01	45.27	37.99	33.22	22.39	41.06	40.46		
<b>New Hampshire</b>	32.52	56.30	43.71	30.45	40.56	39.61	67.74	61.44	42.35	44.93	48.47	54.56	37.63	33.61	32.67	33.00	32.85	32.94	33.31	37.55	44.62	37.39	32.46	21.86	40.52	39.99		
<b>Maine</b>	31.55	55.03	42.73	29.90	39.93	38.97	67.04	60.02	41.60	43.84	47.14	52.65	36.47	32.69	31.74	32.09	31.98	32.08	32.52	36.59	43.26	36.10	31.31	21.25	39.52	38.88		
<b>Mass Hub</b>	33.35	57.82	44.99	31.36	41.69	40.66	68.77	62.40	42.98	45.68	49.33	55.61	38.40	34.27	33.31	33.69	33.55	33.64	33.91	38.25	45.67	38.44	33.50	22.57	41.41	40.79		
<b>DA Forecast Load (GW)</b>	11.18	10.66	10.44	10.42	10.70	11.75	13.87	15.19	15.56	15.62	15.68	15.64	15.39	15.30	15.05	14.85	14.94	15.27	15.55	16.11	15.89	14.84	13.44	12.05				
<b>Forecast Error %</b>	6.7%	13.0%	14.7%	12.7%	12.3%	9.3%	-0.1%	0.0%	-0.1%	0.1%	0.2%	0.0%	0.2%	-0.2%	-0.2%	-0.2%	-1.3%	-2.5%	-3.1%	-1.1%	0.4%	0.8%	0.6%	2.0%				

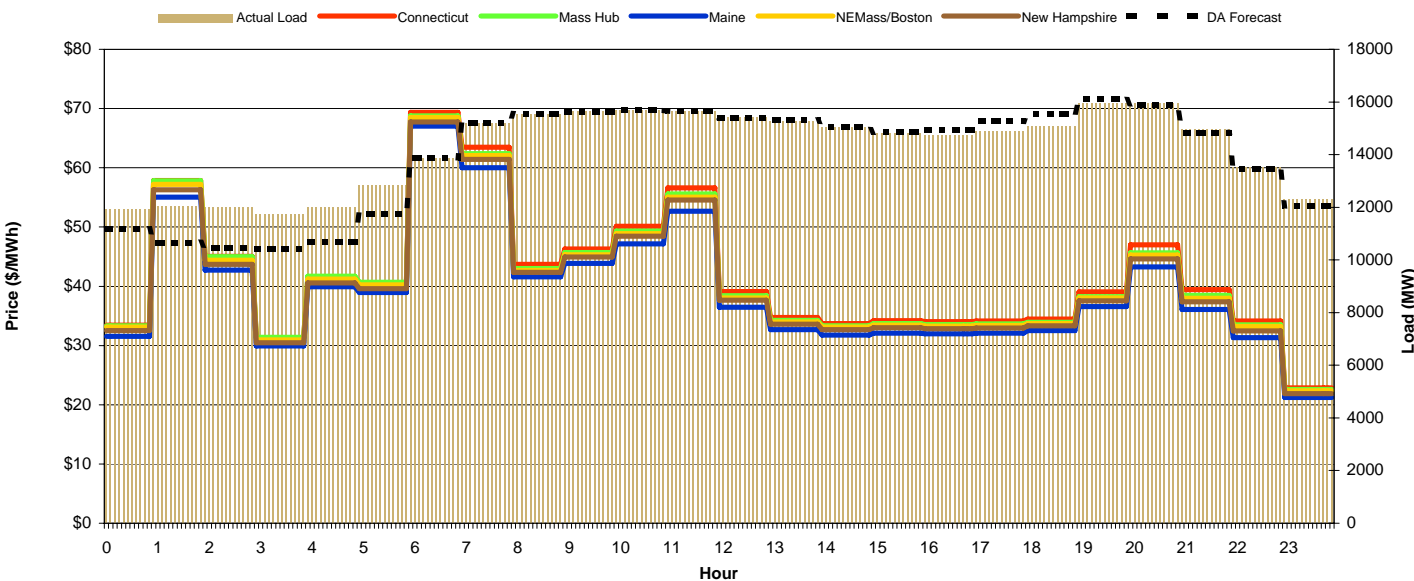






# ISO-NE Daily Report

Thursday March 25, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	31.11	30.97	30.21	28.15	29.66	31.33	38.47	42.75	40.27	42.81	42.95	39.71	38.01	37.00	35.38	35.03	35.38	35.80	41.20	51.04	42.48	35.59	32.77	30.06	36.59	39.26	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	30.21	30.09	29.33	27.34	28.80	30.42	37.34	41.51	38.89	41.57	41.41	38.10	36.91	35.93	34.36	34.02	34.36	34.76	39.10	49.24	40.85	34.56	31.82	29.19	35.42	37.96		
<b>New Hampshire</b>	29.84	29.71	28.97	27.00	28.44	30.04	36.87	41.00	38.40	41.05	40.89	37.61	36.45	35.48	33.93	33.59	33.93	34.33	38.60	48.62	40.33	34.13	31.43	28.83	34.98	37.49		
<b>Maine</b>	28.99	28.87	28.15	26.23	27.64	29.23	35.83	39.83	37.31	39.89	39.73	36.55	35.42	34.48	32.97	32.64	32.97	33.36	37.50	47.24	39.19	33.16	30.53	28.01	33.99	36.42		
<b>Mass Hub</b>	30.42	30.30	29.54	27.53	29.00	30.63	37.60	41.80	39.13	41.86	41.65	38.30	37.17	36.18	34.60	34.25	34.60	35.00	39.24	49.53	41.07	34.80	32.04	29.39	35.65	38.20		
<b>Cleared Load (GW)</b>	11.3	11.3	11.4	11.6	11.8	11.8	14.2	15.1	15.2	15.3	15.3	15.1	14.9	14.7	14.2	14.2	14.3	14.6	15.2	15.6	15.1	13.9	12.5	11.2				

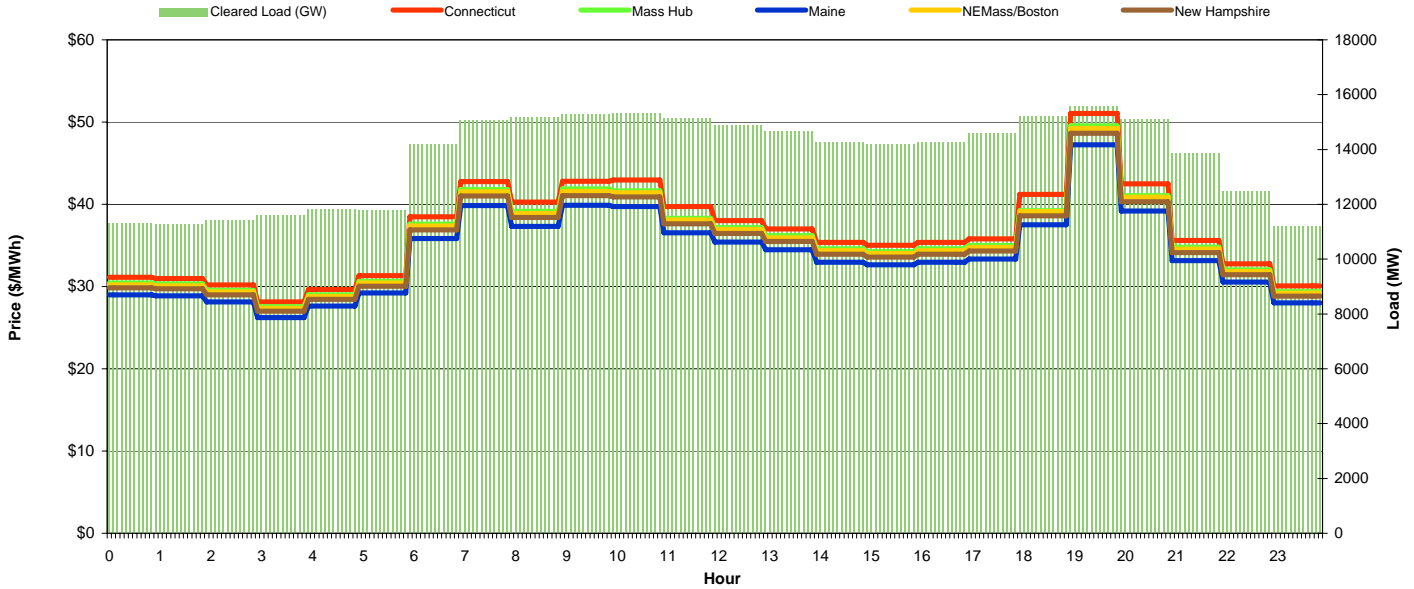

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	21.84	24.85	2.08	0.00	32.55	25.56	34.72	36.90	38.80	39.80	46.34	38.81	34.68	34.85	34.54	33.89	34.29	34.37	35.03	45.72	38.08	36.51	28.88	26.93	31.67	36.97	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	21.52	24.50	2.05	0.00	31.80	25.04	34.12	35.70	37.23	38.16	44.01	37.13	33.39	33.45	33.12	32.60	33.03	33.15	33.77	43.86	36.44	35.11	28.17	26.47	30.58	35.52		
<b>New Hampshire</b>	21.13	24.19	2.02	0.00	31.36	24.66	33.64	35.37	36.90	37.81	43.45	36.64	32.91	32.93	32.47	31.94	32.37	32.56	33.23	43.16	35.85	34.57	27.44	25.80	30.10	34.98		
<b>Maine</b>	20.70	23.75	1.99	0.00	30.87	24.13	32.95	34.42	35.97	36.83	42.17	35.62	32.02	31.91	31.30	30.83	31.29	31.48	32.14	41.66	34.54	33.38	26.40	25.34	29.24	33.87		
<b>Mass Hub</b>	21.77	24.82	2.08	0.00	32.31	25.35	34.35	36.14	37.80	38.74	44.82	37.71	33.85	33.95	33.60	33.05	33.48	33.58	34.21	44.54	37.04	35.65	28.42	26.64	31.00	36.04		
<b>DA Forecast Load (GW)</b>	11.24	10.79	10.57	10.56	10.88	11.95	14.03	15.25	15.49	15.55	15.53	15.38	15.13	15.00	14.74	14.55	14.63	14.93	15.25	15.86	15.58	14.55	13.18	11.80				
<b>Forecast Error %</b>	11.5%	14.1%	14.4%	14.2%	11.5%	6.5%	-0.6%	-1.2%	-1.6%	-2.1%	-1.6%	-1.3%	-0.7%	-0.4%	0.3%	0.6%	0.2%	-1.0%	-1.6%	-0.5%	0.1%	0.5%	-0.3%	0.6%				

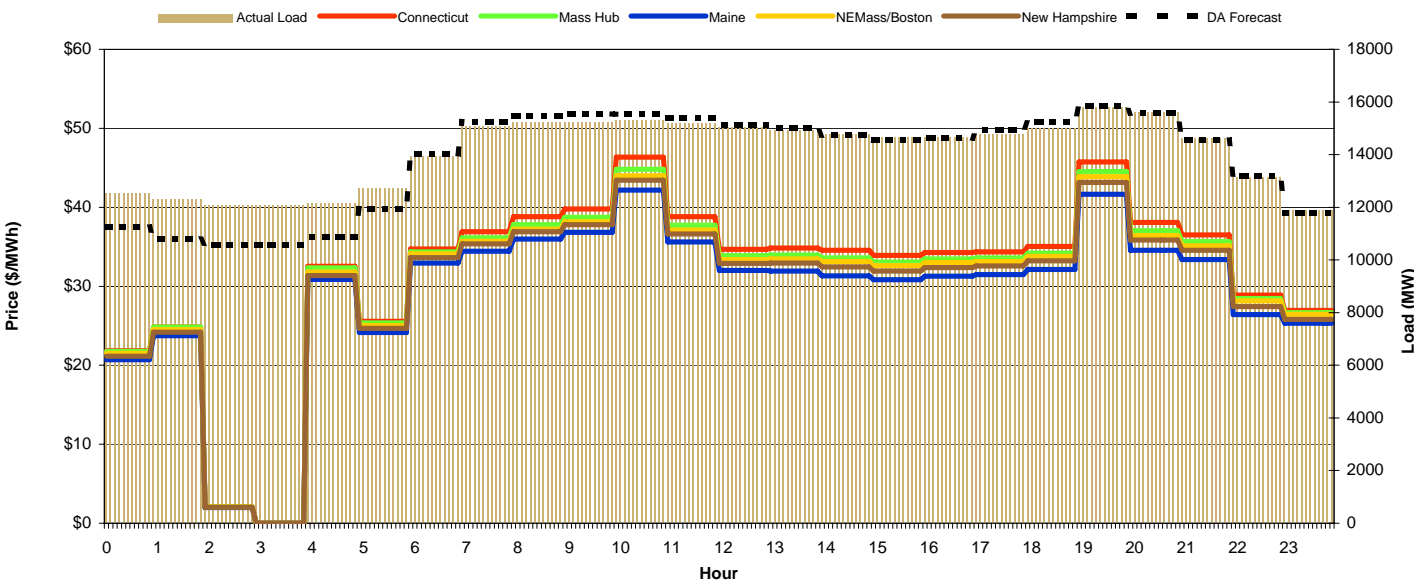




# ISO-NE Daily Report

Friday March 26, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	28.29	27.24	25.45	24.68	27.24	31.58	38.55	43.21	43.52	46.30	45.75	44.37	41.85	39.07	37.06	36.39	38.35	38.80	46.06	51.42	47.54	38.79	36.97	37.11	38.15	42.22	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	27.51	26.49	24.75	24.00	26.49	30.71	37.49	42.02	42.32	45.02	44.49	43.14	40.61	37.76	36.04	35.38	37.29	37.73	44.64	50.00	46.23	37.63	35.95	36.09	37.07	41.02		
<b>New Hampshire</b>	27.17	26.16	24.44	23.70	26.16	30.32	37.02	41.50	41.79	44.46	43.94	42.61	40.10	37.28	35.59	34.94	36.83	37.26	44.08	49.38	45.65	37.16	35.50	35.64	36.61	40.50		
<b>Maine</b>	26.42	25.44	23.77	23.05	25.44	29.49	36.01	40.36	40.65	43.24	42.73	41.44	39.00	36.26	34.61	33.98	35.82	36.24	42.87	48.02	44.40	36.14	34.53	34.66	35.61	39.39		
<b>Mass Hub</b>	27.70	26.67	24.92	24.17	26.67	30.93	37.76	42.32	42.62	45.35	44.81	43.46	40.89	37.99	36.30	35.64	37.56	38.00	44.94	50.36	46.56	37.89	36.21	36.35	37.34	41.31		
<b>Cleared Load (GW)</b>	10.8	10.7	10.6	10.5	11.1	11.1	13.4	15.1	15.5	15.8	16.0	15.9	15.8	15.7	15.1	14.8	15.2	15.3	15.8	16.4	16.0	15.2	13.5	11.8				

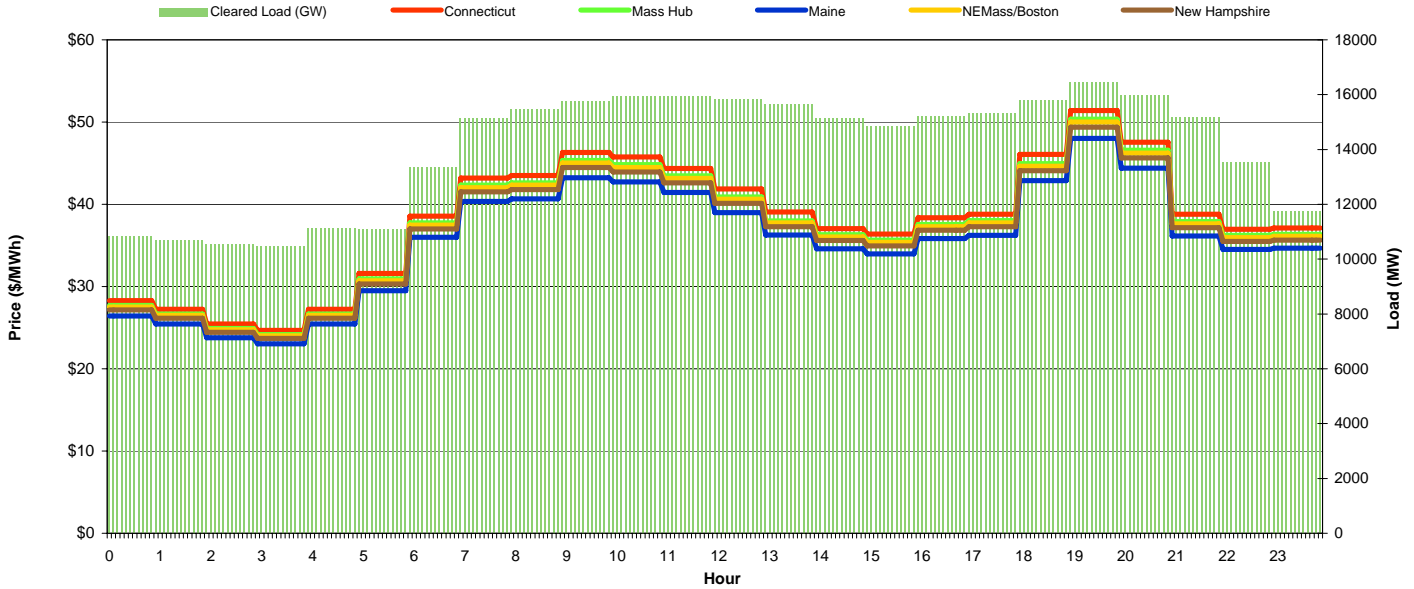

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	1.87	0.00	0.00	0.00	28.25	26.39	36.41	35.51	40.32	37.67	37.03	33.64	33.86	32.71	31.39	25.66	30.27	32.04	33.50	38.48	37.67	35.05	31.36	34.25	28.06	34.14	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	1.85	0.00	0.00	0.00	27.62	25.65	35.42	34.06	38.34	35.73	35.33	32.47	32.69	31.76	30.44	25.06	29.59	31.17	32.58	37.17	36.12	33.72	30.43	33.34	27.11	32.92		
<b>New Hampshire</b>	1.80	0.00	0.00	0.00	27.13	25.19	34.89	33.69	37.99	35.39	34.97	32.01	32.19	31.27	29.97	24.56	29.02	30.62	32.13	36.86	35.84	33.29	29.75	32.58	26.71	32.47		
<b>Maine</b>	1.78	0.00	0.00	0.00	26.76	24.80	34.08	32.89	36.98	34.42	33.99	31.13	31.18	30.32	29.09	23.83	28.16	29.62	31.34	36.04	34.81	32.22	28.67	31.90	26.00	31.54		
<b>Mass Hub</b>	1.86	0.00	0.00	0.00	27.96	25.94	35.72	34.52	38.97	36.37	35.89	32.87	33.10	32.12	30.79	25.26	29.82	31.50	32.97	37.71	36.73	34.25	30.79	33.63	27.45	33.35		
<b>DA Forecast Load (GW)</b>	10.85	10.40	10.17	10.16	10.47	11.51	13.59	15.03	15.56	15.84	15.96	15.94	15.68	15.50	15.24	15.04	14.98	15.21	15.56	16.21	15.82	15.07	13.98	12.79				
<b>Forecast Error %</b>	6.8%	8.7%	8.5%	8.5%	6.4%	-0.9%	-2.2%	-1.5%	-1.0%	-1.8%	-1.3%	-1.2%	-0.7%	-0.7%	-1.0%	-1.3%	-2.0%	-3.4%	-4.3%	-3.3%	-0.8%	-0.4%	0.0%	0.2%				

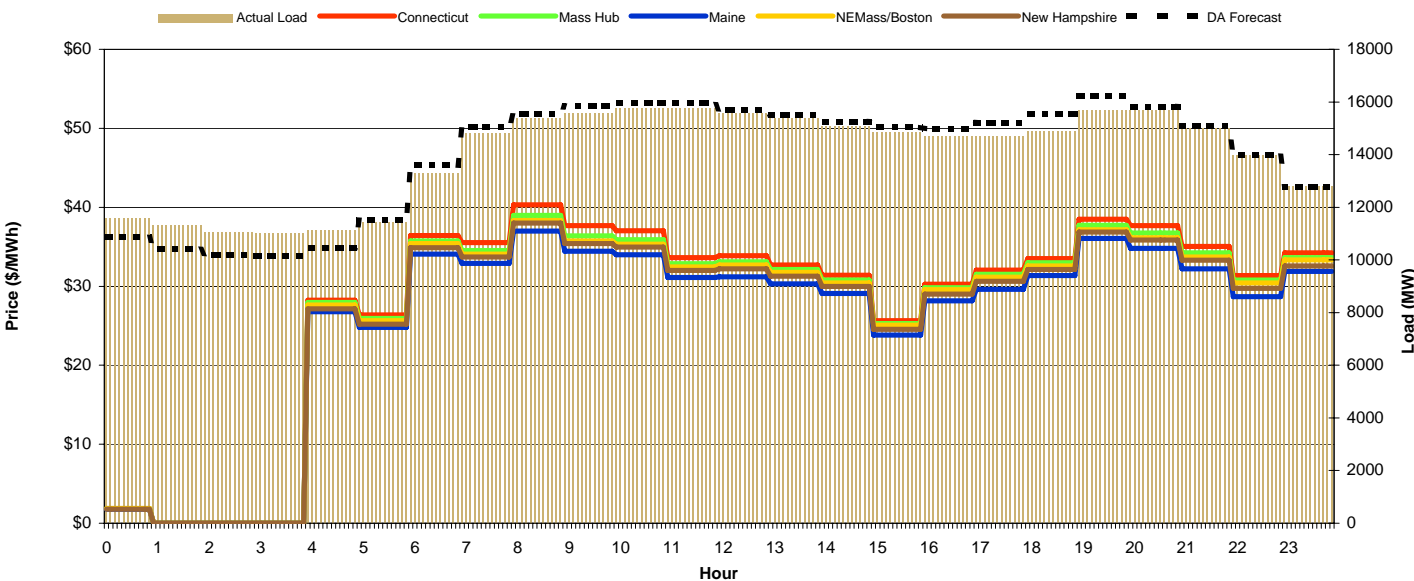




# ISO-NE Daily Report

Saturday March 27, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$		
<b>Connecticut</b>	34.34	30.62	27.25	27.72	32.40	33.83	35.97	38.82	45.89	48.23	47.25	46.77	40.78	35.30	34.63	34.34	34.63	36.99	46.45	50.16	46.58	39.19	34.86	34.86	34.86	38.24	41.30
<b>NEMass/Boston</b>	33.38	29.77	26.49	26.95	31.49	32.88	34.97	37.74	44.55	46.68	45.79	45.46	39.55	34.32	33.66	33.38	33.66	35.96	44.93	47.88	45.08	38.10	33.88	33.88	33.88	37.10	40.04
<b>New Hampshire</b>	32.95	29.39	26.15	26.60	31.09	32.46	34.52	37.26	43.98	46.07	45.20	44.88	39.01	33.88	33.23	32.95	33.23	35.50	44.35	47.25	44.50	37.61	33.45	33.45	33.45	36.62	39.52
<b>Maine</b>	32.08	28.61	25.46	25.93	30.27	31.60	33.60	36.27	42.81	44.85	44.00	43.69	37.99	32.98	32.35	32.08	32.35	34.56	43.18	46.00	43.32	36.61	32.56	32.56	32.56	35.65	38.48
<b>Mass Hub</b>	33.64	30.00	26.70	27.16	31.74	33.14	35.24	38.04	44.89	47.01	46.12	45.82	39.89	34.59	33.92	33.64	33.92	36.24	45.25	48.13	45.40	38.40	34.15	34.15	34.15	37.38	40.34
<b>Cleared Load (GW)</b>	10.9	11.0	10.8	10.5	10.6	11.0	11.9	13.2	13.8	14.4	14.4	14.3	13.7	13.4	13.3	13.2	13.4	13.7	14.3	14.7	14.2	13.5	12.8	11.7			

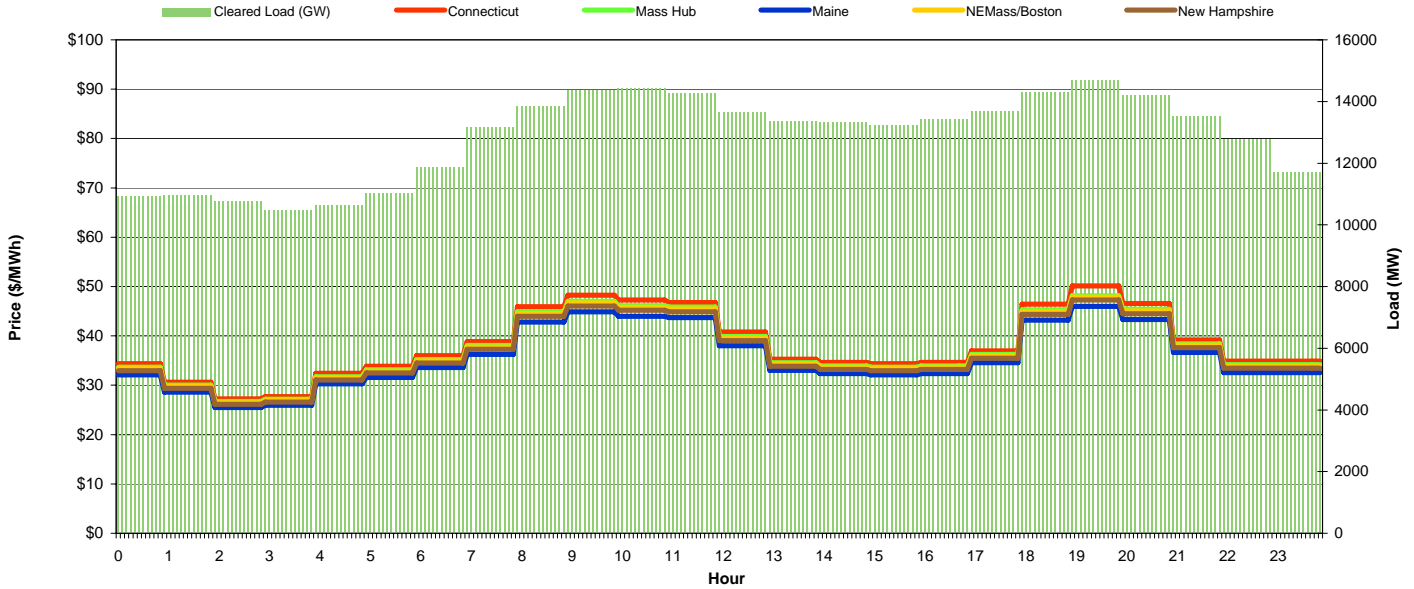

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$		
<b>Connecticut</b>	34.98	29.12	27.19	28.36	32.41	32.57	39.52	42.06	89.98	50.34	42.83	44.60	45.09	35.89	33.94	32.04	32.40	34.30	34.74	39.81	44.29	40.66	33.73	31.81	31.81	38.86	42.29
<b>NEMass/Boston</b>	34.22	28.68	26.76	27.78	31.75	31.74	38.37	40.64	86.82	48.64	41.47	43.07	43.29	34.70	32.94	31.15	31.29	33.02	33.45	38.45	42.60	38.89	32.28	30.85	30.85	37.62	40.79
<b>New Hampshire</b>	33.73	28.36	26.42	27.44	31.40	31.18	37.78	40.20	86.06	48.15	41.04	42.58	42.77	34.29	32.47	30.65	30.89	32.68	33.17	38.15	42.30	38.66	31.94	30.49	30.49	37.20	40.38
<b>Maine</b>	33.30	27.95	25.96	26.89	30.82	30.52	36.74	39.15	83.29	46.15	39.39	40.70	40.71	33.10	31.37	29.59	29.86	31.60	32.15	37.00	40.86	37.59	31.01	30.17	30.17	36.08	38.97
<b>Mass Hub</b>	34.47	28.85	26.92	27.99	32.01	32.03	38.73	41.07	87.57	49.04	41.77	43.40	43.71	34.99	33.20	31.37	31.61	33.41	33.84	38.78	43.02	39.39	32.72	31.10	31.10	37.96	41.18
<b>DA Forecast Load (GW)</b>	12.03	11.54	11.32	11.30	11.40	11.86	12.69	13.55	14.54	15.05	15.15	14.95	14.56	14.15	13.79	13.59	13.52	13.85	14.40	15.19	15.08	14.51	13.55	12.54			
<b>Forecast Error %</b>	-0.9%	-1.5%	-1.5%	-2.0%	-1.8%	-1.7%	-2.3%	-2.2%	-2.1%	-1.5%	-1.1%	-1.0%	-0.4%	-0.8%	-1.3%	-1.6%	-1.1%	-1.8%	-3.0%	-2.0%	-0.8%	-1.1%	-0.7%	-1.0%			

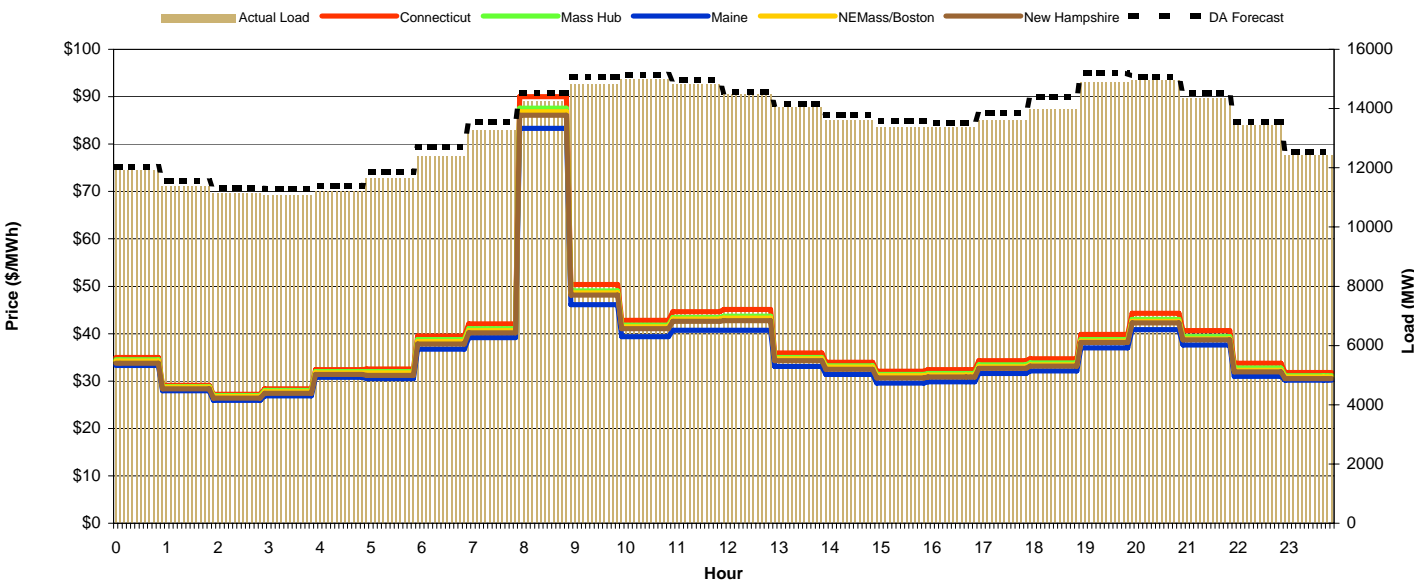




# ISO-NE Daily Report

Sunday March 28, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
<b>Connecticut</b>	32.25	31.95	31.49	29.87	28.14	27.27	27.66	31.52	34.28	37.48	41.92	40.32	38.65	36.22	34.29	34.28	35.71	40.00	48.14	58.00	48.55	40.00	34.29	31.30	31.30	36.40	39.60	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	31.34	31.05	30.61	29.03	27.35	26.50	26.88	30.64	33.31	36.43	40.74	39.18	37.56	35.21	33.32	33.31	34.71	38.87	46.78	56.13	47.06	38.87	33.32	30.42	30.42	35.36	38.47		
<b>New Hampshire</b>	30.93	30.64	30.21	28.65	26.99	26.15	26.53	30.23	32.88	35.95	40.21	38.67	37.07	34.74	32.89	32.88	34.26	38.37	46.17	55.39	46.44	38.37	32.89	30.02	30.02	34.90	37.96		
<b>Maine</b>	30.15	29.87	29.44	27.92	26.30	25.49	25.85	29.47	32.04	35.04	39.18	37.68	36.13	33.86	32.05	32.04	33.38	37.39	45.00	53.99	45.26	37.39	32.06	29.26	29.26	34.01	37.00		
<b>Mass Hub</b>	31.60	31.31	30.86	29.27	27.57	26.72	27.10	30.89	33.59	36.73	41.08	39.51	37.88	35.50	33.60	33.59	35.00	39.20	47.16	56.55	47.42	39.19	33.59	30.66	30.66	35.65	38.78		
<b>Cleared Load (GW)</b>	10.3	10.7	10.4	10.2	10.5	10.6	11.1	11.4	12.3	13.3	13.3	13.3	13.0	12.9	12.7	12.5	13.0	13.4	14.2	14.6	13.9	13.1	11.6	10.5					

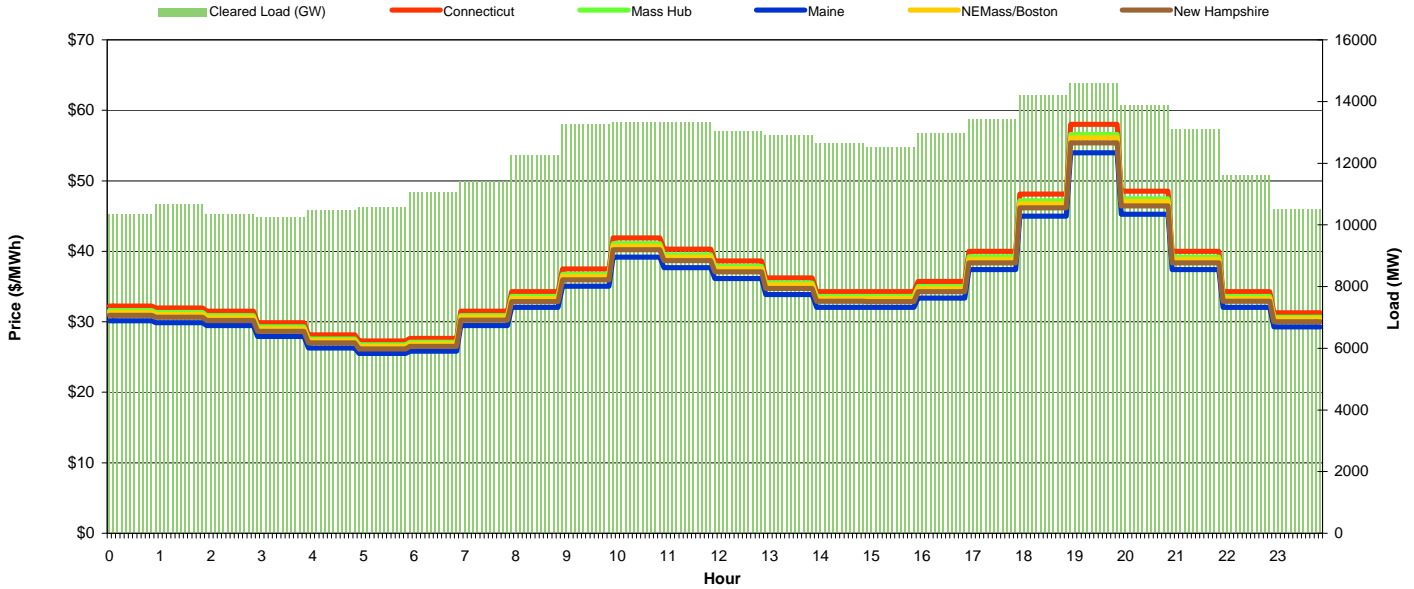

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
<b>Connecticut</b>	31.70	30.92	30.81	27.53	26.07	26.19	28.18	28.76	34.44	35.29	36.21	37.85	36.90	35.61	34.17	34.44	35.46	36.83	35.31	40.78	41.49	36.81	30.75	29.39	29.39	33.41	35.69	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	31.15	30.36	30.20	27.00	25.63	25.86	27.71	28.19	33.50	34.12	34.72	36.14	35.13	33.94	32.72	32.94	33.85	34.98	33.97	39.29	39.69	35.13	29.73	28.82	28.82	32.28	34.25		
<b>New Hampshire</b>	30.82	30.04	29.88	26.70	25.37	25.55	27.32	27.80	33.20	33.97	34.62	36.04	35.04	33.80	32.45	32.67	33.65	34.85	33.74	38.99	39.39	34.87	29.22	28.26	28.26	32.01	34.02		
<b>Maine</b>	30.49	29.66	29.50	26.47	25.19	25.29	26.84	27.34	32.46	33.14	33.55	34.80	33.62	32.49	31.13	31.33	32.30	33.35	32.45	37.56	37.70	33.45	27.98	27.58	27.58	31.07	32.79		
<b>Mass Hub</b>	31.23	30.53	30.40	27.18	25.81	25.99	27.86	28.37	33.77	34.49	35.17	36.67	35.69	34.46	33.16	33.41	34.36	35.57	34.32	39.59	40.11	35.63	29.99	28.90	28.90	32.61	34.67		
<b>DA Forecast Load (GW)</b>	11.48	10.98	10.79	10.64	10.69	10.93	11.47	12.21	13.17	13.79	14.10	14.22	14.11	13.86	13.74	13.64	13.75	13.89	14.53	15.25	15.01	14.21	13.00	11.74					
<b>Forecast Error %</b>	1.0%	7.6%	7.3%	8.6%	9.8%	7.3%	4.2%	2.1%	-1.6%	-0.9%	-0.5%	-0.4%	0.2%	0.5%	-0.2%	0.1%	1.1%	4.1%	2.9%	1.8%	1.4%	0.1%	-0.8%	-0.5%					

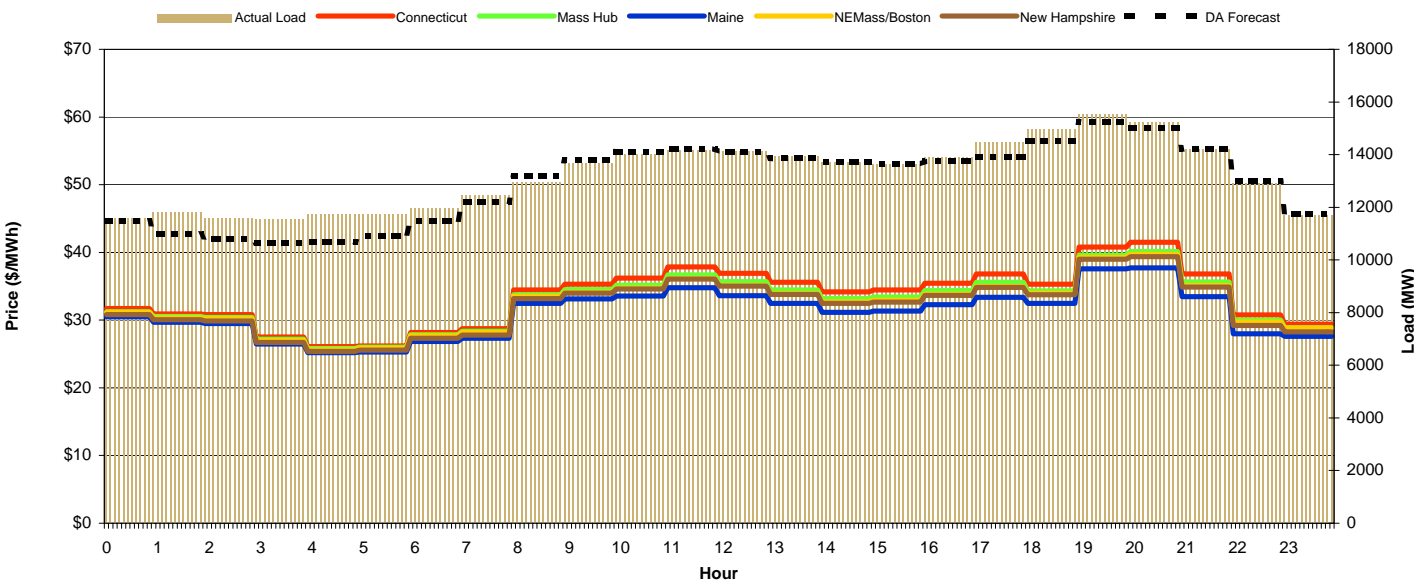




# ISO-NE Daily Report

Monday March 29, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	24.60	24.60	21.07	20.51	22.56	30.12	35.24	43.08	40.04	43.08	43.11	42.81	41.31	37.97	36.61	36.37	38.31	39.31	45.31	49.31	46.31	35.24	32.67	30.24	35.82	40.68	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	23.89	23.89	20.47	19.92	21.91	29.26	34.23	41.85	38.73	41.85	41.85	41.58	39.95	36.89	35.57	35.32	37.21	38.18	43.97	46.51	44.66	34.23	31.73	29.37	34.71	39.38		
<b>New Hampshire</b>	23.59	23.59	20.21	19.67	21.63	28.89	33.79	41.31	38.22	41.31	41.31	41.05	39.43	36.42	35.11	34.87	36.74	37.70	43.41	45.87	44.08	33.79	31.33	29.00	34.26	38.87		
<b>Maine</b>	23.01	23.00	19.74	19.25	21.36	28.16	32.94	40.27	37.26	40.27	40.27	40.02	38.43	35.50	34.22	33.99	35.81	36.74	42.31	44.72	42.96	32.94	30.54	28.26	33.42	37.89		
<b>Mass Hub</b>	24.09	24.09	20.64	20.09	22.10	29.51	34.52	42.20	39.02	42.20	42.20	41.93	40.25	37.20	35.86	35.62	37.53	38.51	44.33	46.68	44.98	34.52	32.00	29.62	34.99	39.69		
<b>Cleared Load (GW)</b>	10.6	10.4	10.6	10.4	10.6	10.7	12.8	13.9	14.3	14.6	14.7	14.4	14.4	14.5	14.3	14.2	14.3	14.8	15.3	15.9	14.8	13.6	12.1	10.8				

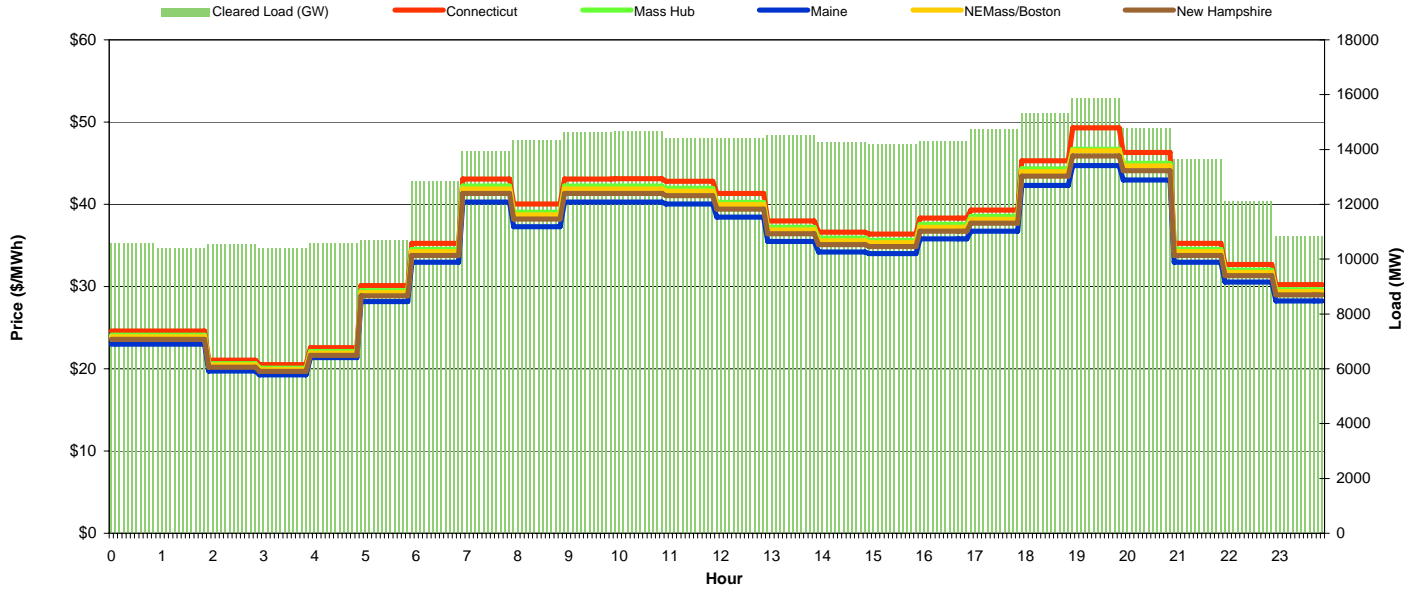

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	24.38	23.95	21.72	19.99	23.97	19.66	37.94	43.58	40.01	43.25	46.08	48.16	45.41	40.56	39.12	40.56	45.27	43.23	39.74	37.02	41.92	34.03	26.81	23.97	35.43	40.92	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	24.08	23.53	21.29	19.61	23.54	19.28	37.06	41.88	38.44	41.58	44.17	46.03	43.53	39.09	37.80	39.13	43.42	41.73	38.51	35.92	40.52	32.83	26.18	23.63	34.28	39.42		
<b>New Hampshire</b>	23.70	23.18	20.99	19.37	23.17	18.77	36.25	41.02	37.80	40.88	43.31	45.06	42.61	38.29	37.05	38.30	42.49	40.79	37.66	35.09	39.63	32.04	25.34	22.77	33.57	38.59		
<b>Maine</b>	23.19	22.59	20.46	18.91	22.66	18.40	35.77	40.37	37.31	40.19	42.46	43.98	41.67	37.48	36.19	37.40	41.50	39.71	36.76	34.18	38.33	31.06	24.63	22.27	32.81	37.70		
<b>Mass Hub</b>	24.14	23.67	21.44	19.75	23.69	19.36	37.21	42.26	38.79	41.95	44.59	46.45	43.90	39.42	38.11	39.47	43.87	42.02	38.77	36.08	40.75	33.09	26.26	23.61	34.53	39.74		
<b>DA Forecast Load (GW)</b>	10.82	10.33	10.14	10.12	10.41	11.55	13.59	14.94	15.37	15.56	15.78	15.76	15.68	15.53	15.34	15.19	15.23	15.54	15.85	16.26	15.77	14.65	13.18	11.73				
<b>Forecast Error %</b>	4.9%	10.0%	10.1%	10.6%	10.7%	6.1%	-0.3%	0.7%	1.3%	1.8%	2.2%	3.0%	3.1%	3.4%	3.2%	3.7%	5.0%	5.1%	3.9%	1.9%	1.8%	1.4%	1.6%	4.7%				

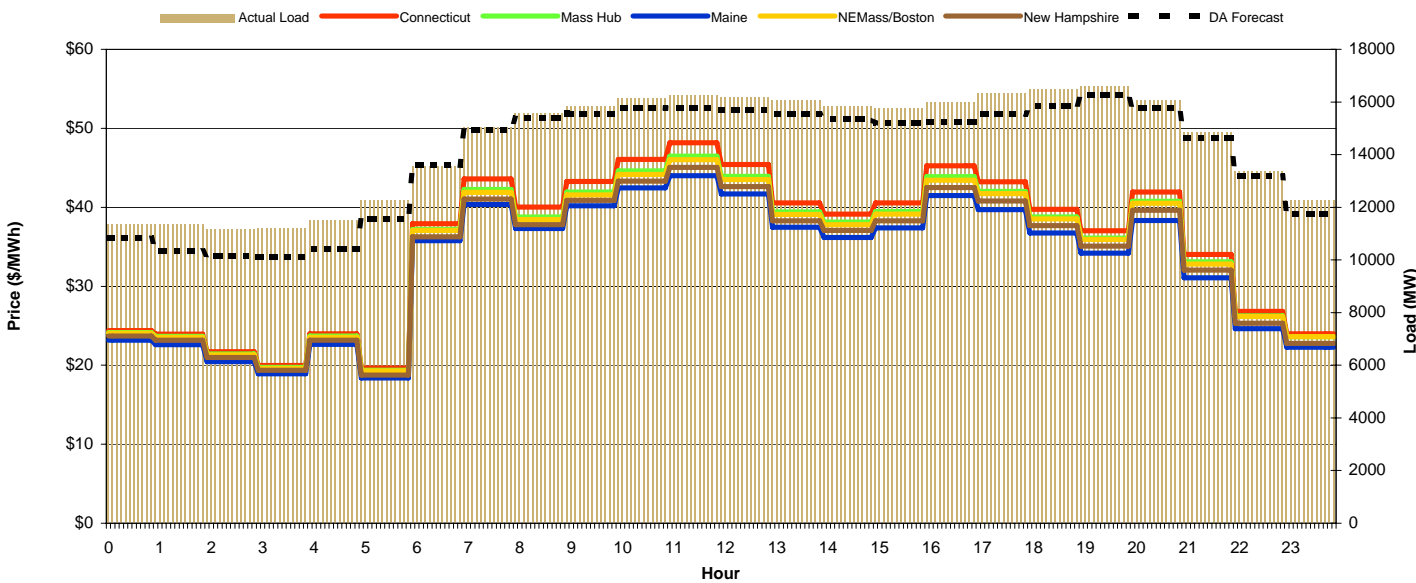




# ISO-NE Daily Report

Tuesday March 30, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%

## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	27.34	27.34	25.72	25.72	24.60	26.64	36.01	44.00	45.00	46.07	45.53	45.22	41.82	39.93	38.55	37.43	38.25	39.00	45.00	48.55	44.99	34.76	34.10	29.96	37.15	41.76	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	26.52	26.52	24.94	24.94	23.85	25.84	38.08	42.67	43.64	44.68	44.16	43.86	40.56	38.73	37.39	36.30	37.10	37.82	43.64	46.81	43.62	33.70	32.49	29.06	36.12	40.45		
<b>New Hampshire</b>	26.20	26.20	24.64	24.64	23.57	25.53	34.48	42.16	43.12	44.15	43.63	43.34	40.07	38.27	36.94	35.87	36.66	37.37	43.12	46.24	43.10	33.29	30.46	28.71	35.49	39.86		
<b>Maine</b>	25.52	25.52	24.00	24.00	22.95	24.86	33.56	41.07	42.00	43.00	42.49	42.21	39.03	37.27	35.98	34.93	35.70	36.40	42.00	45.04	41.98	32.43	29.43	27.96	34.56	38.81		
<b>Mass Hub</b>	26.76	26.76	25.17	25.17	24.07	26.07	35.23	43.06	44.04	45.09	44.56	44.26	40.93	39.08	37.73	36.63	37.44	38.17	44.04	47.19	44.01	34.00	33.06	29.32	36.33	40.83		
<b>Cleared Load (GW)</b>	10.1	10.1	10.2	9.9	10.5	10.7	12.9	14.0	14.4	14.6	14.7	14.7	14.8	14.6	14.4	14.4	14.6	14.9	15.4	15.9	15.1	13.9	12.2	10.8				

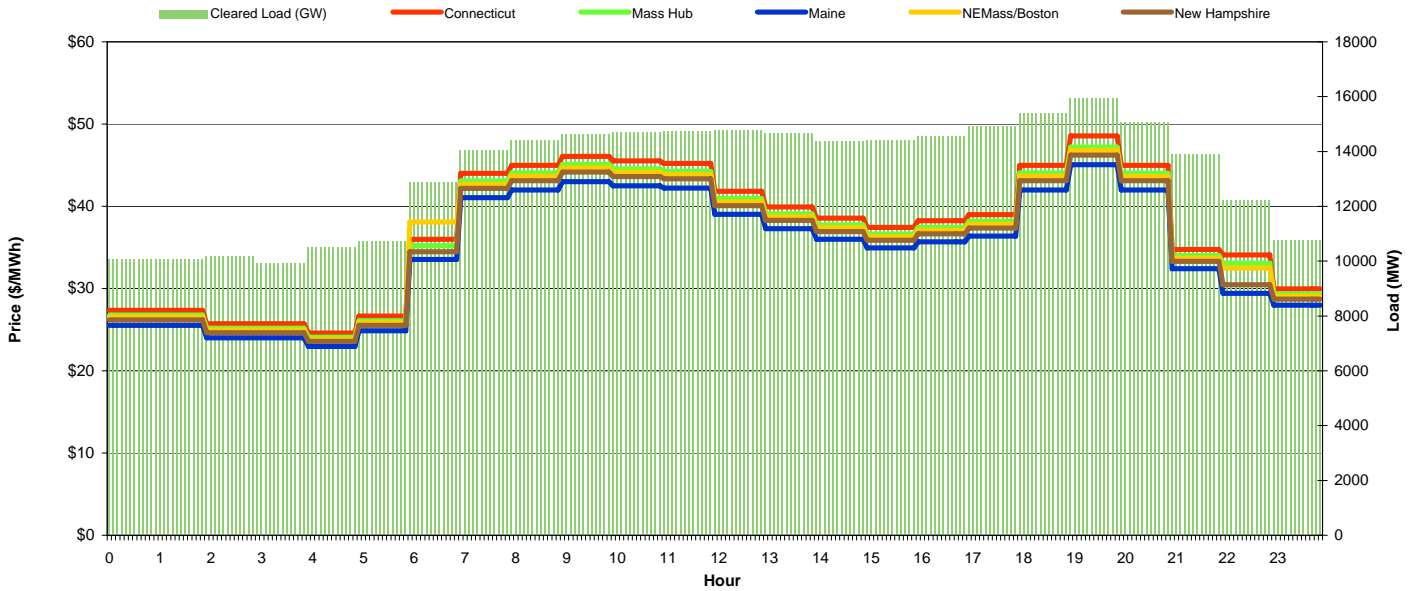

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	25.87	24.04	27.37	31.33	30.95	29.79	39.70	38.56	39.57	45.19	43.87	40.07	37.58	44.48	40.46	36.05	45.88	45.71	36.25	36.69	39.09	40.52	37.12	39.32	37.31	40.44	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	25.81	23.89	27.27	31.10	30.83	29.89	39.40	37.67	38.26	43.53	42.32	38.68	36.48	43.15	39.09	34.99	44.44	44.54	35.47	35.73	37.84	38.86	35.93	38.80	36.42	39.19		
<b>New Hampshire</b>	24.78	22.98	26.21	29.91	29.73	28.92	38.47	36.93	37.66	42.88	41.68	38.05	35.81	42.32	38.35	34.29	43.69	43.69	34.80	34.99	37.07	38.01	34.77	37.13	35.55	38.44		
<b>Maine</b>	24.25	22.47	25.57	29.07	29.03	28.54	38.39	36.71	37.44	42.50	41.32	37.63	35.37	41.77	37.74	33.64	43.01	42.97	34.25	34.43	36.25	37.13	34.02	36.55	35.00	37.89		
<b>Mass Hub</b>	25.73	23.87	27.26	31.14	30.86	29.78	39.30	37.75	38.50	43.89	42.66	38.97	36.69	43.39	39.36	35.18	44.73	44.69	35.50	35.75	37.98	39.18	36.12	38.67	36.54	39.40		
<b>DA Forecast Load (GW)</b>	10.94	10.41	10.17	10.18	10.42	11.47	13.61	15.04	15.46	15.66	15.88	15.89	15.81	15.68	15.50	15.38	15.61	16.00	16.25	16.51	15.96	14.86	13.41	12.02				
<b>Forecast Error %</b>	5.5%	8.0%	8.9%	7.6%	8.0%	3.8%	0.3%	0.6%	1.4%	2.2%	2.6%	3.0%	3.6%	4.4%	4.5%	4.9%	4.1%	3.3%	2.5%	2.2%	2.6%	2.8%	3.0%	3.2%				

