


FSIS Regulatory Testing for LM in RTE Products by Calendar Year 1990 - 2010 (2004 - 2010 ALLRTE Only)

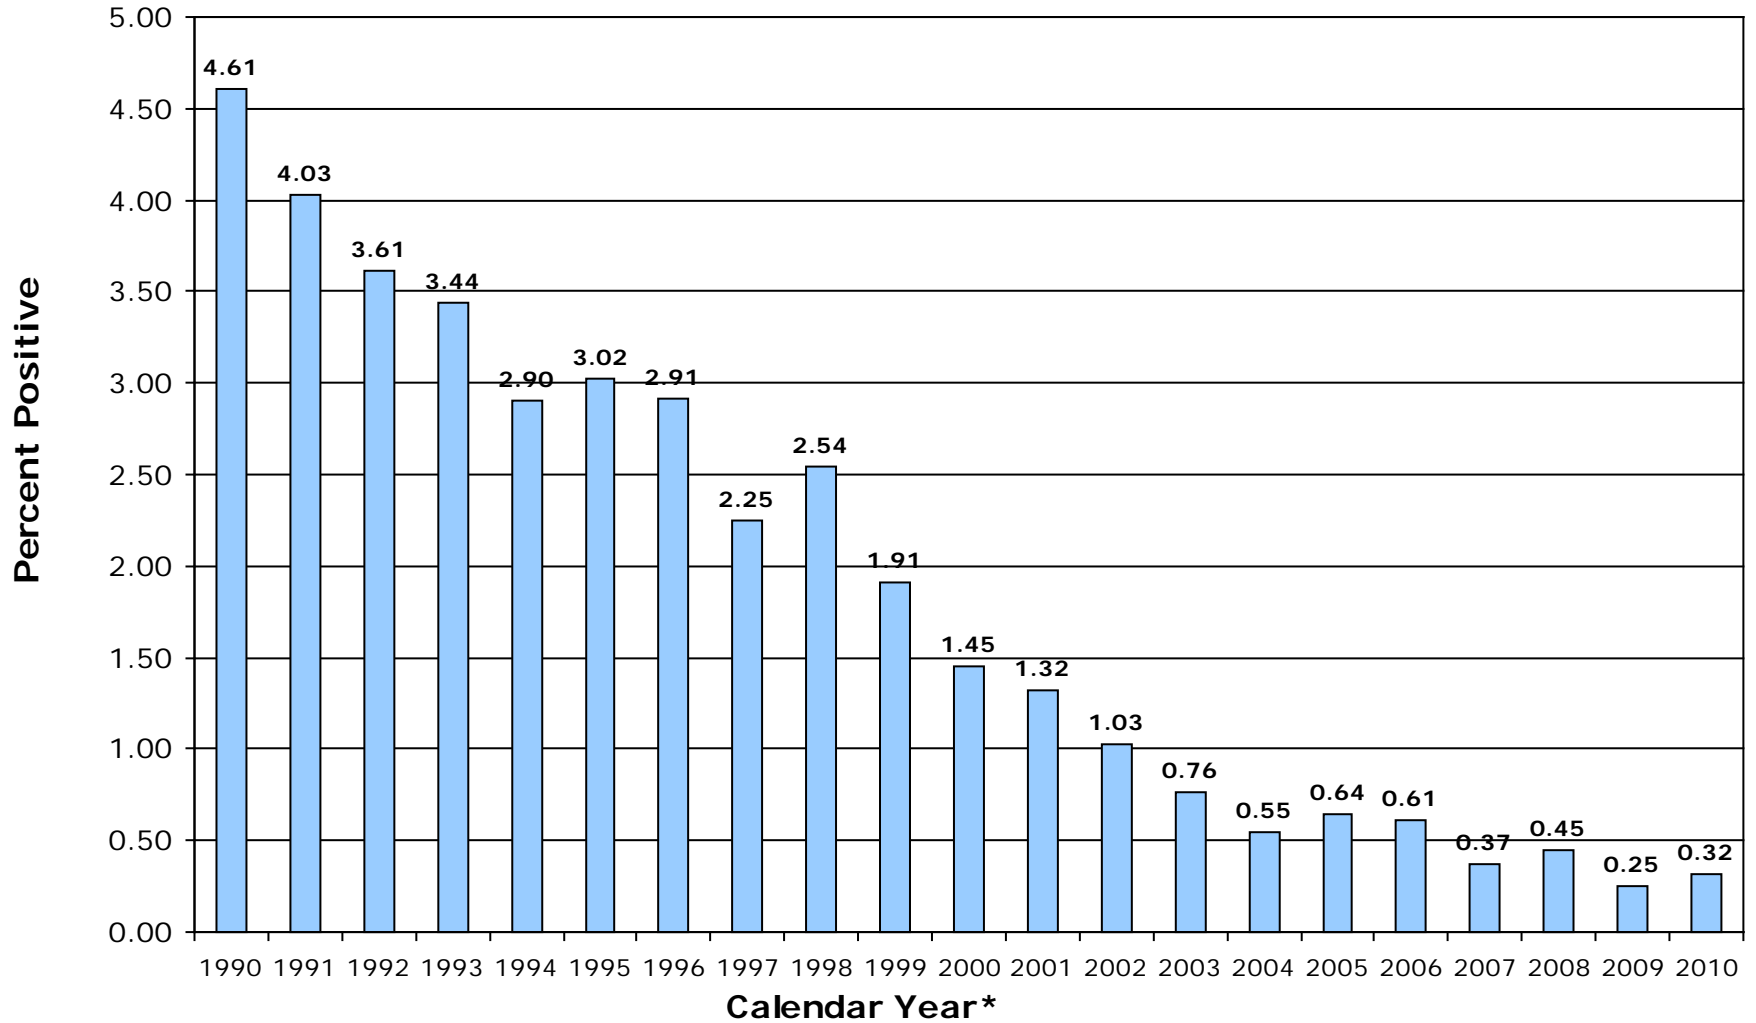

*Starting with CY2008, annual microbiological results are reported by sample collection date as opposed to analysis end date.