


# FSIS Regulatory Testing for LM in RTE Products by Calendar Year 1990 - 2010 (All Years All Projects)

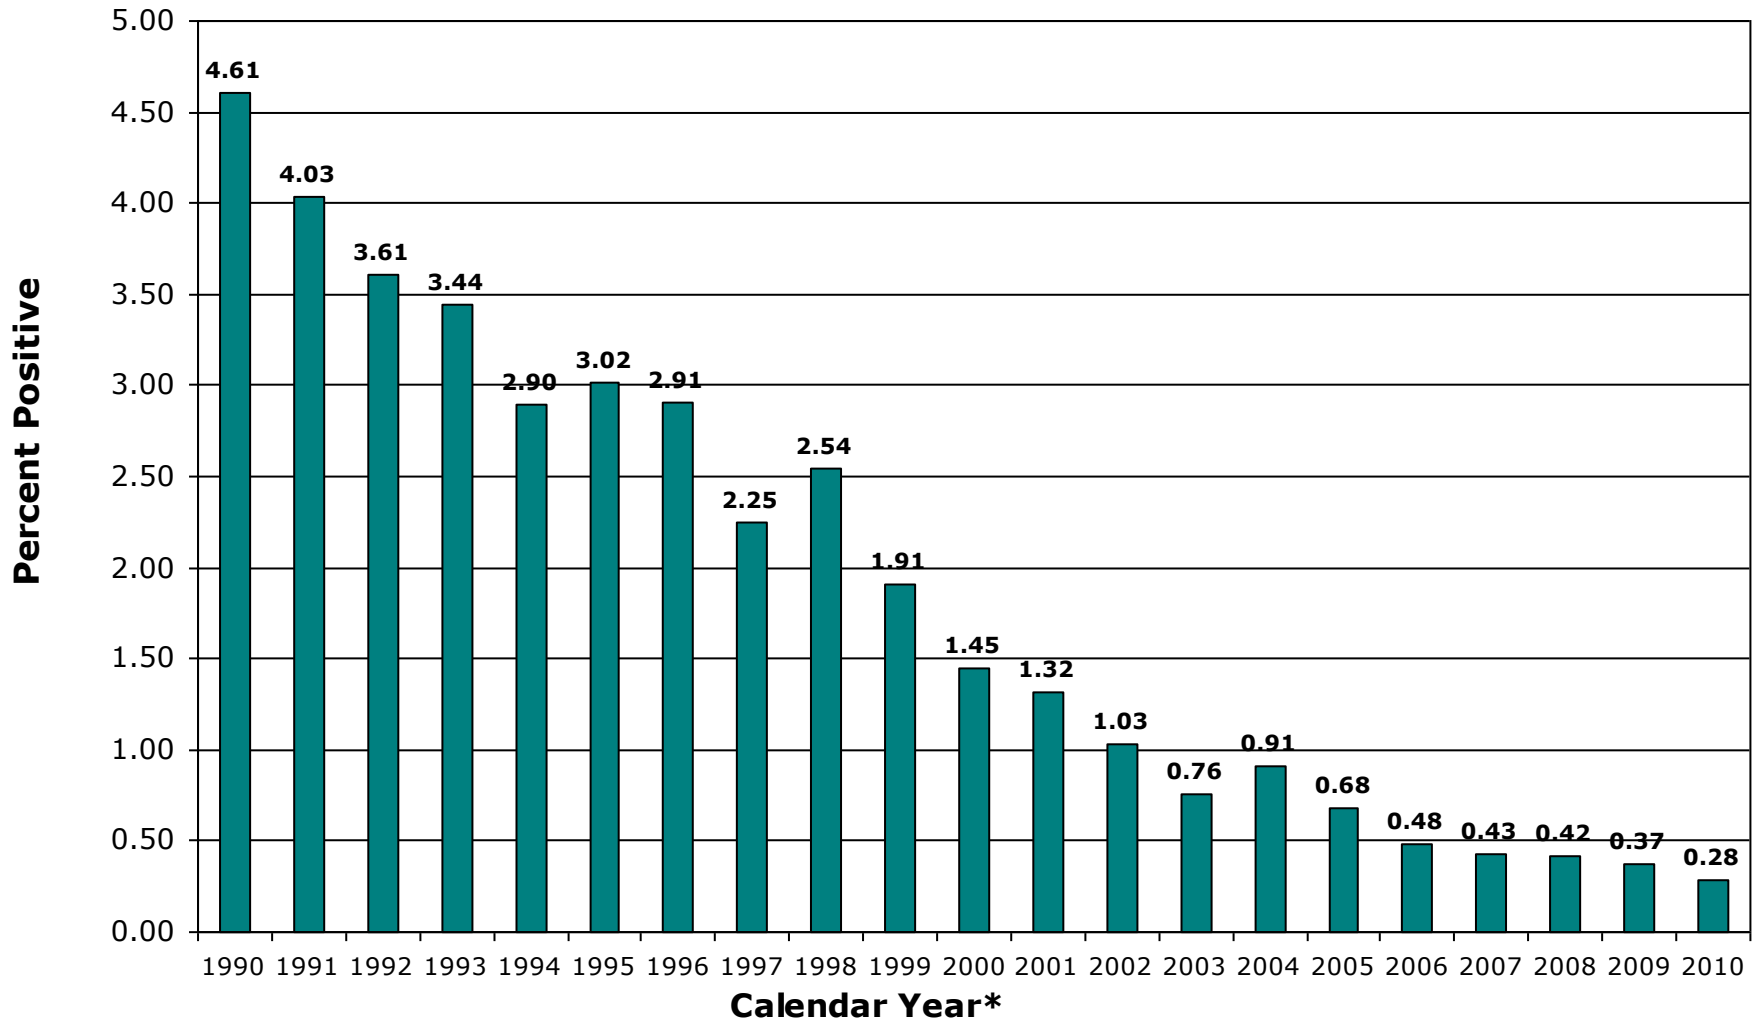

\*Starting with CY2008, annual microbiological results are reported by sample collection date as opposed to analysis end date.