


NOTES -
 TANK TO BE MADE OF STEEL WELDED
 CONSTRUCTION THROUGHOUT. REFER TO
 COCHRANE STD DWG. C-25275
 TANK TO BE WATER TIGHT WHEN FILLED TO TOP
 WITH WATER. INSIDE SURFACES & THROTTLED
 CONNECTIONS ARE TO BE CLEANED &
 GRAYED. AREA INSIDE & OUTSIDE
 AFTER FABRICATION
 TANK TO BE INSPECTED BY COCHRANE
 CORP. INSPECTOR PRIOR TO SHIPMENT.

OCT 31 1956

CERTIFIED CONSTRUCTION DRAWING
 FOR YOUR ORDER NUMBER
 J. J. Hausman
 COCHRANE CORPORATION
 PHILADELPHIA, PA.

1/2" x 1/2" x 1/2" Lg. Stl.
 STRIP TO BE WELDED AS SHOWN
 INSIDE OF SHELL

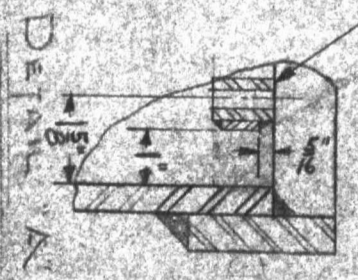

This print is our property and is loaned subject to return on demand and with the express condition that it is not to be used directly or indirectly detrimental to our interests.
 ENGINEERING DEPT. - Cochrane Corp.

SCALE	N.M.	3-1-54	TM	PE 6997	APPD.	LTR.	DATE	REVISION	DFT. APP.	ENG. APP.
	DRAWN	DATE	CHKD.	FIRST USED ON S.O.						
COCHRANE CORPORATION PHILADELPHIA, PA.						BRINE TANK 2'-6" I.D. x 4'-0" HIGH		SIZE D	NUMBER 89762-3	CHG. LTR. B
S.O.		3202 56								

1953
FOR YOUR ORDER IN ADVANCE
CORPORATION
PHILADELPHIA PA