


Digital CP (solid): 2.00 kW ERP at 654 m HAAT vs. Analog (dashed): 9.77 kW ERP at 654 m HAAT

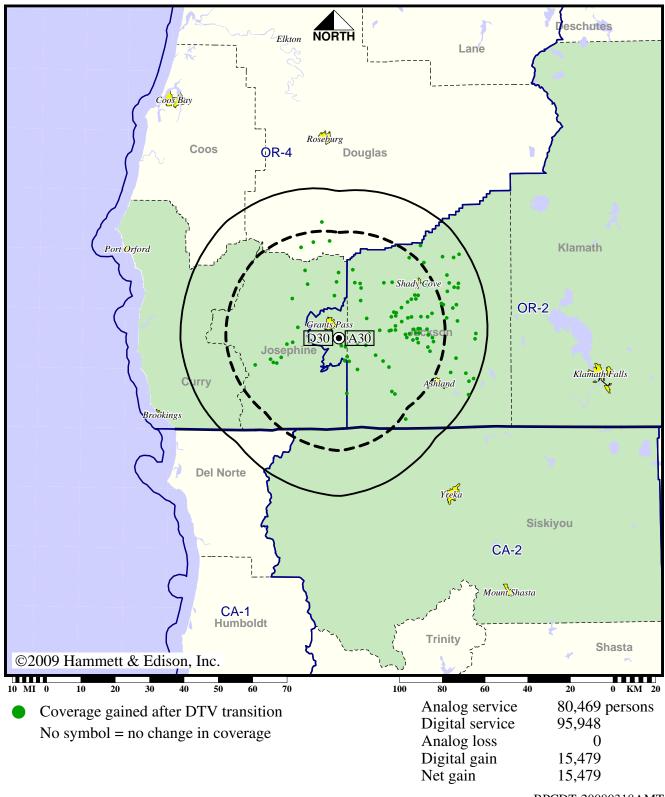


Digital CP (solid): 2.00 kW ERP at 654 m HAAT vs. Analog (dashed): 9.77 kW ERP at 654 m HAAT

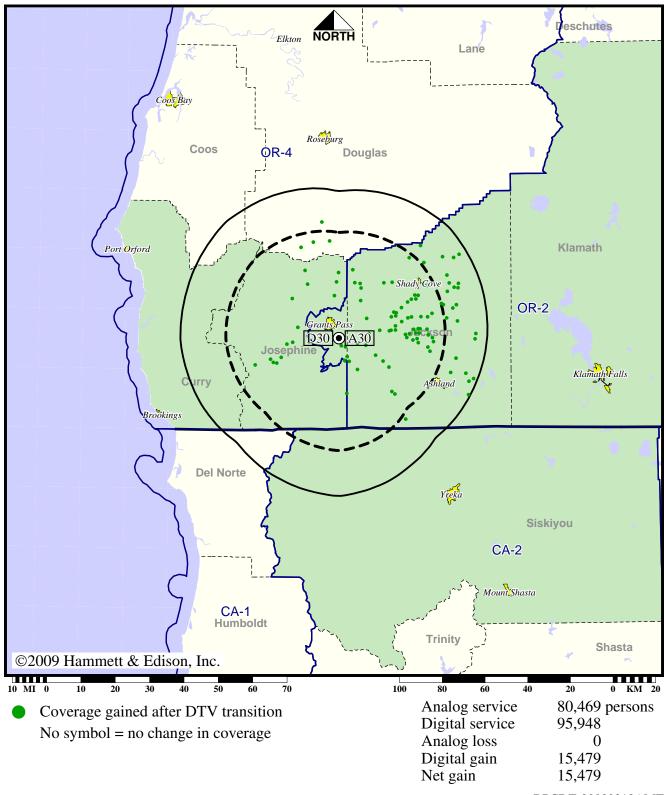


Digital CP (solid): 4.87 kW ERP at 651 m HAAT, Network: ABC vs. Analog (dashed): 6.03 kW ERP at 691 m HAAT, Network: ABC

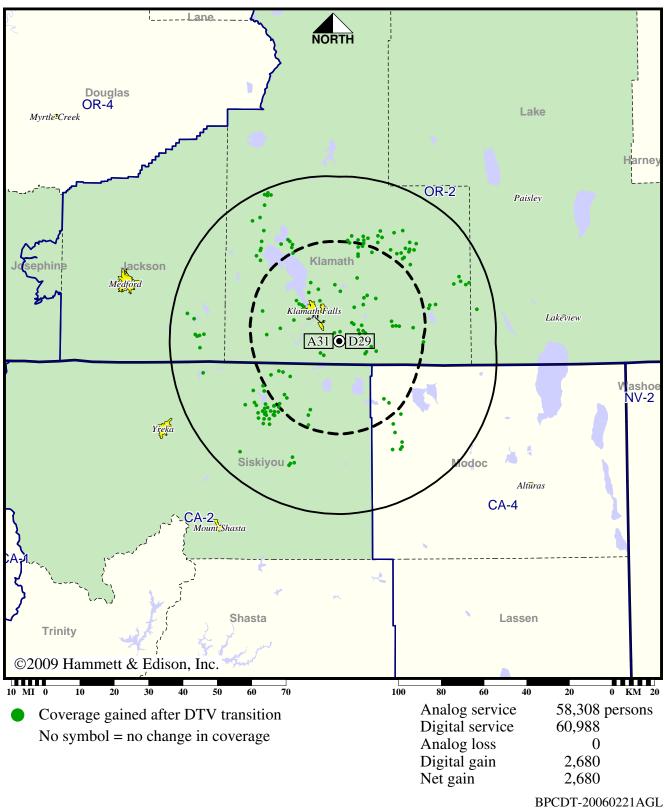


Digital CP (solid): 4.87 kW ERP at 651 m HAAT, Network: ABC vs. Analog (dashed): 6.03 kW ERP at 691 m HAAT, Network: ABC

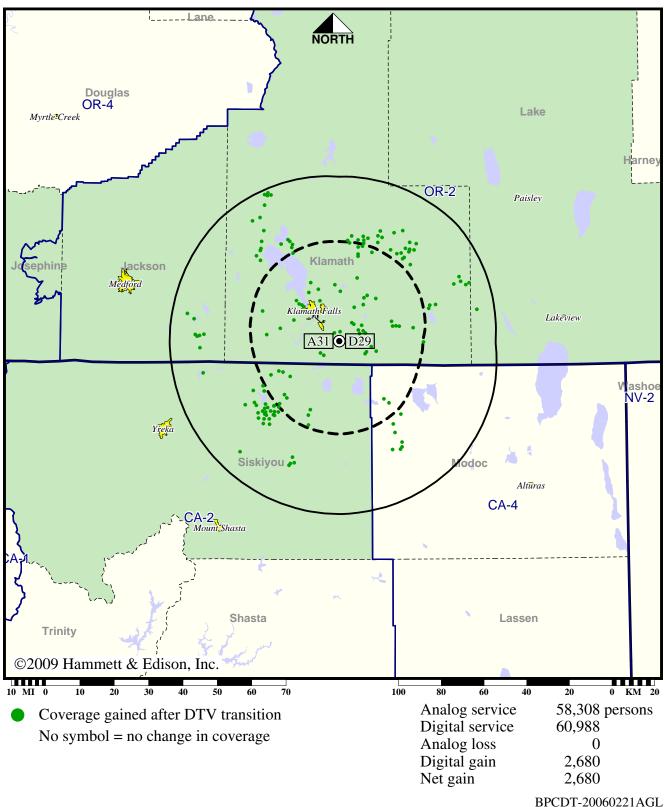

Digital CP (solid): 16.9 kW ERP at 823 m HAAT, Network: ABC vs. Analog (dashed): 191 kW ERP at 823 m HAAT, Network: ABC

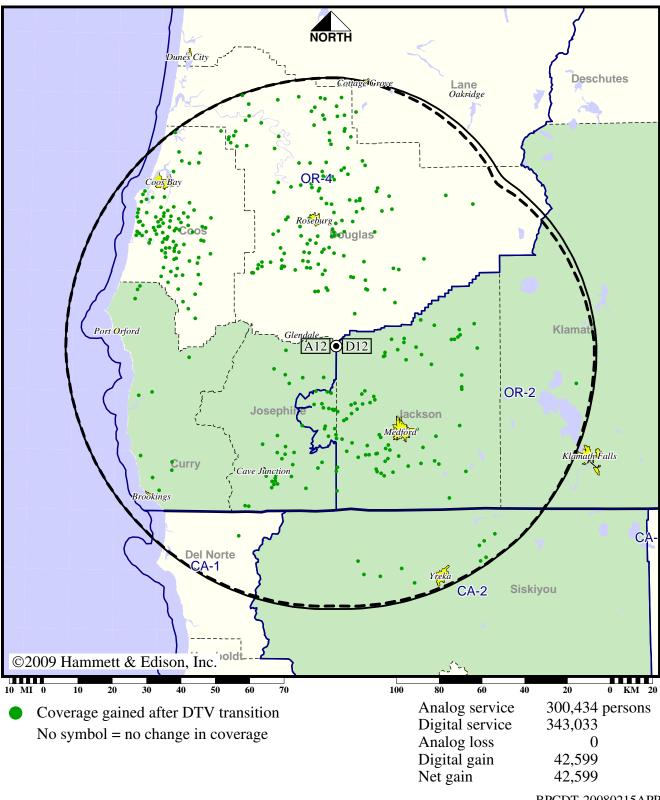


Digital CP (solid): 16.9 kW ERP at 823 m HAAT, Network: ABC vs. Analog (dashed): 191 kW ERP at 823 m HAAT, Network: ABC

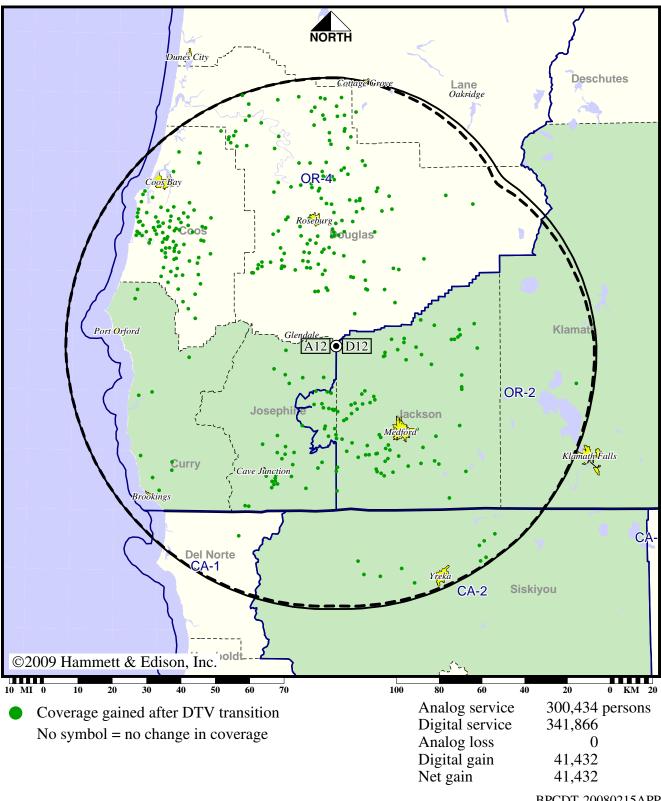


Expected Operation on June 13: Licensed

Digital License (solid): 9.60 kW ERP at 649 m HAAT, Network: PBS vs. Analog (dashed): 9.33 kW ERP at 656 m HAAT, Network: PBS

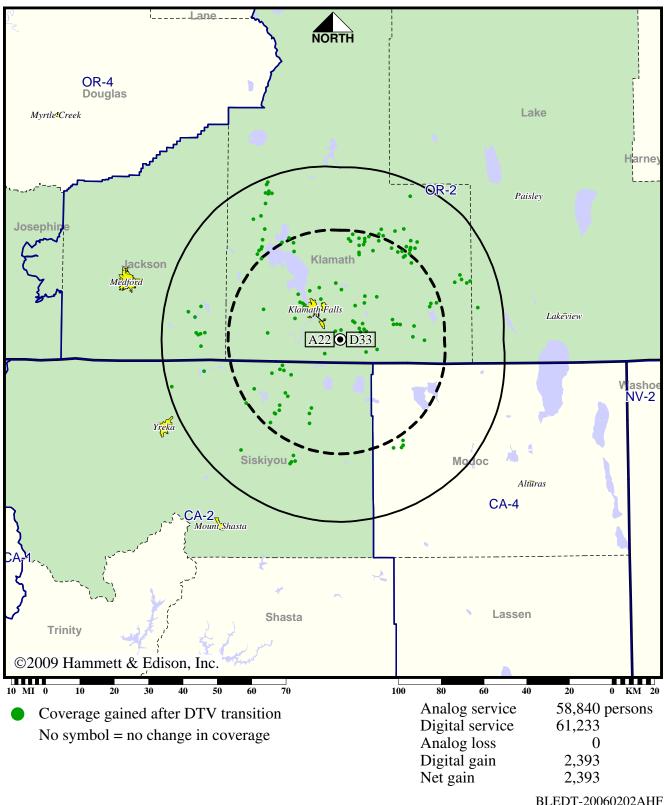


Approved Post-Transition Operation: Licensed

Digital License (solid): 9.60 kW ERP at 649 m HAAT, Network: PBS vs. Analog (dashed): 9.33 kW ERP at 656 m HAAT, Network: PBS

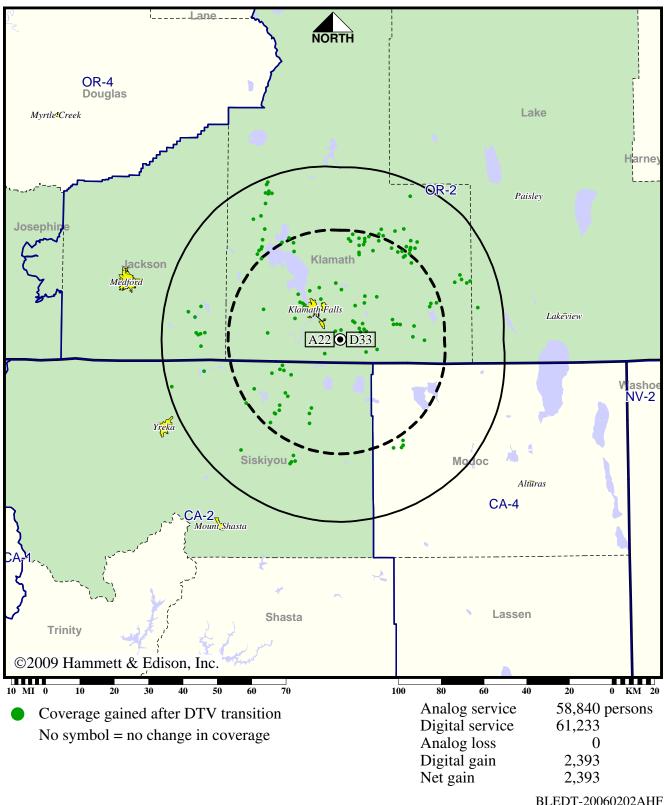


Expected Operation on June 13: Special Temporary Authorization


Digital STA (solid): 16.2 kW ERP at 441 m HAAT, Network: Fox vs. Analog (dashed): 110 kW ERP at 440 m HAAT, Network: Fox

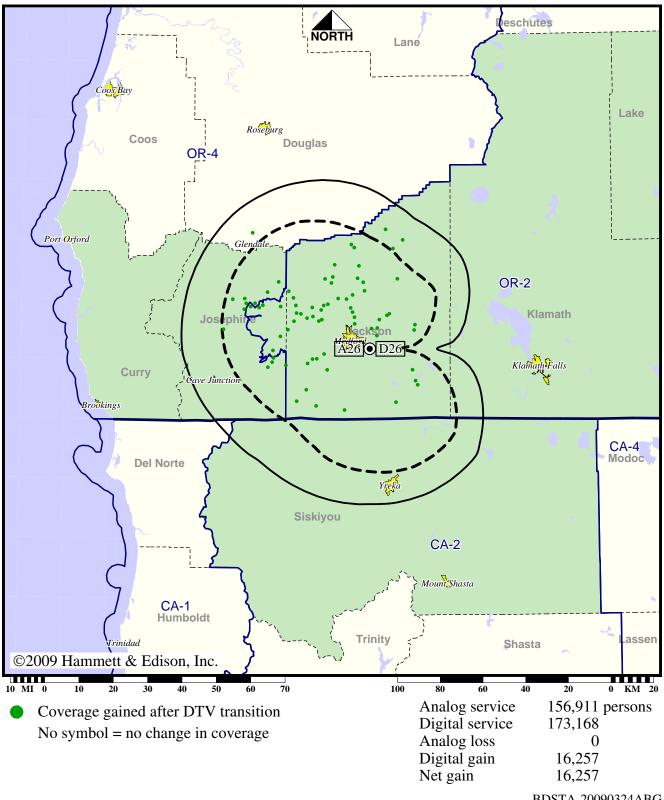

Digital CP (solid): 16.2 kW ERP at 441 m HAAT, Network: Fox vs. Analog (dashed): 110 kW ERP at 440 m HAAT, Network: Fox

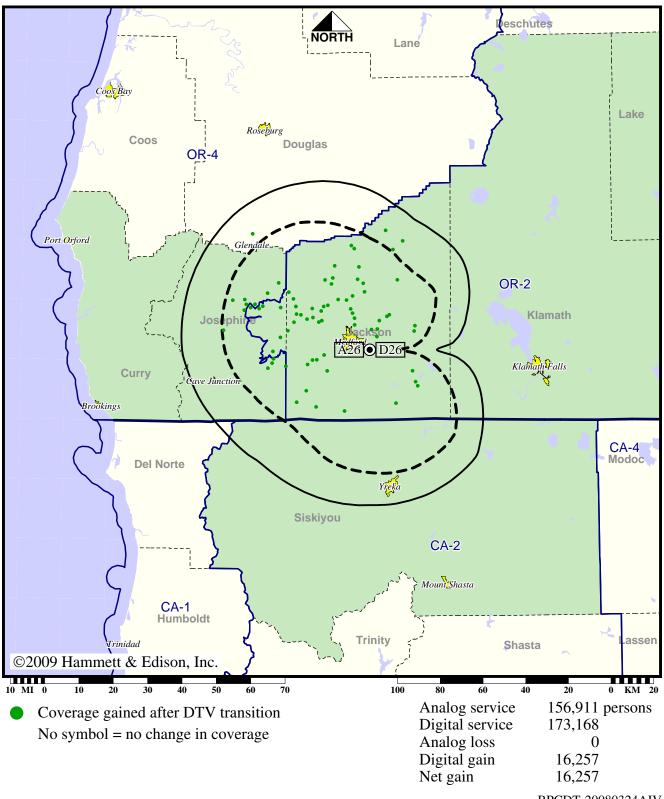


Digital CP (solid): 5.40 kW ERP at 823 m HAAT, Network: NBC vs. Analog (dashed): 60.3 kW ERP at 823 m HAAT, Network: NBC

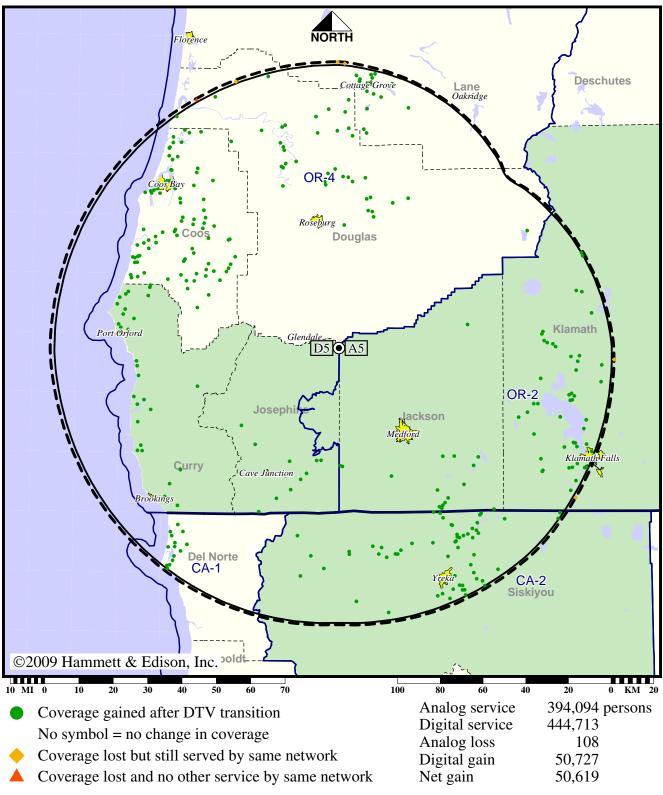

Market: Medford-Klamath Falls, OR


BPCDT-20080312AAM KOBI Digital CP

Digital CP (solid): 5.40 kW ERP at 823 m HAAT, Network: NBC vs. Analog (dashed): 60.3 kW ERP at 823 m HAAT, Network: NBC

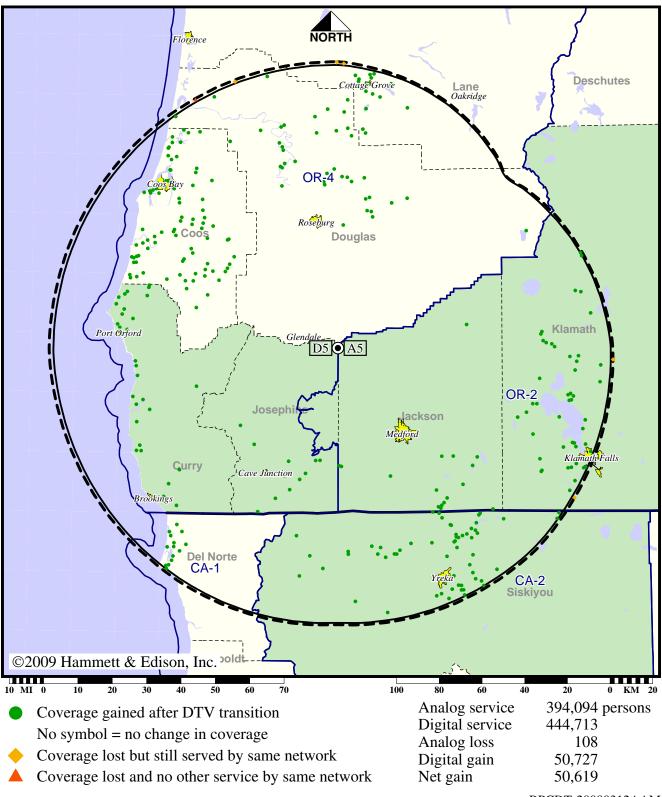


Expected Operation on June 13: Licensed

Digital License (solid): 9.00 kW ERP at 659 m HAAT, Network: NBC vs. Analog (dashed): 35.5 kW ERP at 671 m HAAT, Network: NBC

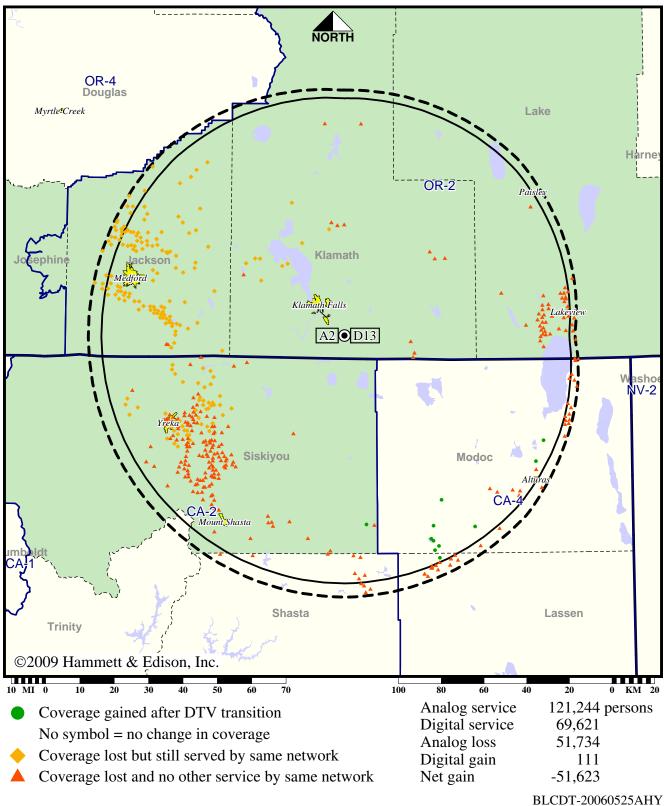


Approved Post-Transition Operation: Licensed

Digital License (solid): 9.00 kW ERP at 659 m HAAT, Network: NBC vs. Analog (dashed): 35.5 kW ERP at 671 m HAAT, Network: NBC

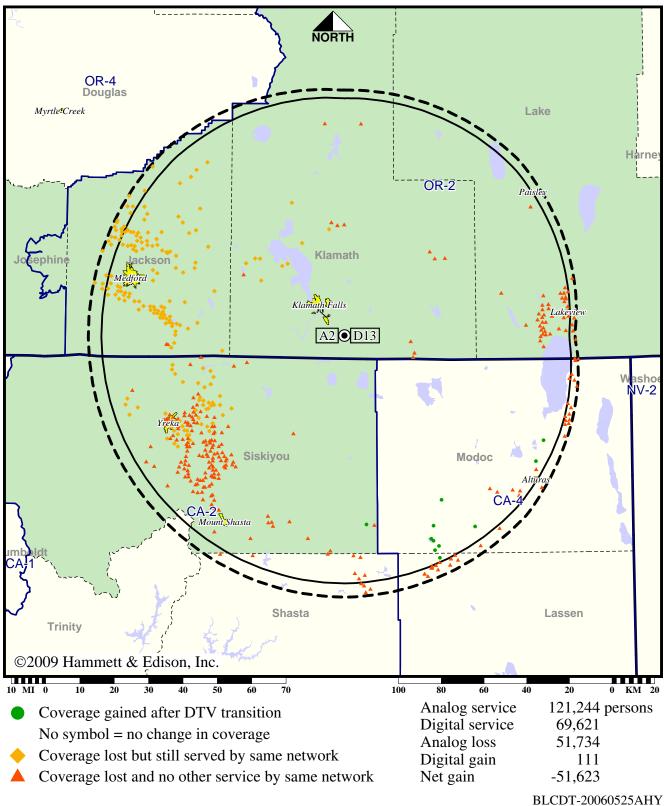


Digital CP (solid): 16.9 kW ERP at 818 m HAAT, Network: PBS vs. Analog (dashed): 191 kW ERP at 818 m HAAT, Network: PBS

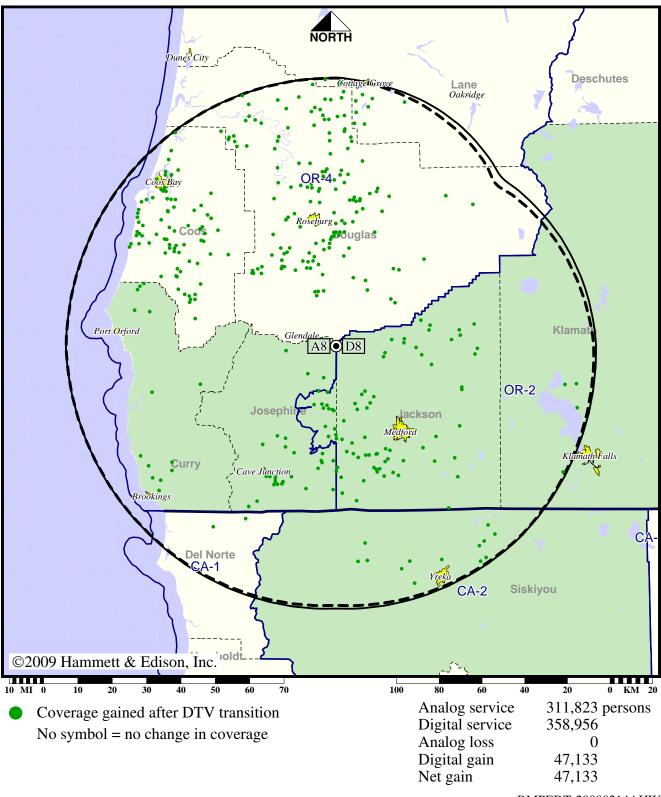

Market: Medford-Klamath Falls, OR

BMPEDT-20080214AHW KSYS Digital CP


Digital CP (solid): 16.9 kW ERP at 818 m HAAT, Network: PBS vs. Analog (dashed): 191 kW ERP at 818 m HAAT, Network: PBS

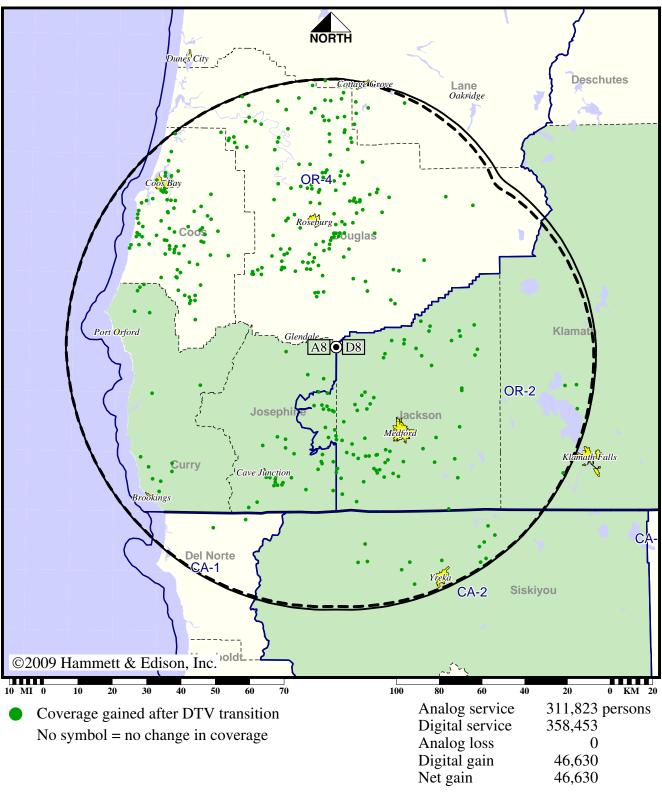

Market: Medford-Klamath Falls, OR

BMPEDT-20080214AHW KSYS Digital CP


Digital CP (solid): 9.00 kW ERP at 1001 m HAAT, Network: CBS vs. Analog (dashed): 132 kW ERP at 1009 m HAAT, Network: CBS

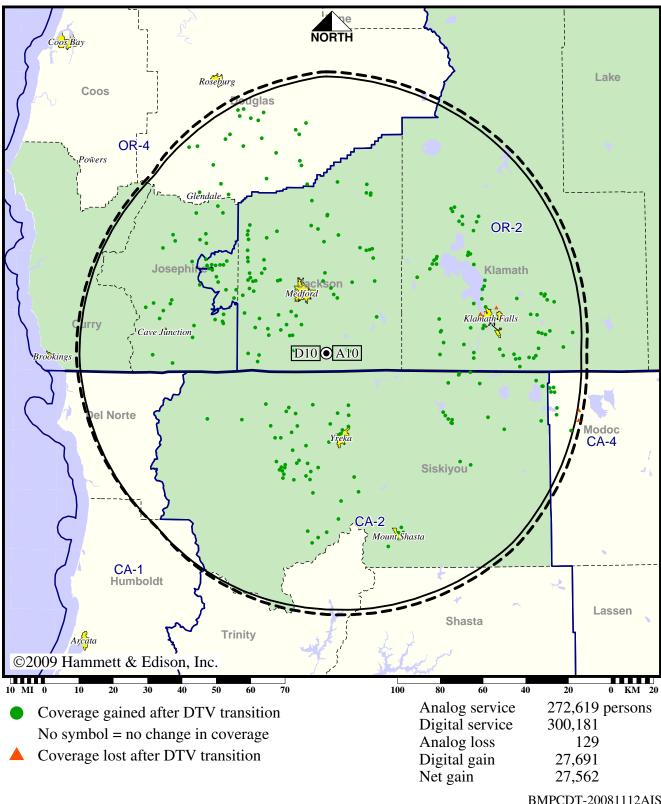

Market: Medford-Klamath Falls, OR

BMPCDT-20081112AIS KTVL Digital CP

Digital CP (solid): 9.00 kW ERP at 1001 m HAAT, Network: CBS vs. Analog (dashed): 132 kW ERP at 1009 m HAAT, Network: CBS

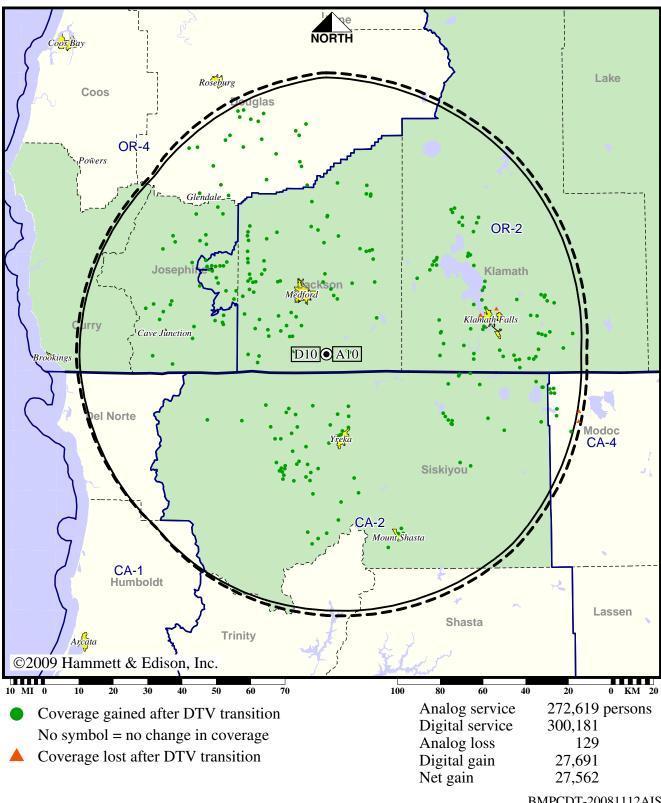

Market: Medford-Klamath Falls, OR

BMPCDT-20081112AIS KTVL Digital CP