

#### **Expected Operation on June 13: Licensed**

### Digital License (solid): 97.3 kW ERP at 392 m HAAT, Network: PBS vs. Analog (dashed): 79.4 kW ERP at 425 m HAAT, Network: PBS

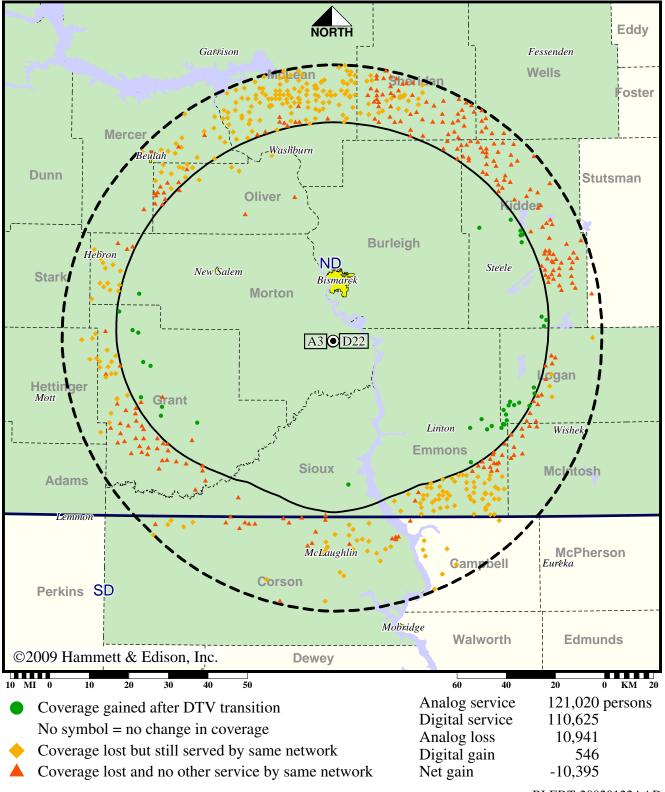


#### **Approved Post-Transition Operation: Licensed**

### Digital License (solid): 97.3 kW ERP at 392 m HAAT, Network: PBS vs. Analog (dashed): 79.4 kW ERP at 425 m HAAT, Network: PBS

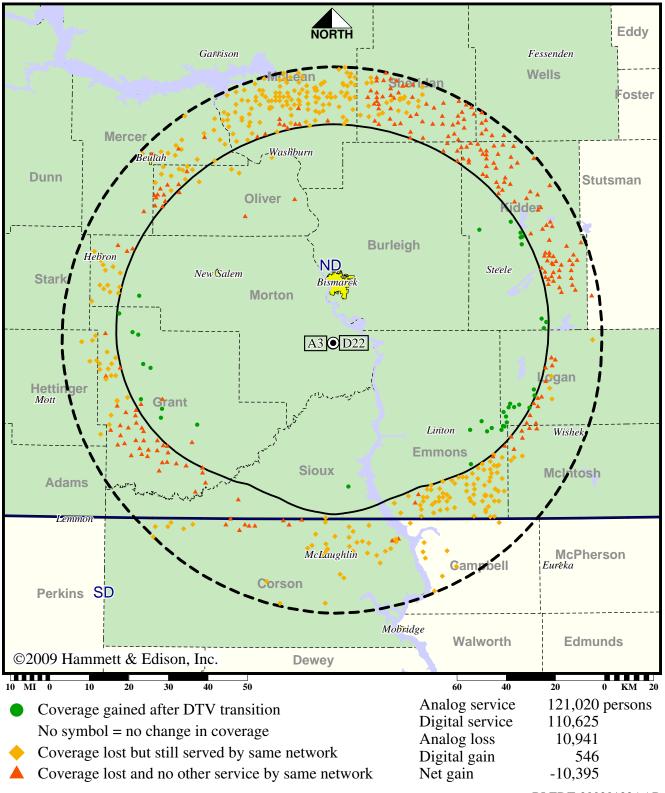


#### **Expected Operation on June 13: Special Temporary Authorization**


### Digital STA (solid): 1.70 kW ERP at 94 m HAAT, Network: ABC vs. Analog (dashed): 513 kW ERP at 290 m HAAT, Network: ABC

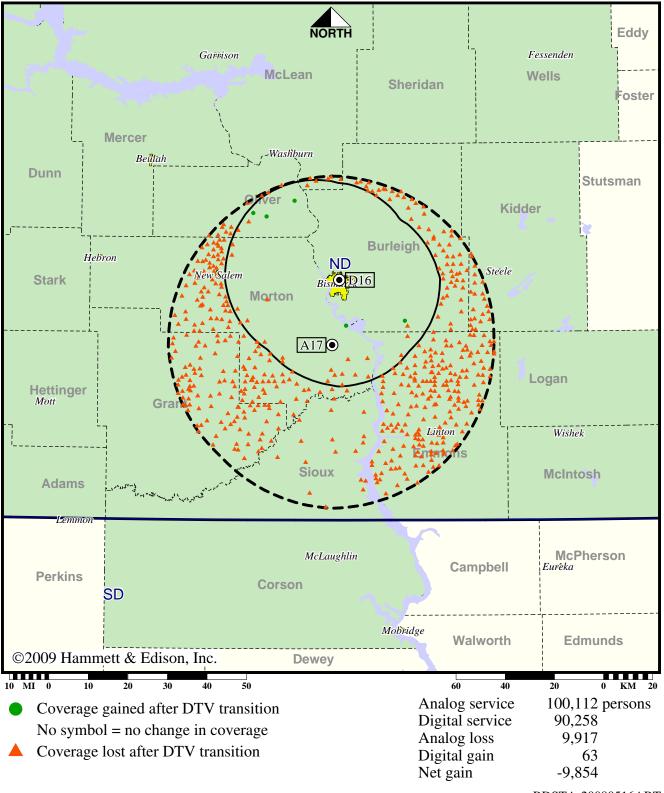


### Digital CP (solid): 94.5 kW ERP at 290 m HAAT, Network: ABC vs. Analog (dashed): 513 kW ERP at 290 m HAAT, Network: ABC

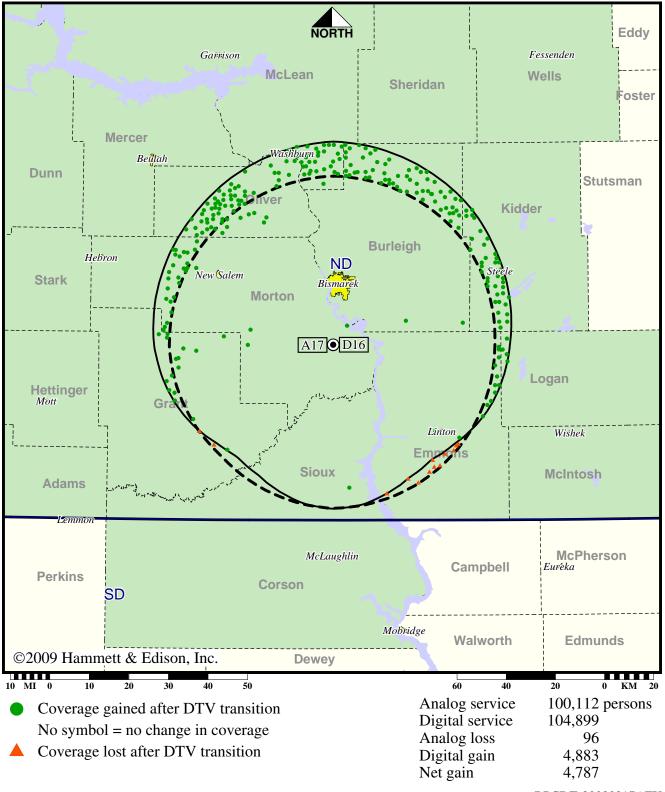

## Digital CP (solid): 8.35 kW ERP at 244 m HAAT, Network: PBS vs. Analog (dashed): 214 kW ERP at 246 m HAAT, Network: PBS

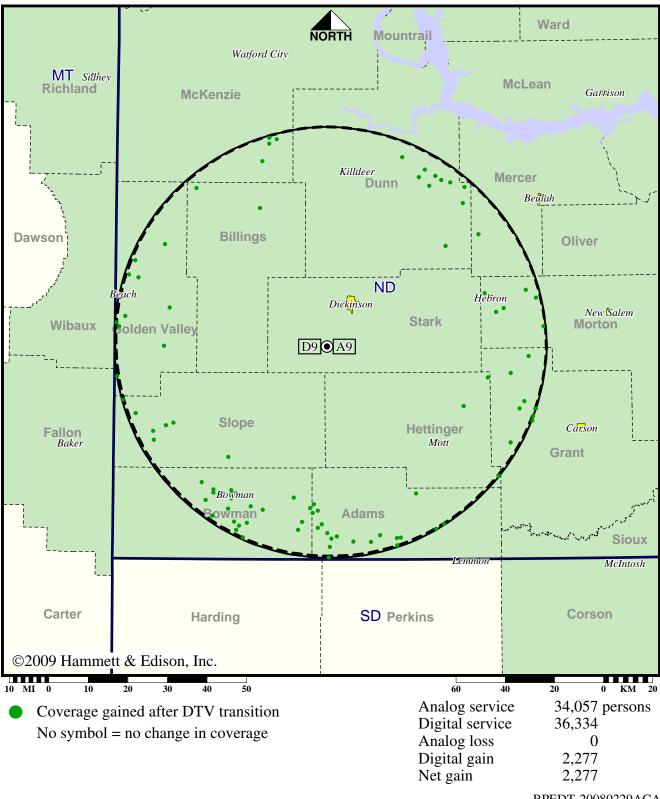


### Digital CP (solid): 8.35 kW ERP at 244 m HAAT, Network: PBS vs. Analog (dashed): 214 kW ERP at 246 m HAAT, Network: PBS

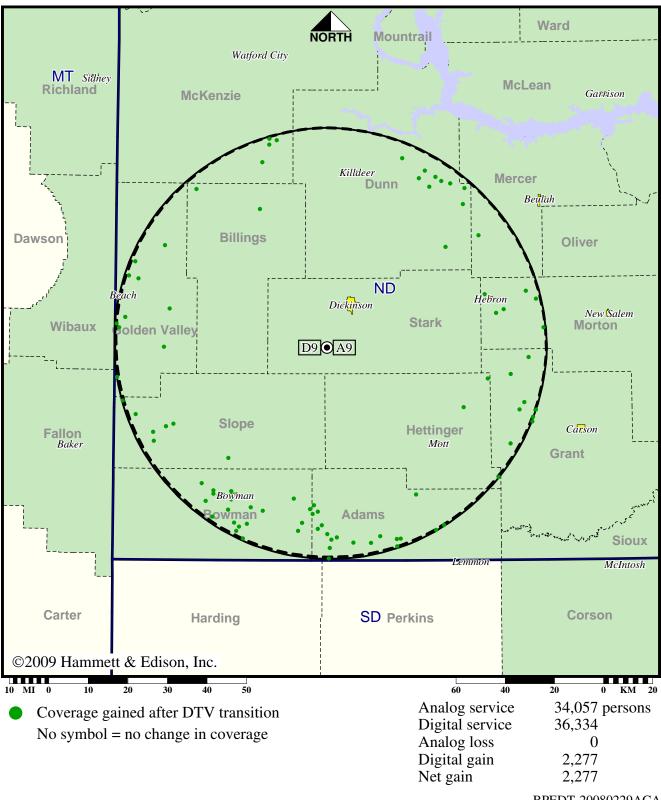


#### **Expected Operation on June 13: Licensed**

### Digital License (solid): 500 kW ERP at 389 m HAAT, Network: NBC vs. Analog (dashed): 100 kW ERP at 427 m HAAT, Network: NBC

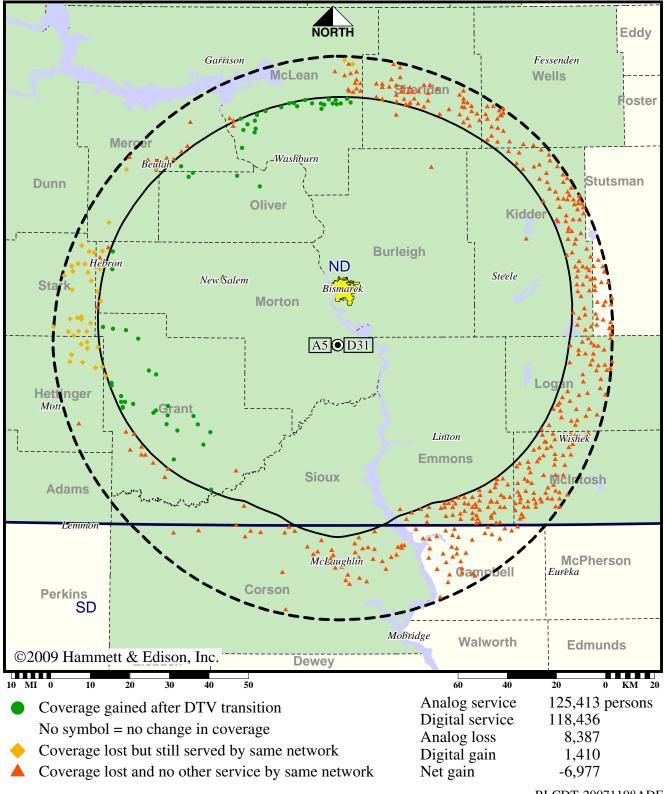


#### **Approved Post-Transition Operation: Licensed**


### Digital License (solid): 500 kW ERP at 389 m HAAT, Network: NBC vs. Analog (dashed): 100 kW ERP at 427 m HAAT, Network: NBC

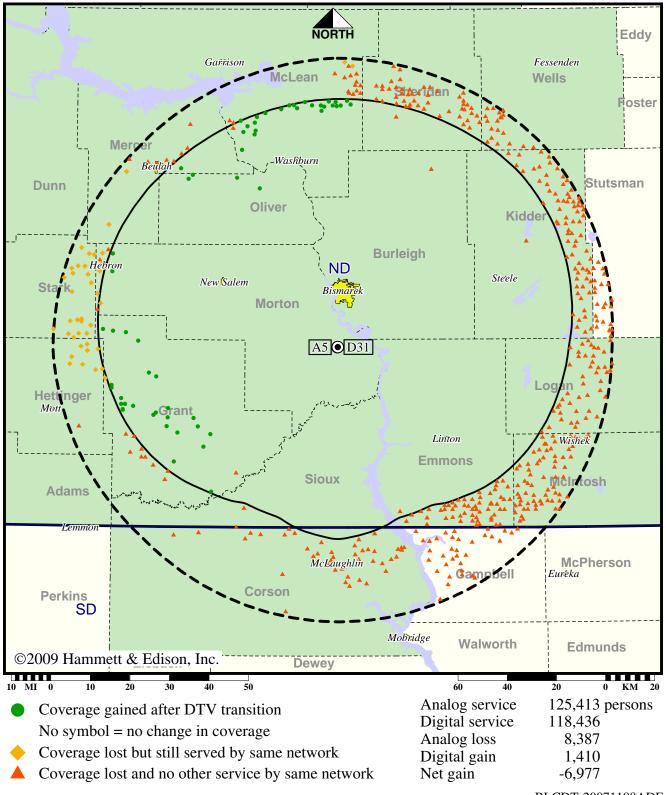


### Digital CP (solid): 40.0 kW ERP at 217 m HAAT, Network: ABC vs. Analog (dashed): 513 kW ERP at 229 m HAAT, Network: ABC

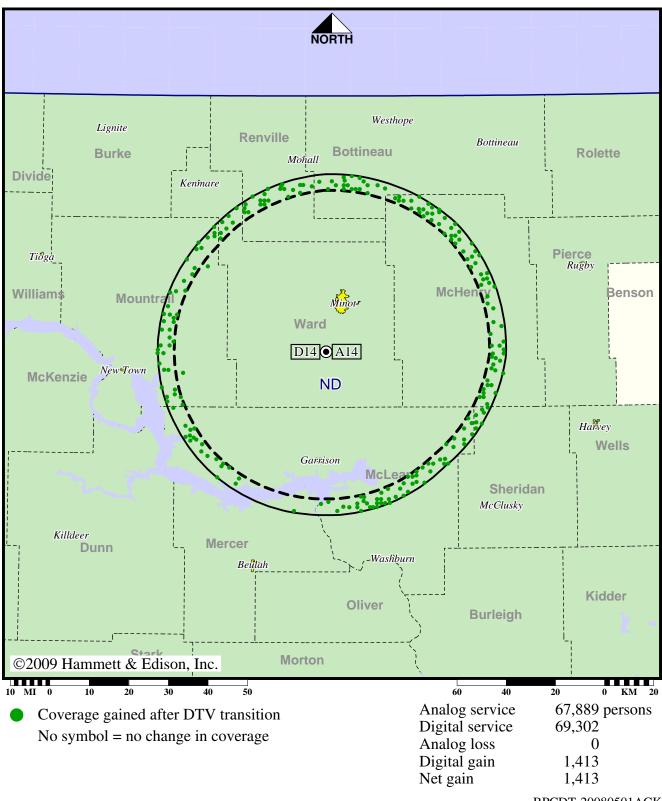


### Digital CP (solid): 40.0 kW ERP at 217 m HAAT, Network: ABC vs. Analog (dashed): 513 kW ERP at 229 m HAAT, Network: ABC

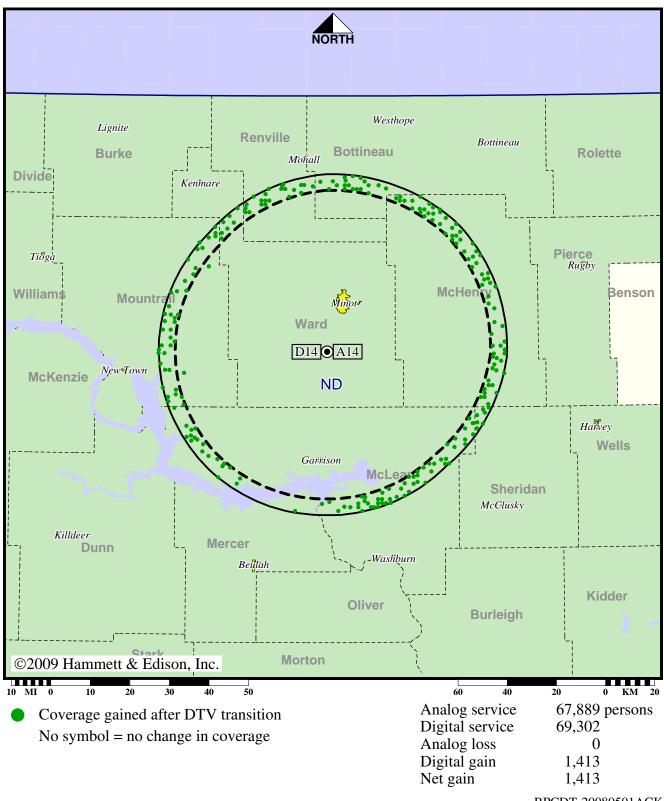


## Digital CP (solid): 7.69 kW ERP at 207 m HAAT, Network: NBC vs. Analog (dashed): 214 kW ERP at 207 m HAAT, Network: NBC

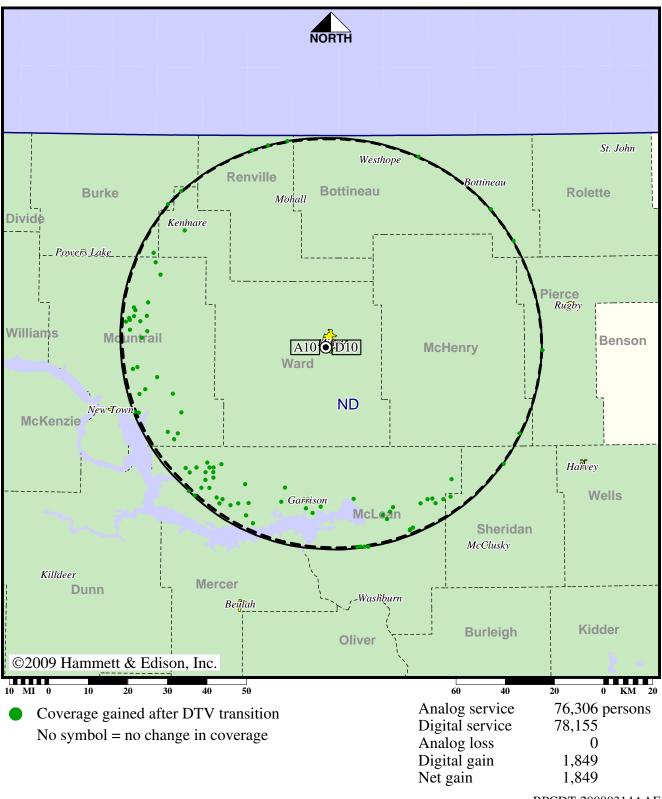


# Digital CP (solid): 7.69 kW ERP at 207 m HAAT, Network: NBC vs. Analog (dashed): 214 kW ERP at 207 m HAAT, Network: NBC

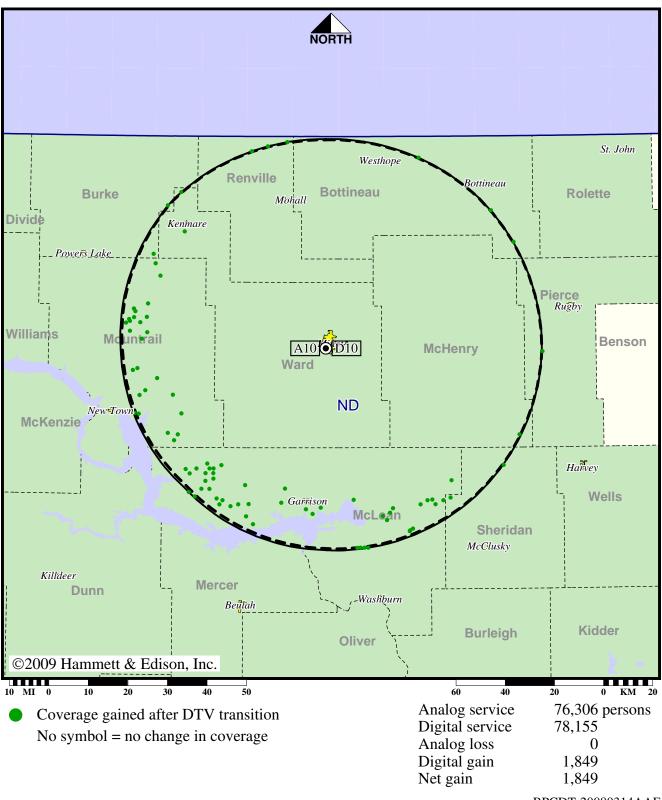


### Digital CP (solid): 50.0 kW ERP at 300 m HAAT, Network: Fox vs. Analog (dashed): 741 kW ERP at 300 m HAAT, Network: Fox

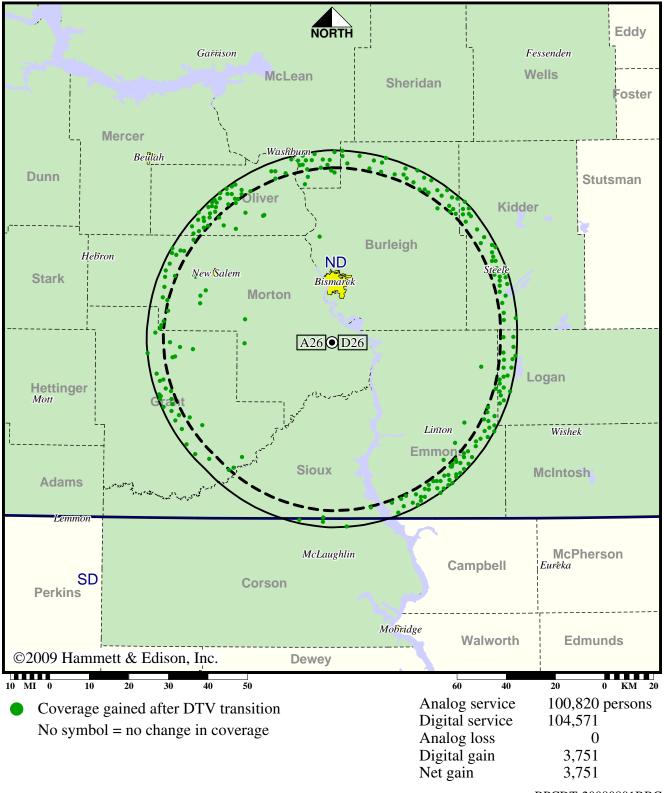


### Digital CP (solid): 50.0 kW ERP at 300 m HAAT, Network: Fox vs. Analog (dashed): 741 kW ERP at 300 m HAAT, Network: Fox

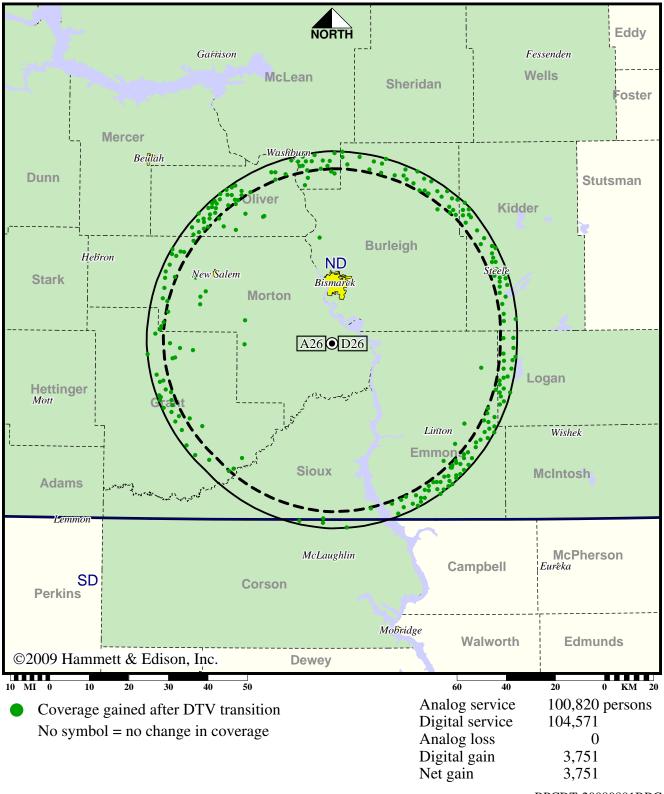


# Digital CP (solid): 21.9 kW ERP at 516 m HAAT, Network: PBS vs. Analog (dashed): 316 kW ERP at 516 m HAAT, Network: PBS

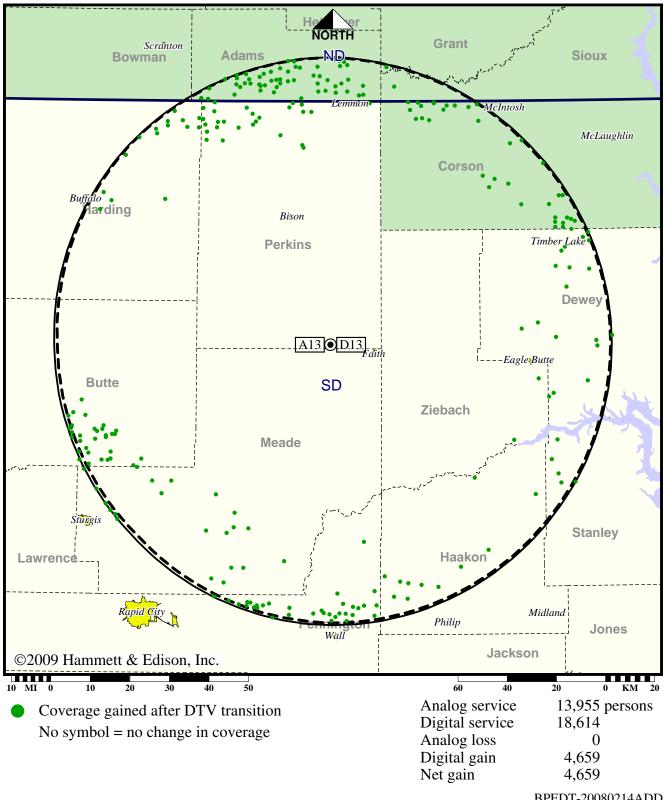


## Digital CP (solid): 27.0 kW ERP at 516 m HAAT, Network: PBS vs. Analog (dashed): 316 kW ERP at 516 m HAAT, Network: PBS

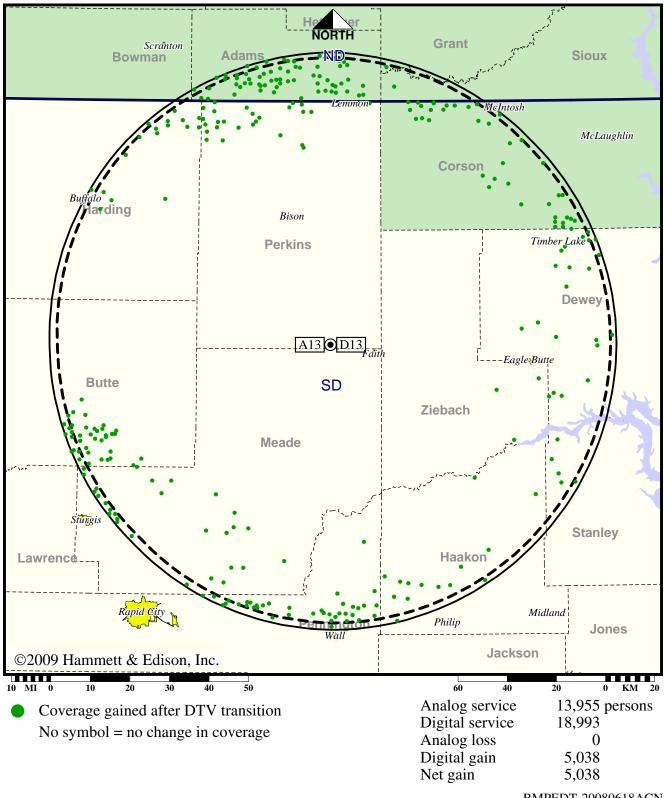

### Digital CP (solid): 11.3 kW ERP at 205 m HAAT, Network: NBC vs. Analog (dashed): 316 kW ERP at 223 m HAAT, Network: NBC

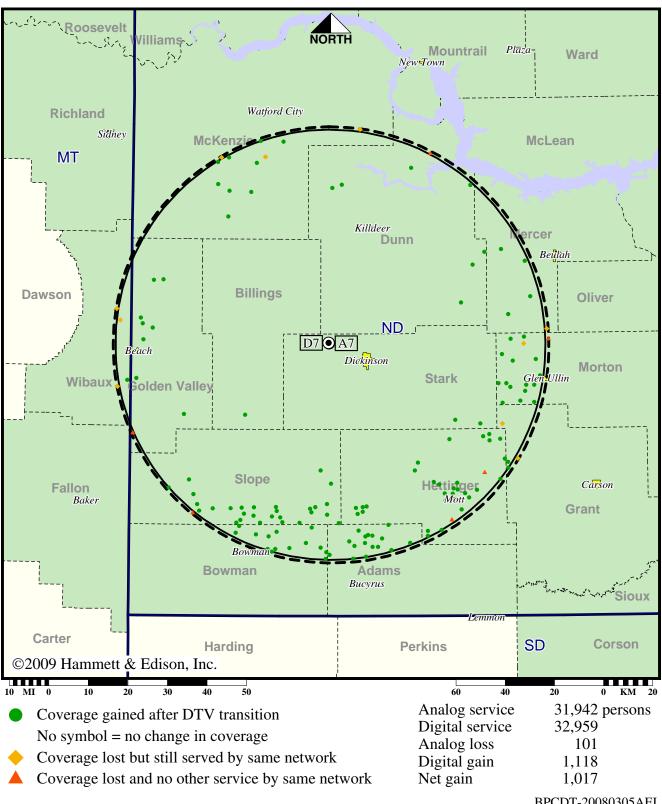


### Digital CP (solid): 11.3 kW ERP at 205 m HAAT, Network: NBC vs. Analog (dashed): 316 kW ERP at 223 m HAAT, Network: NBC

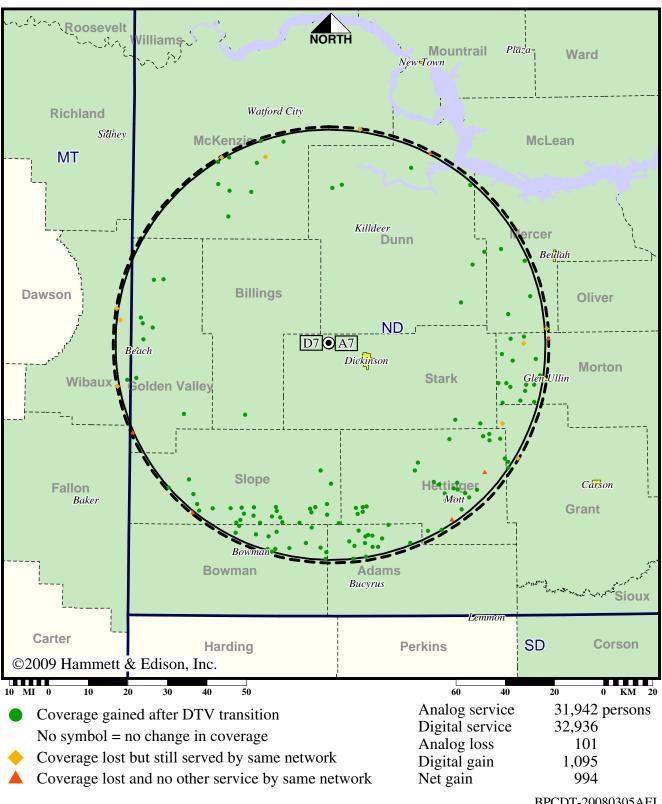


#### **Expected Operation on June 13: Licensed**

### Digital License (solid): 146 kW ERP at 249 m HAAT, Network: PBS vs. Analog (dashed): 100 kW ERP at 323 m HAAT, Network: PBS

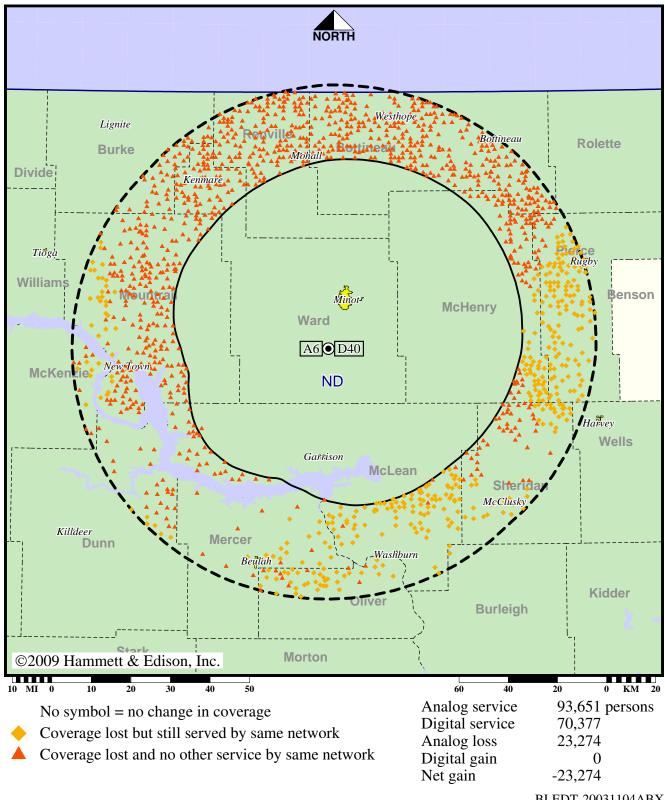


#### **Approved Post-Transition Operation: Licensed**


## Digital License (solid): 146 kW ERP at 249 m HAAT, Network: PBS vs. Analog (dashed): 100 kW ERP at 323 m HAAT, Network: PBS

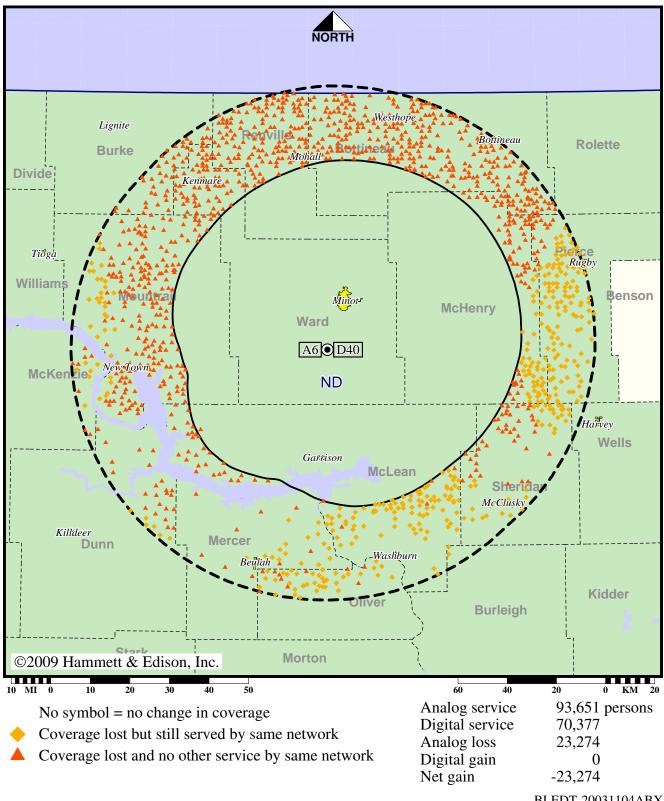

### Digital CP (solid): 6.00 kW ERP at 320 m HAAT, Network: NBC vs. Analog (dashed): 166 kW ERP at 323 m HAAT, Network: NBC

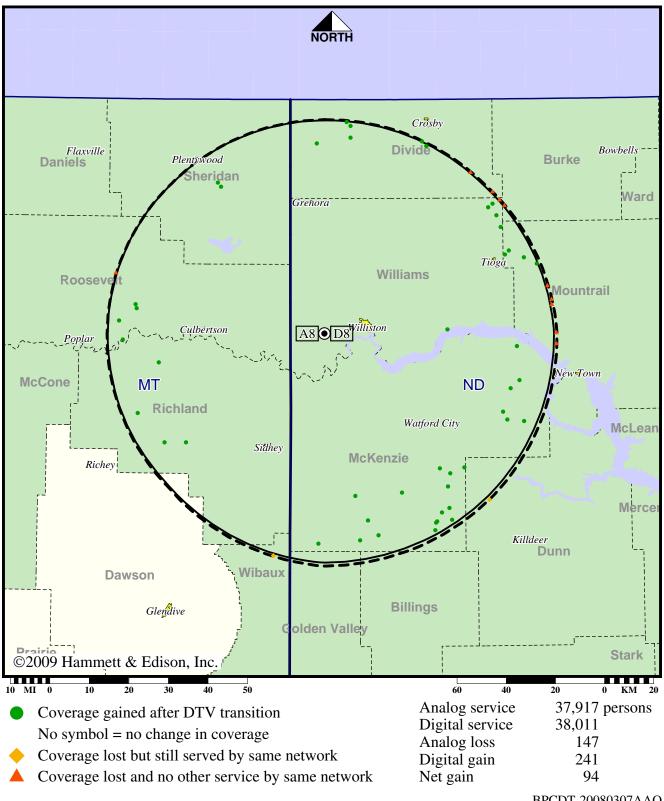


### Digital CP (solid): 6.00 kW ERP at 320 m HAAT, Network: NBC vs. Analog (dashed): 166 kW ERP at 323 m HAAT, Network: NBC

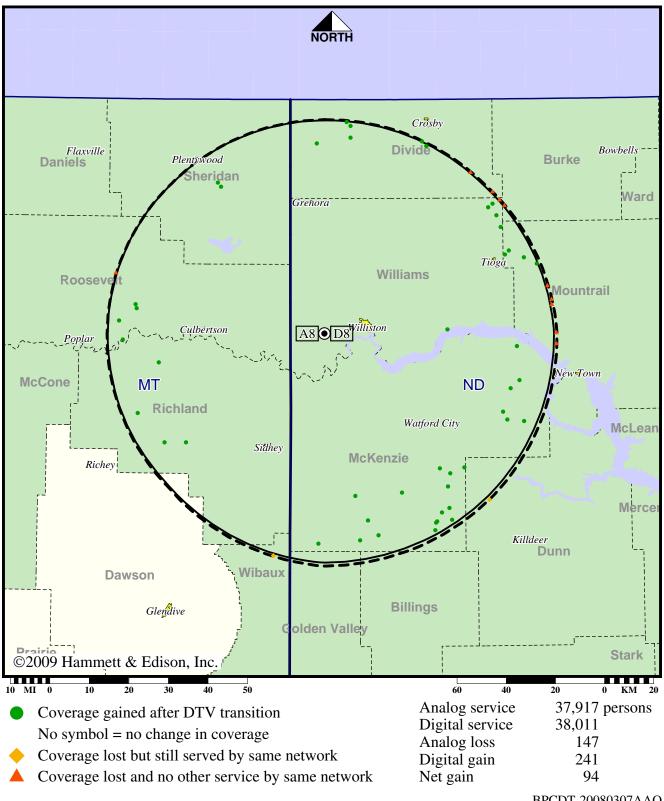


#### **Expected Operation on June 13: Licensed**

### Digital License (solid): 53.9 kW ERP at 248 m HAAT, Network: PBS vs. Analog (dashed): 79.4 kW ERP at 278 m HAAT, Network: PBS

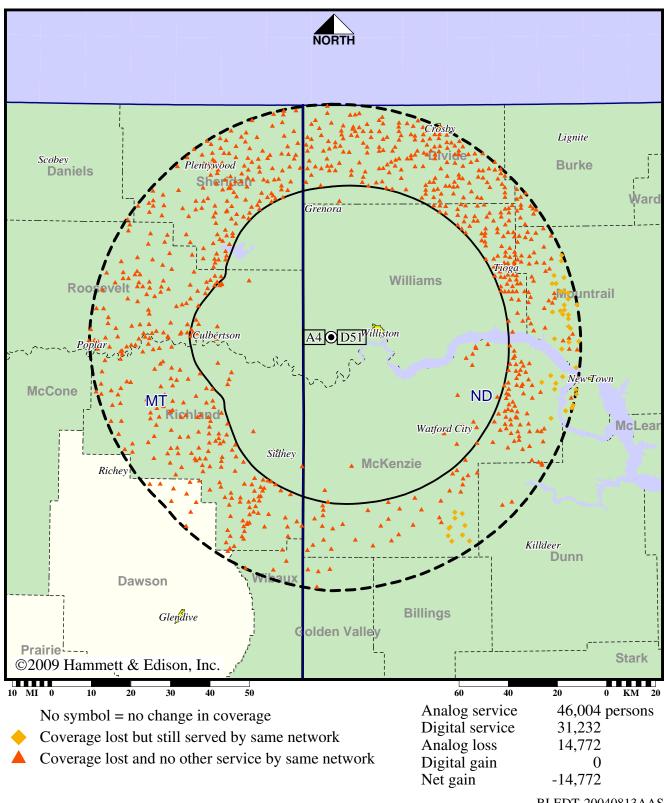

#### **Approved Post-Transition Operation: Licensed**


### Digital License (solid): 53.9 kW ERP at 248 m HAAT, Network: PBS vs. Analog (dashed): 79.4 kW ERP at 278 m HAAT, Network: PBS

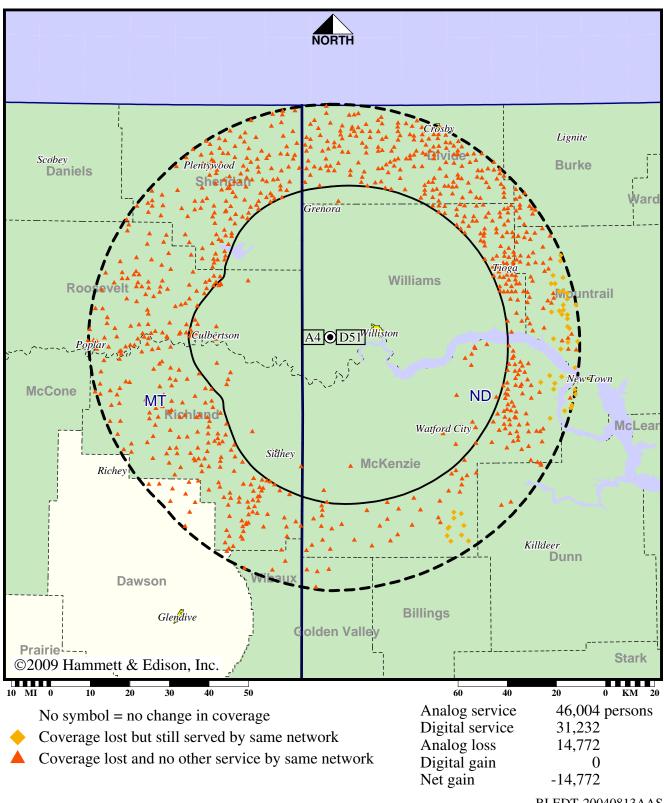


Market: Minot-Bismarck-Dickinson, ND

BLEDT-20040813AAS KWSE Digital License

### Digital CP (solid): 50.0 kW ERP at 217 m HAAT, Network: CBS vs. Analog (dashed): 100 kW ERP at 256 m HAAT, Network: CBS

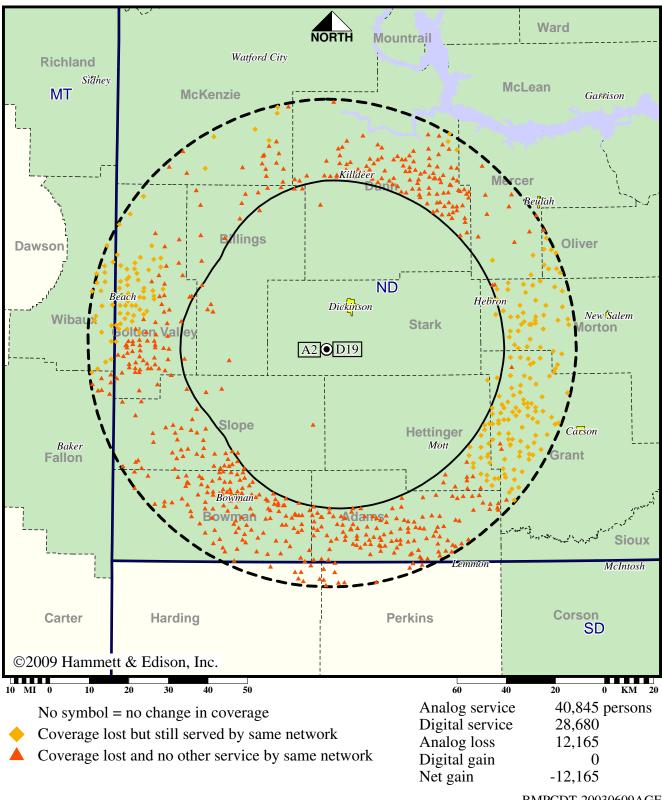


### Digital CP (solid): 50.0 kW ERP at 217 m HAAT, Network: CBS vs. Analog (dashed): 100 kW ERP at 256 m HAAT, Network: CBS

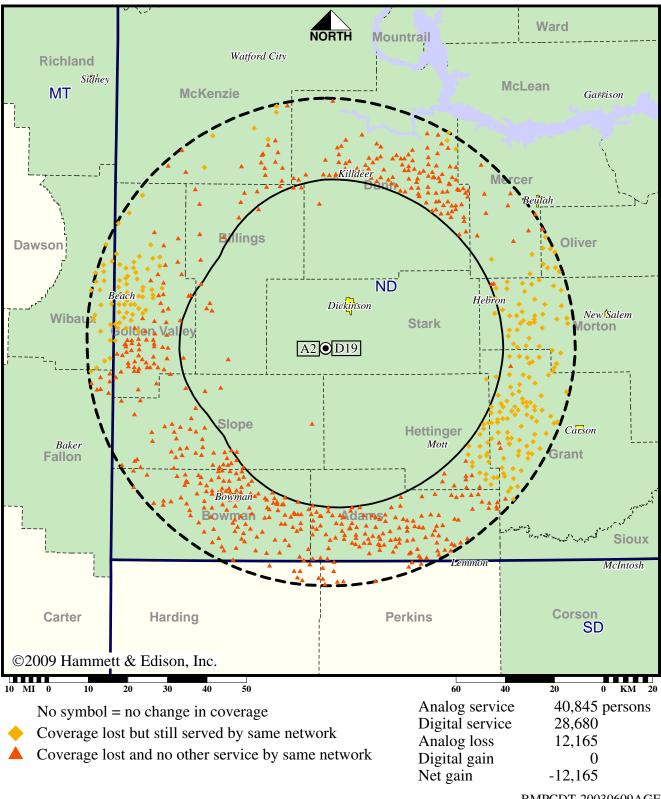


Market: Minot-Bismarck-Dickinson, ND

BMPCDT-20030609AGE KXMA-TV Digital CP


### Digital CP (solid): 19.1 kW ERP at 444 m HAAT, Network: CBS vs. Analog (dashed): 316 kW ERP at 466 m HAAT, Network: CBS

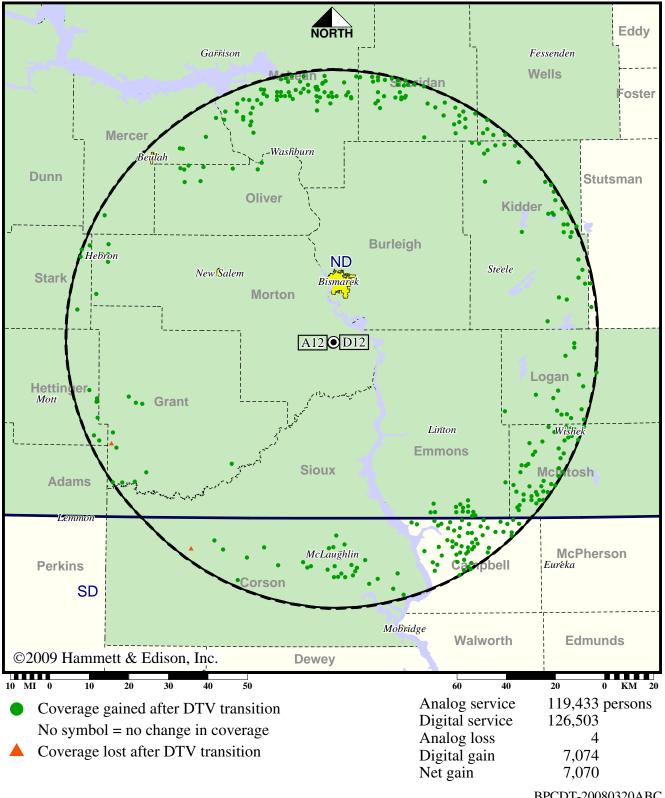


### Digital CP (solid): 19.1 kW ERP at 444 m HAAT, Network: CBS vs. Analog (dashed): 316 kW ERP at 466 m HAAT, Network: CBS

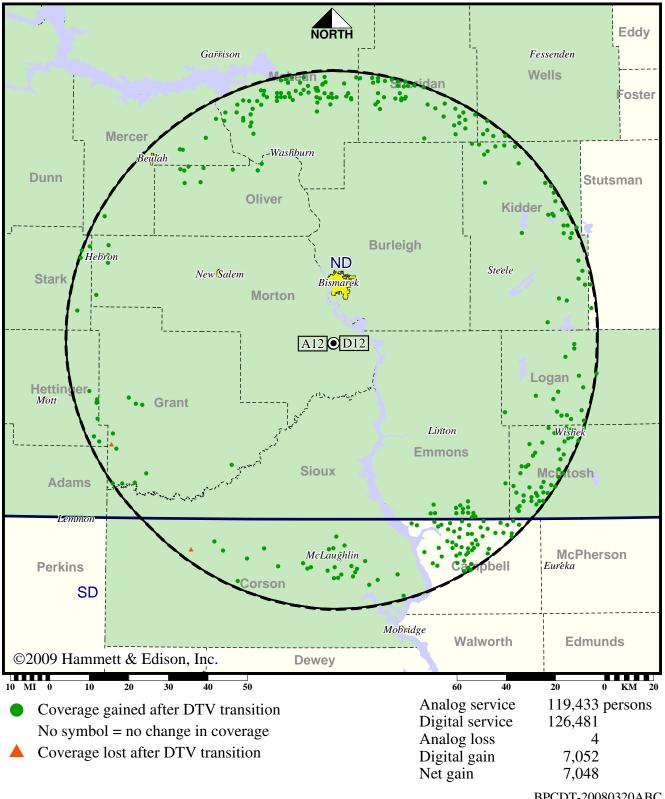


### Digital CP (solid): 16.1 kW ERP at 334 m HAAT, Network: CBS vs. Analog (dashed): 316 kW ERP at 344 m HAAT, Network: CBS

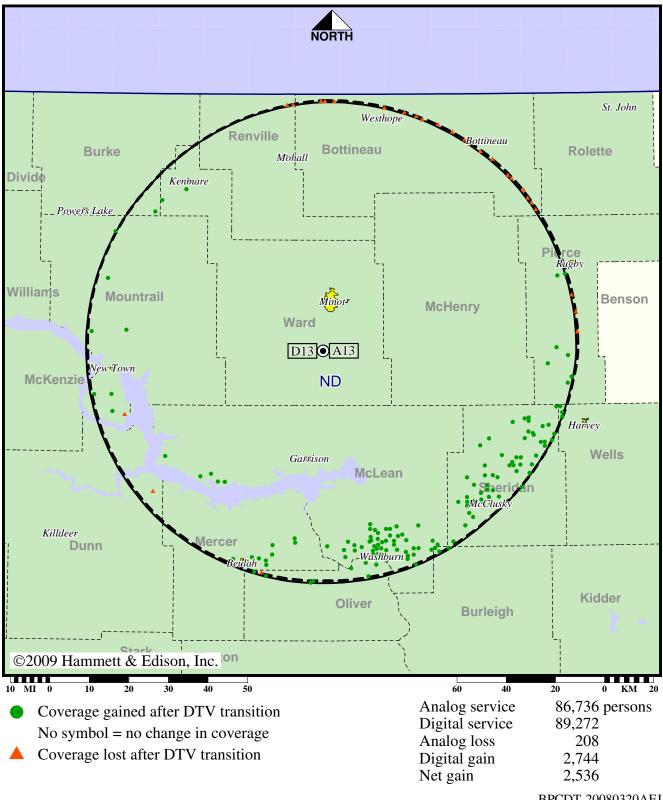


### Digital CP (solid): 16.1 kW ERP at 334 m HAAT, Network: CBS vs. Analog (dashed): 316 kW ERP at 344 m HAAT, Network: CBS

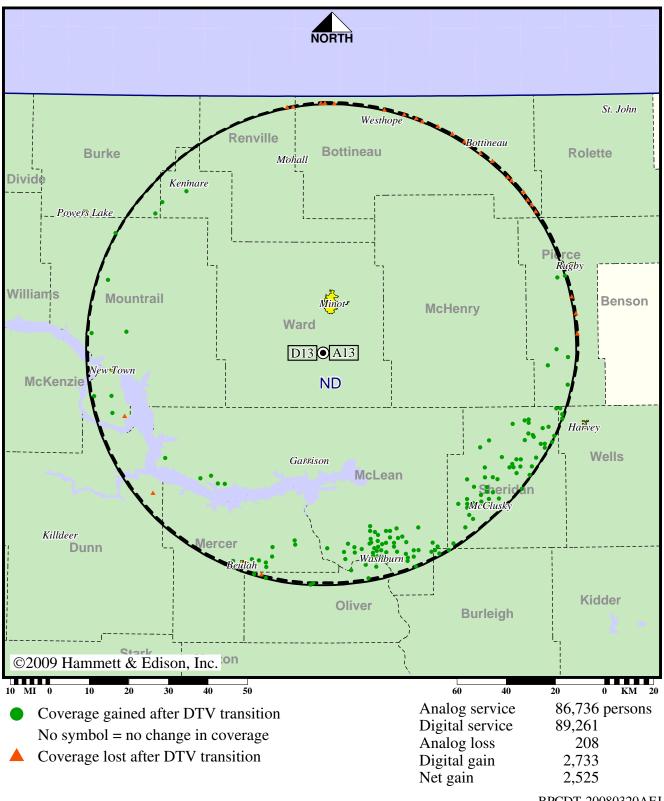


### Digital CP (solid): 50.0 kW ERP at 257 m HAAT, Network: CBS vs. Analog (dashed): 100 kW ERP at 291 m HAAT, Network: CBS

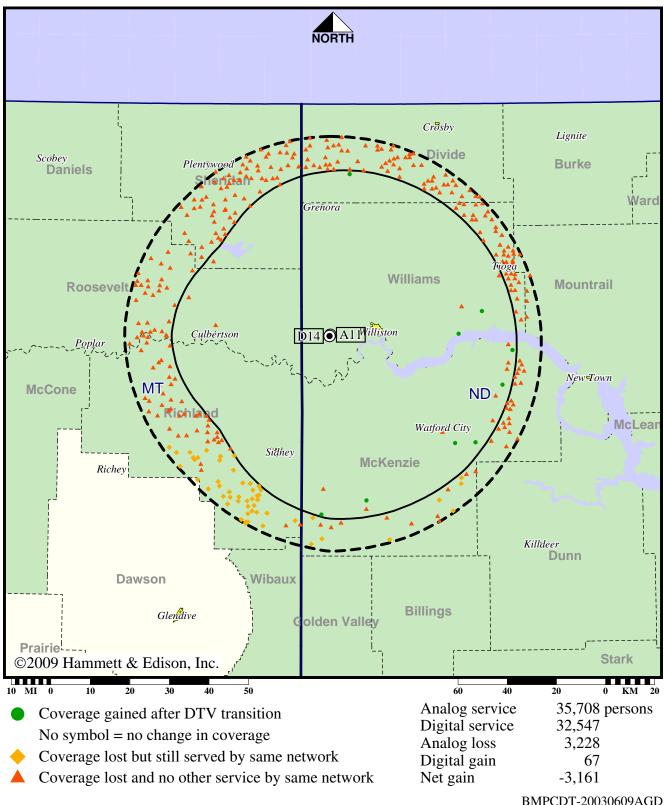

### Digital CP (solid): 50.0 kW ERP at 257 m HAAT, Network: CBS vs. Analog (dashed): 100 kW ERP at 291 m HAAT, Network: CBS

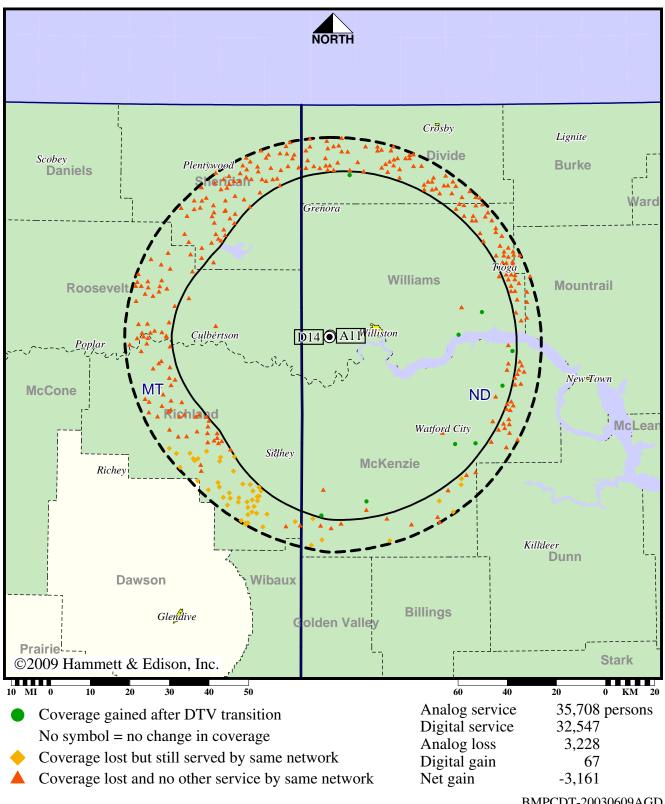

### Digital CP (solid): 50.0 kW ERP at 239 m HAAT, Network: Fox vs. Analog (dashed): 740 kW ERP at 239 m HAAT, Network: Fox

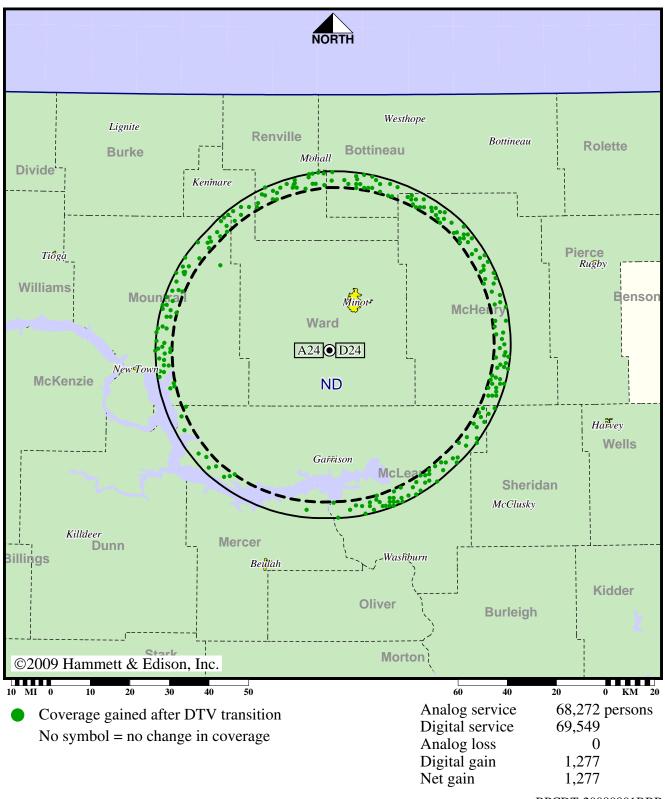

### Digital CP (solid): 50.0 kW ERP at 239 m HAAT, Network: Fox vs. Analog (dashed): 740 kW ERP at 239 m HAAT, Network: Fox

